

A Non-Combustible Exterior Wall Insulation System
with Moisture Drainage utilizing Mineral Wool Insulation

DS983

Outsulation Mineral Wool System Installation Details

Table of Contents

Detail

OUTSULATION MINERAL WOOL SYSTEM CUTAWAY	OMW 1
AWRB APPLICATION	OMW 2
OPENING PREPARATION- AQUAFLASH® SYSTEM OR EXOAIR 230 WITH MESH OPTION	OMW 3
OPENING PREPARATION- BACKSTOP® FLASH AND FILL OR DYMONIC 100 OPTION	OMW 3a
OPENING PREPARATION- BACKSTOP® NTX OR EXOAIR 230 WITH MESH OPTION	OMW 4
OPENING FLASHING INTEGRATION	OMW 5
OPENING FLASHING INTEGRATION - BACKSTOP® FLASH AND FILL OR DYMONIC 100 OPTION	OMW 5a
MECHANICAL FASTENINGS - 6 PATTERN OPTION AND LOAD TABLE	OMW 6
MECHANICAL FASTENING - 9 PATTERN OPTION	OMW 6a
FASTENER OPTIONS	OMW 7
STARTER BOARD	OMW 8
INSIDE/OUTSIDE CORNERS	OMW 9
INSIDE/OUTSIDE CORNERS - BACKSTOP® FLASH AND FILL OR DYMONIC 100 OPTION	OMW 9a
OUTSIDE CORNER - CORNER BEAD OPTIONS	OMW 10
OUTSIDE CORNER - HIGH IMPACT	OMW 10a
TERMINATION AT GRADE	OMW 11
TERMINATION AT CONCRETE CURB	OMW 12
TERMINATION AT ADA COMPLIANT SIDEWALK	OMW 13
TERMINATION AT ADA COMPLIANT SIDEWALK - TREMCO OPTION	OMW 13a
TERMINATION AT WATERPROOF DECK	OMW 14
TERMINATION AT WOOD FRAMED DECK	OMW 15

NOTE:

DRYVIT AND TREMCO MAKES NO REPRESENTATION REGARDING CONFORMITY OF ITS SUGGESTIONS TO MODEL BUILDING CODES, ENGINEERING CRITERIA, SPECIFIC APPLICATIONS, OR PROJECT LOCATIONS. ALL COMPONENTS INDICATED IN ILLUSTRATIONS, AS WELL AS OTHERS THAT MAY BE REQUIRED FOR THE INTEGRITY OF THE SYSTEM SHALL BE DESIGNED, DETAILED, AND ENGINEERED BY REPRESENTATIVES OF THE ARCHITECT, OWNER, OR CONTRACTOR TO BE IN CONFORMANCE WITH MODEL CODES, ARCHITECTURAL, AND ENGINEERING REQUIREMENTS PERTAINING TO SPECIFIC BUILDING PROJECTS.

DRYVIT AND TREMCO MAKE NO WARRANTY, EXPRESSED OR IMPLIED, AS TO THE ARCHITECTURAL DESIGN, ENGINEERING, OR WORKMANSHIP OF PROJECTS UTILIZING DRYVIT SYSTEMS OR PRODUCTS.

THE LIABILITIES OF DRYVIT AND TREMCO SHALL BE AS STATED IN THE DRYVIT STANDARD WARRANTY. CONTACT DRYVIT AND TREMCO FOR A FULL AND COMPLETE COPY OF THE WARRANTY.

Detail

INSULATION PREPARATION AT WALL PENETRATIONS	OMW 16
STOREFRONT WINDOW SILL - JAMB	OMW 17
STOREFRONT AND FLANGED WINDOW HEAD	OMW 18
PREPARATION AT PARAPET/ WALL INTERSECTION	OMW 19
TERMINATION AT PARAPET - CAP FLASHING	OMW 20
TERMINATION AT ROOF MEMBRANE	OMW 21
TERMINATION AT ROOF MEMBRANE - EXOAIR 110AT/ DYMONIC 100 OPTION	OMW 21a
TERMINATION AT SLOPED ROOF	OMW 22
VERTICAL WALL/SUSPENDED SOFFIT TRANSITION	OMW 23
TRANSITION AT SOFFIT/ FASCIA INTERSECTION	OMW 24
FASCIA/UNINSULATED SOFFIT TRANSITION	OMW 25
TERMINATION AT UNINSULATED SOFFIT VENT	OMW 26
HORIZONTAL JOINT AT FLOOR LINE WITHOUT WEEPS	OMW 27
HORIZONTAL JOINT AT FLOOR LINE WITH WEEPS	OMW 28
HORIZONTAL JOINT AT FLOOR LINE WITH WEEPS - EXOAIR 110AT OPTION	OMW 28a
HORIZONTAL JOINT - SUBSTRATE CHANGE	OMW 29
HORIZONTAL TERMINATION AT ADJACENT THIN PROFILE CLADDING	OMW 30
VERTICAL EIFS EXPANSION JOINT	OMW 31
THROUGH-WALL EXPANSION JOINT	OMW 32
THROUGH-WALL EXPANSION JOINT - DYMONIC 100 OPTION	OMW 32a
VERTICAL EXPANSION JOINT - FLUSH AND RECESSED OPTIONS	OMW 33
VERTICAL EXPANSION JOINT - DOUBLE SEAL OPTION	OMW 34
VERTICAL TERMINATION AT ADJACENT CLADDING	OMW 35
PENETRATIONS	OMW 36
SIGN ATTACHMENT	OMW 37
AESTHETIC REVEALS	OMW 38
FIELD-FABRICATED MINERAL WOOL SHAPES	OMW 39

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Table of Contents

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024

File Name:


TOC




Construction Products Group

www.tremcocpg.com

STANDARD IMPACT
RESISTANCE

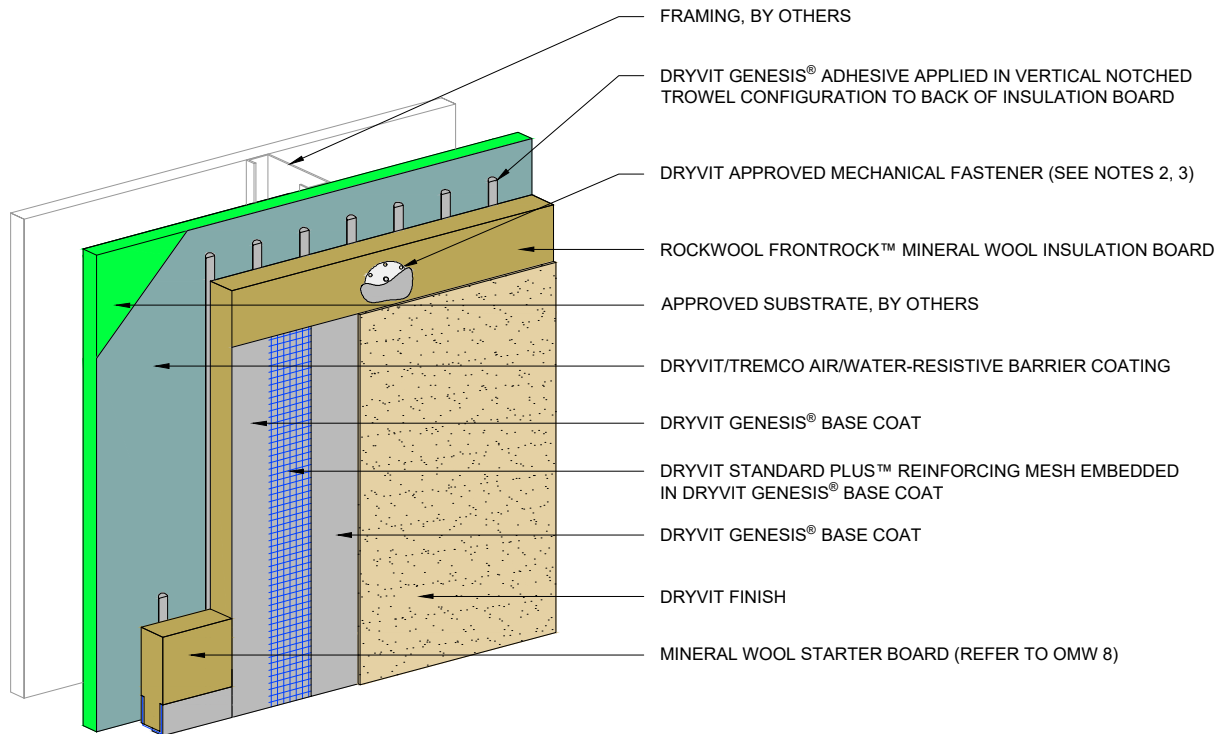

ULTRA HIGH IMPACT
RESISTANCE

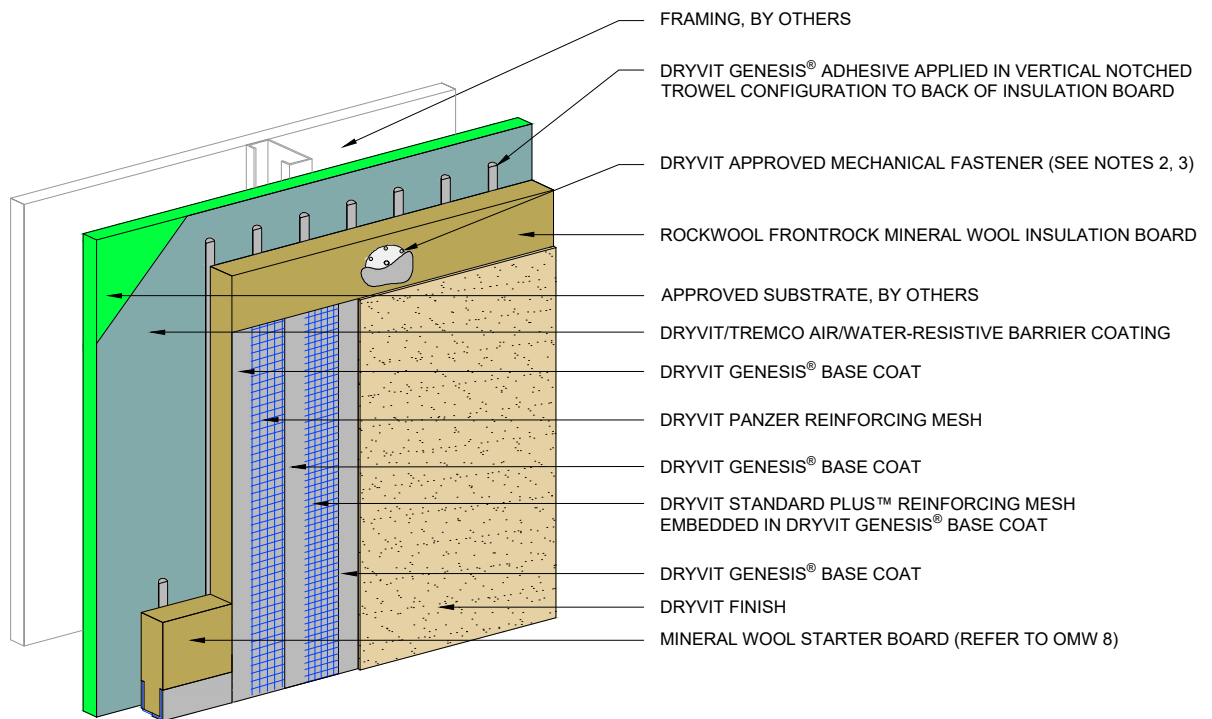

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
3. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Outsulation Mineral Wool System Cutaway

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 1



Construction Products Group

www.tremcocpg.com

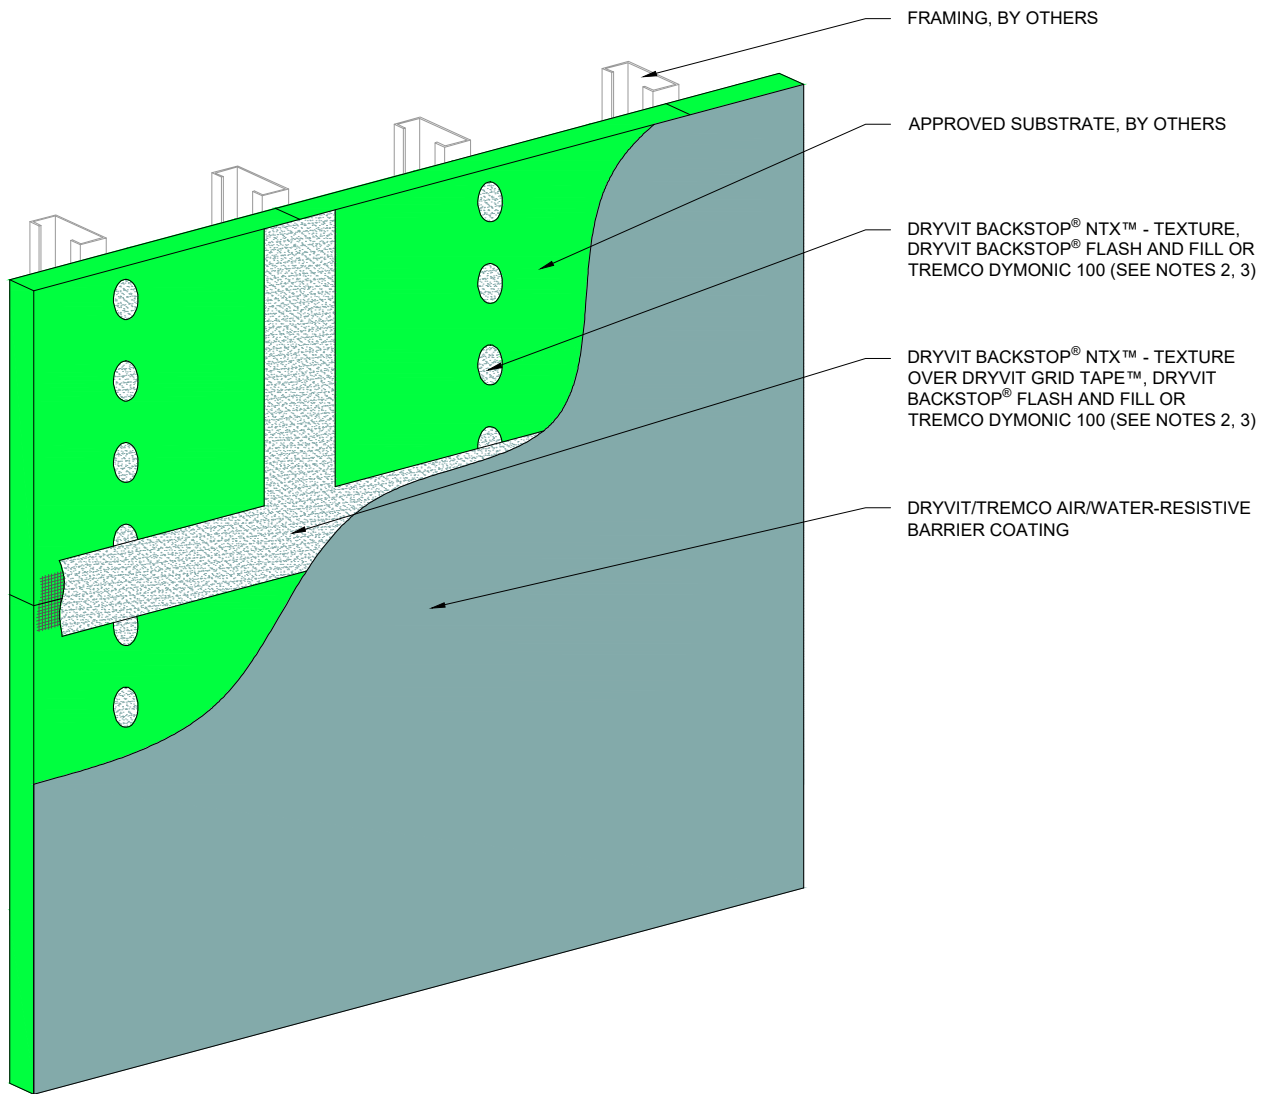

NOTE:

1. FOR ADDITIONAL BACKSTOP® NTX™ DETAILS, REFER TO DRYVIT PUBLICATION DS840.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Dryvit/Tremco AWRB Application

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 2




Construction Products Group


www.tremcocpg.com

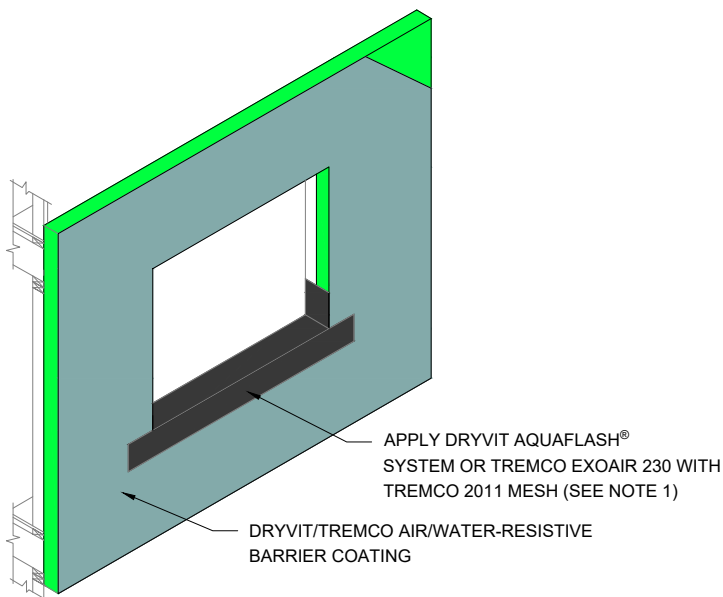


STEP #1

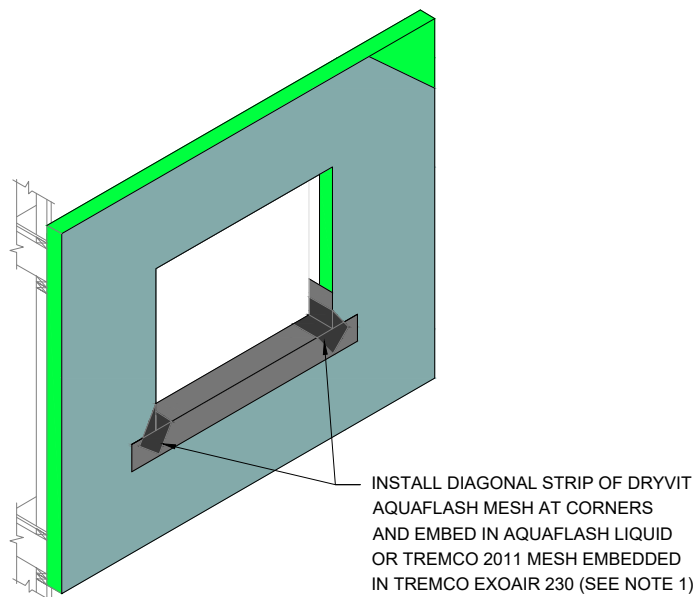

STEP #2

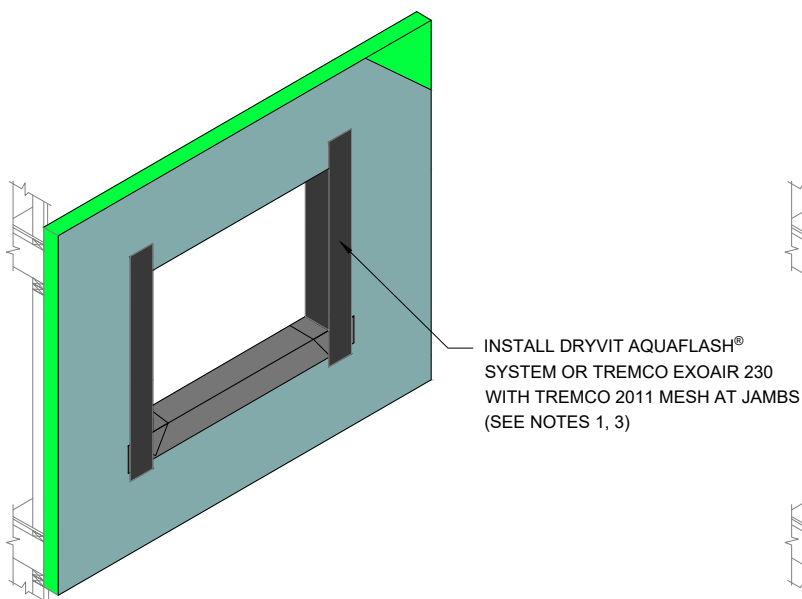

STEP #3

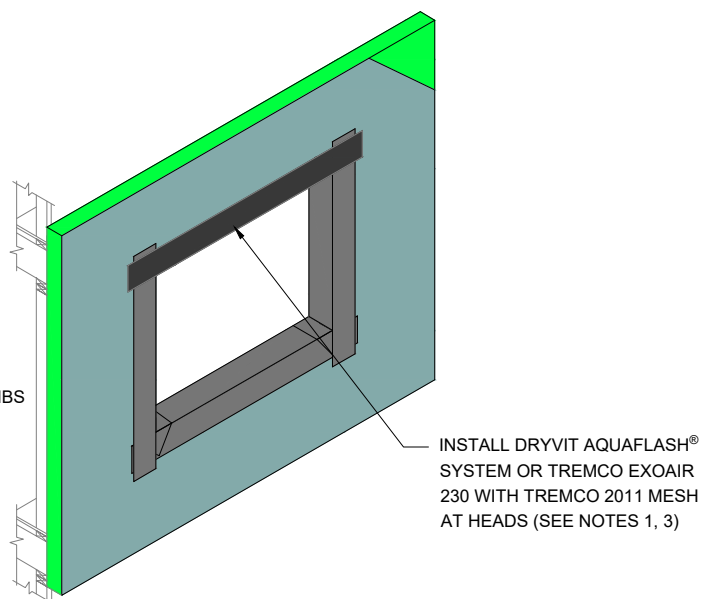

STEP #4

NOTE:

1. DRYVIT AQUAFLASH® SYSTEM OR TREMCO EXOAIR 230 WITH TREMCO 2011 MESH SHALL EXTEND TO INTERIOR FACE OF OPENING.
2. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.
3. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS.
4. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
5. FOR ADDITIONAL BACKSTOP® NTX™ DETAILS, REFER TO DRYVIT PUBLICATION DS840.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Opening Preparation - AquaFlash® System or ExoAir 230 with Mesh Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 3



Construction Products Group

www.tremcocpg.com

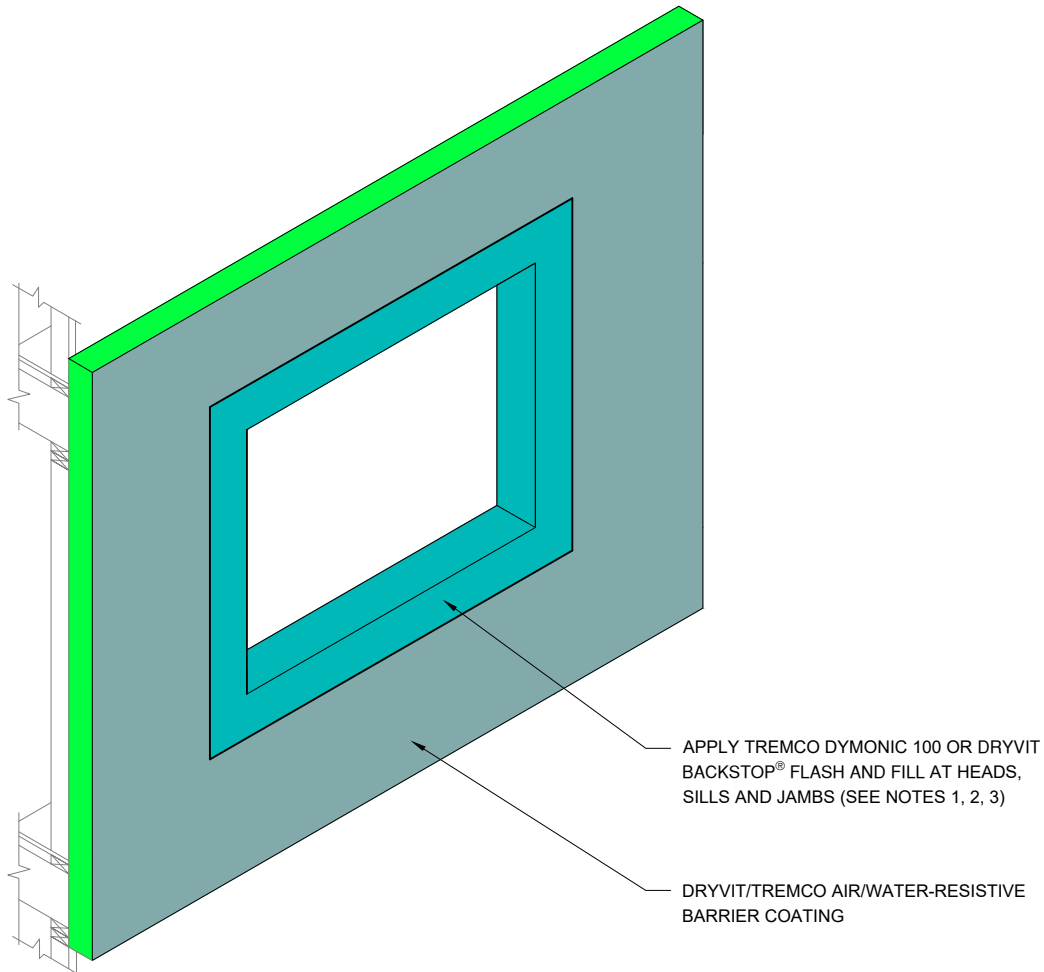


NOTE:

1. REFER TO HEAD, SILL AND JAMB DETAILS FOR FLASHING INTEGRATION.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.


Outsulation® Mineral Wool System

 Dryvit Technical Support: 800-556-7752	Detail: Opening Preparation - Dryvit Backstop® Flash And Fill or Tremco Dymonic 100 Option				File Name: OMW 3a	 Construction Products Group
	Drawn by: HDE	Checked by: CW	Scale: NTS	Date: 2/28/2024		
	www.tremcocpg.com					

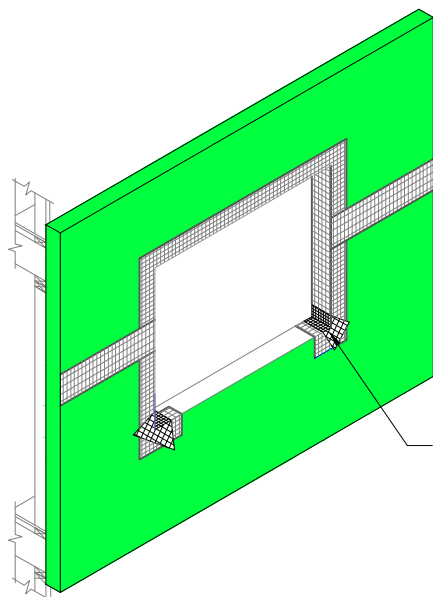

APPLY DRYVIT GRID TAPE™ OR
TREMCO 2011 MESH
(SEE NOTES 1, 2, 6)


STEP #1

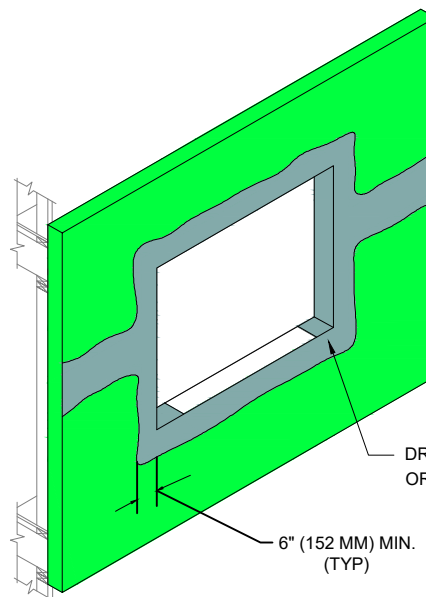

DRYVIT BACKSTOP® NTX™ - TEXTURE
OR EXOAIR 230 (SEE NOTES 1, 2)


6" (152 MM) MIN.
(TYP)

STEP #2

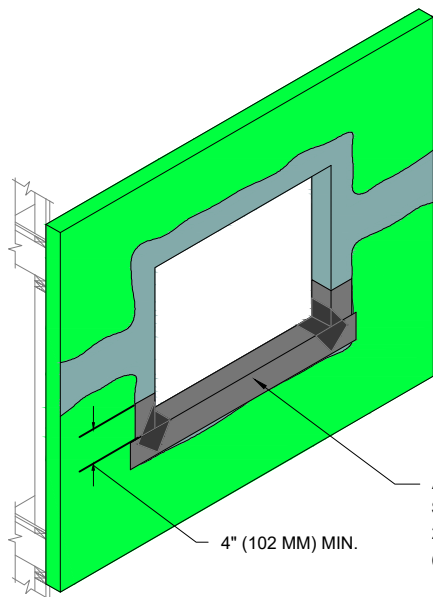

APPLY DRYVIT AQUAFASH®
SYSTEM OR TREMCO EXOAIR
230 OVER TREMCO 2011 MESH
(SEE NOTES 2, 4, 6)

STEP #3

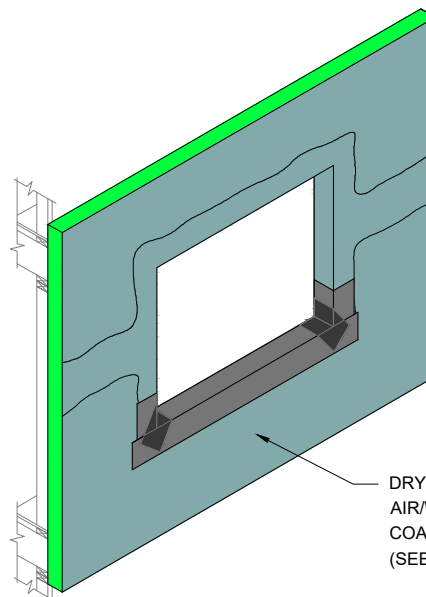

DRYVIT/TREMCO
AIR/WATER-RESISTIVE BARRIER
COATING APPLIED TO FACE OF WALL
(SEE NOTE 4)

STEP #4

NOTE:

1. APPLY OPENING PREPARATION TREATMENT ON HEAD, JAMB, AND CORNERS OF OPENINGS AND SHEATHING JOINTS. DRYVIT GRID TAPE™ IS ONLY TO BE USED WITH BACKSTOP® NTX™ - TEXTURE. TREMCO 2011 MESH IS ONLY TO BE USED WITH TREMCO EXOAIR 230
2. TROWEL APPLY DRYVIT BACKSTOP® NTX™ - TEXTURE OVER DRYVIT GRID TAPE™ OR APPLY TREMCO EXOAIR 230 WITH TREMCO 2011 MESH ALL THE WAY TO INSIDE FACE OF OPENING. ALL VOIDS MUST BE FILLED; MULTIPLE PASSES MAY BE REQUIRED. AS AN OPTION, DRYVIT GRID TAPE™ AND DRYVIT BACKSTOP® NTX™ - TEXTURE MAY ALSO BE APPLIED AT THE SILL PRIOR TO DRYVIT AQUAFASH® SYSTEM APPLICATION.
3. INSTALL WINDOW UNIT AND ASSOCIATED FLASHINGS PER MANUFACTURER'S RECOMMENDATIONS, CODE REQUIREMENTS AND PROJECT DOCUMENTS.
4. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.
5. FOR ADDITIONAL BACKSTOP® NTX™ DETAILS, REFER TO DRYVIT PUBLICATION DS840.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Opening Preparation - Backstop® NTX or ExoAir 230 with Mesh Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 4




Construction Products Group

www.tremcocpg.com

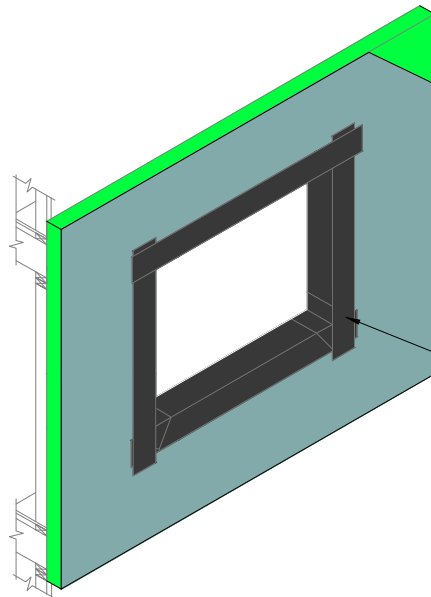

REFER TO OMW 3 AND OMW 4 FOR
PREPARATION OF OPENING PRIOR TO
FLASHING INSTALLATION


STEP #1

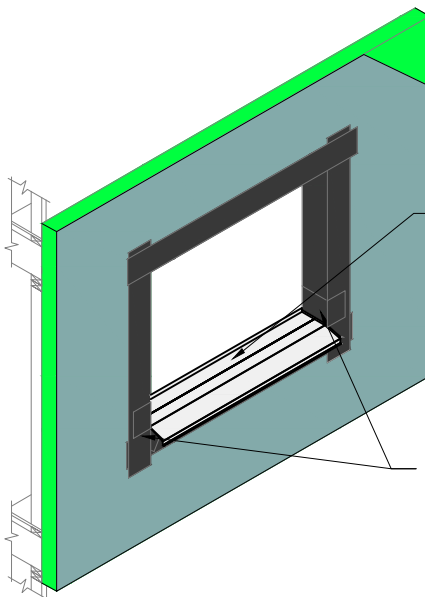

SILL PAN FLASHING, BY OTHERS

APPLY DRYVIT AQUAFLASH®
SYSTEM OR TREMCO EXOAIR 230 WITH
TREMCO 2011 MESH SPLICES LAPPING
OVER LIP OF SILL PAN FLASHING
(SEE NOTE 1)

STEP #2

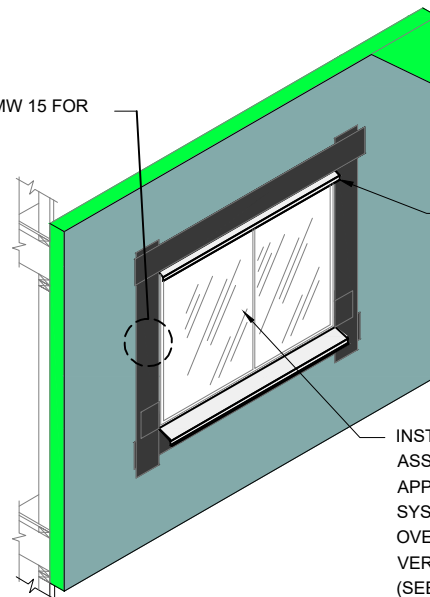

REFER TO OMW 15 FOR
JAMB DETAIL

HEAD FLASHING,
BY OTHERS

INSTALL WINDOW UNIT AND
ASSOCIATED FLASHINGS AND
APPLY DRYVIT AQUAFLASH®
SYSTEM OR TREMCO EXOAIR 230
OVER TREMCO 2011 MESH OVER
VERTICAL LEG OF FLASHING
(SEE NOTES 1, 2)

STEP #3

NOTE:

1. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.
2. FOR ADDITIONAL BACKSTOP® NTX™ DETAILS, REFER TO DRYVIT PUBLICATION DS840.
3. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Opening Flashing Integration

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 5




Construction Products Group


www.tremcocpg.com

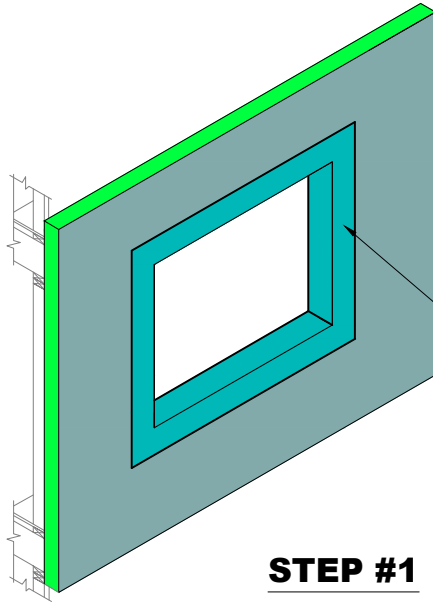

STEP #1

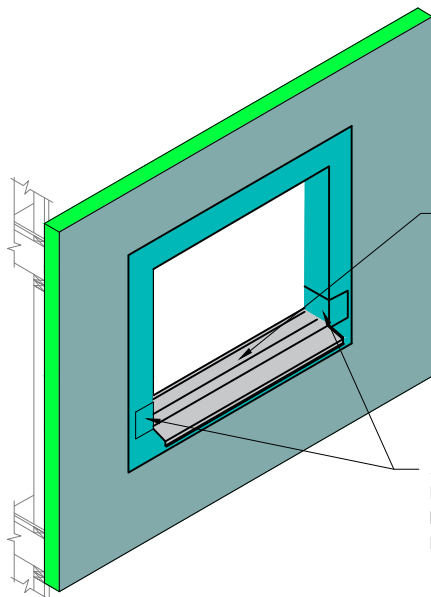

STEP #2

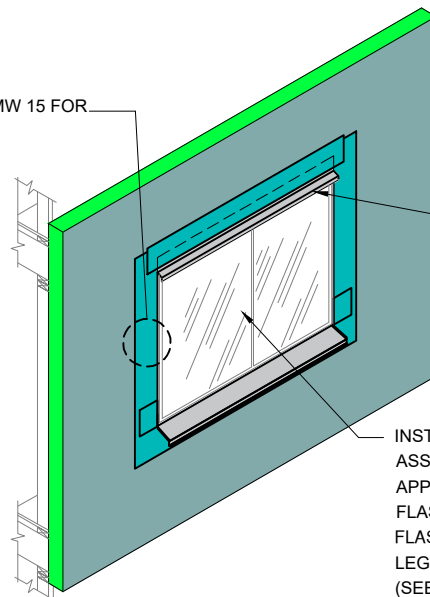

STEP #3

NOTE:

1. REFER TO HEAD, SILL, AND JAMB DETAILS FOR FLASHING INTEGRATION.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Opening Flashing Integration - Backstop® Flash and Fill or Tremco Dymonic 100 Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024

File Name:

OMW 5a



Construction Products Group

www.tremcocpg.com

MECHANICAL FASTENING - 6 FASTENER PATTERN (FIELD OF WALL)

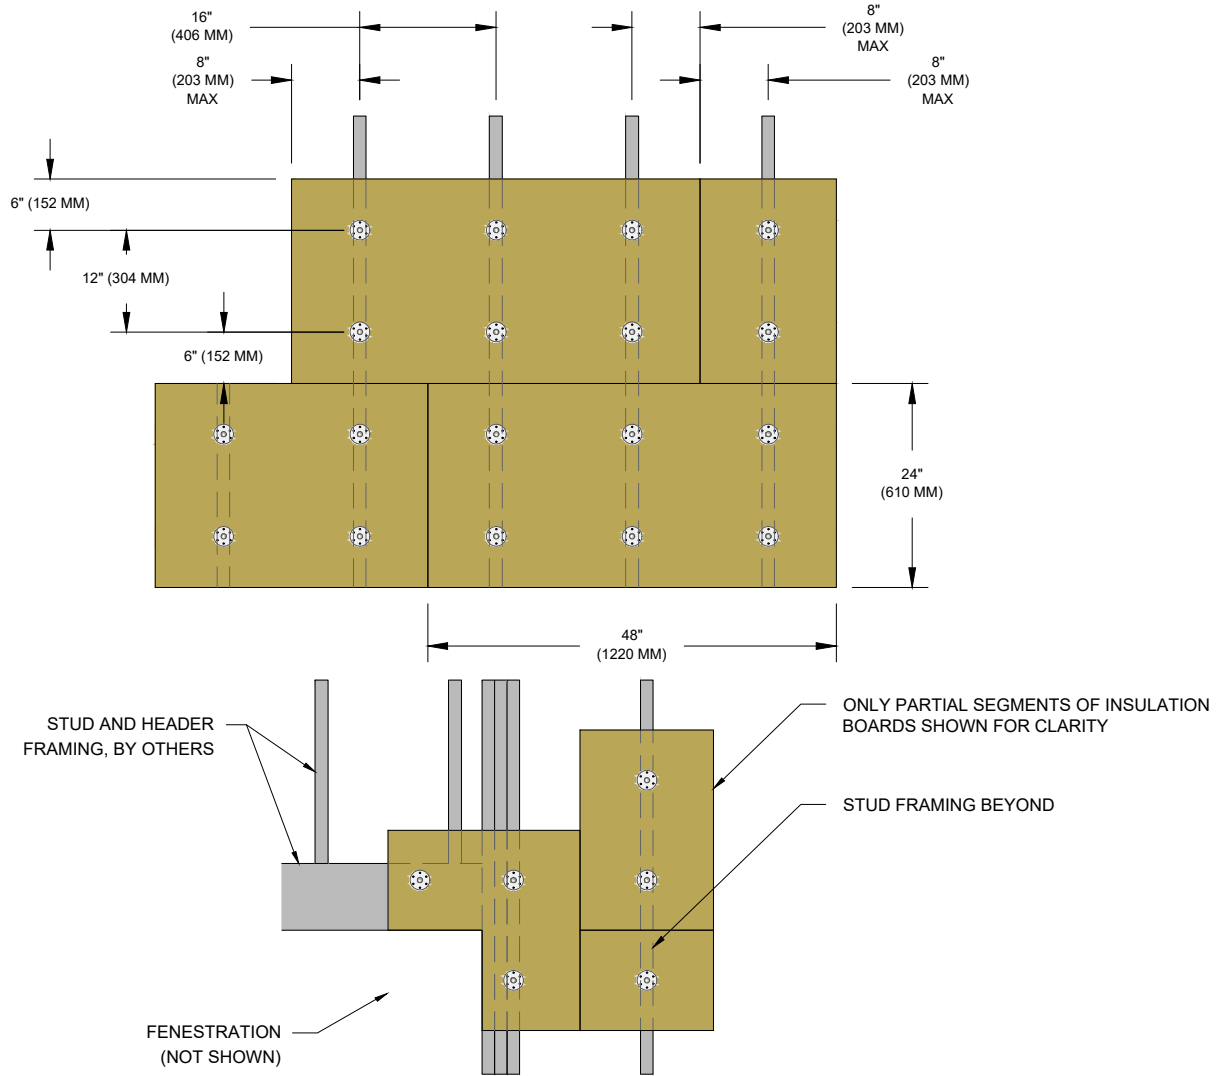


TABLE 1 - FASTENER REQUIREMENT PER MINERAL WOOL TYPE, THICKNESS, AND FASTENER PATTERN

MINERAL WOOL TYPE	MINIMUM MINERAL WOOL THICKNESS	SCREW FASTENER/ WASHER PLATE	FASTENERS/2' X 4' BOARD
DUAL DENSITY (DD)	2.5"	EJOT DABO SCREW TKR-4-4.8 / EJOT WASHER SBH-T 2G 60/25	6 OR 9
MONO DENSITY (MD)	1.5"		6 OR 9
DUAL DENSITY (DD)	2.5"	MIN #8 CORROSION RESISTANT STEEL SCREWS WITH WIND-DEVIL 2 WASHER PLATE	9
MONO DENSITY (MD)	1.5"		9

NOTE:

- DESIGN PROFESSIONAL OF RECORD SHALL BE SOLELY RESPONSIBLE FOR INTERPRETATION AND STRUCTURAL DESIGN BASED ON SPECIFIC PROJECT REQUIREMENTS.
- MINERAL WOOL INSULATION INSTALLATION INCLUDES BOTH PRIMARY MECHANICAL ATTACHMENT AND SUPPLEMENTAL VERTICAL NOTCH TROWEL ADHESIVE.
- AT 2.5" THICKNESS, DO NOT USE COUNTERSUNK FASTENERS.

- FASTENER SHALL BE EJOT STR U 2G PRE-ASSEMBLED SCREW FASTENER AND WASHER WITH TUBE EXPANSION ANCHOR COMBINATION OR WIND-LOCK MT SERIES PRE-ASSEMBLED SCREW FASTENER AND WASHER PLATE WHEN USED OVER CONCRETE OR CMU MASONRY SUBSTRATES. FOR COUNTERSUNK APPLICATIONS, UTILIZE EJOTHERM STR MINERAL WOOL PLUG. COORDINATE AND INSTALL WITH PROPER PRE-DRILLING, AS REQUIRED.

- DISTANCE BETWEEN CENTER OF WASHER AND EDGE OF MINERAL WOOL SLAB SHALL BE NO LESS THAN 4". COORDINATE LAYOUT OF MINERAL WOOL WITH FRAMING ELEMENTS. PROVIDE ADDITIONAL STUDS AND/OR LIGHT GAUGE STRAPPING AS REQUIRED.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Mechanical Fastening - 6 Pattern Option and Load Table

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/25/2024

File Name:


OMW 6



Construction Products Group

www.tremcocpg.com

MECHANICAL FASTENING - 9 FASTENER PATTERN

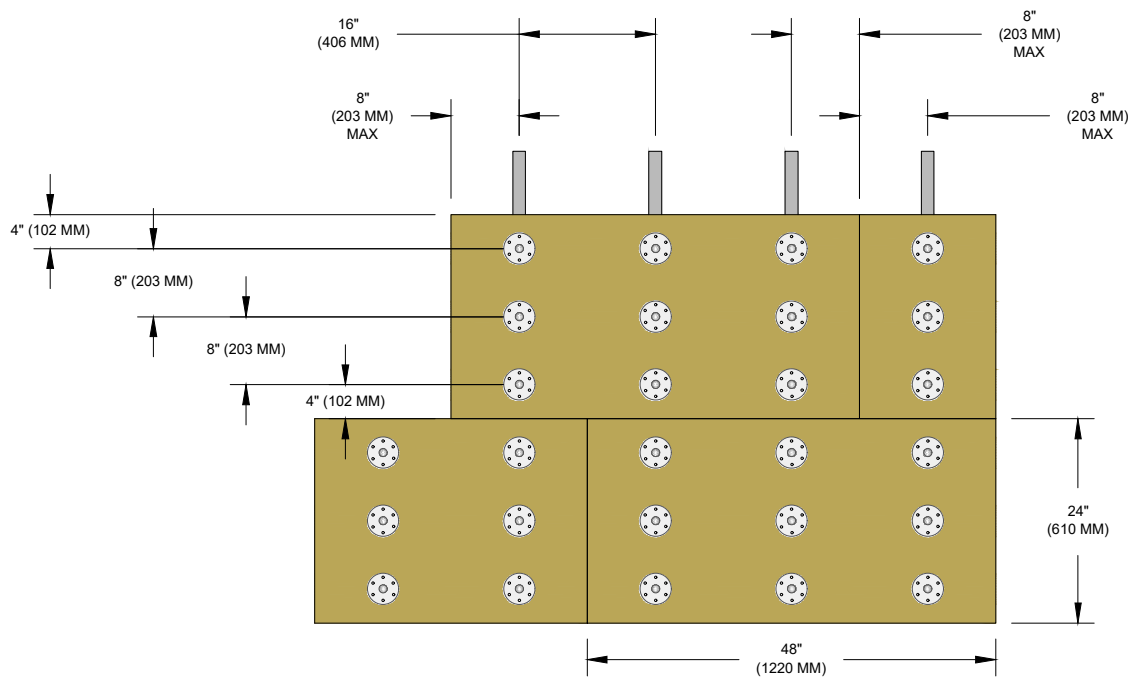

NOTE:

1. REFER TO OMW 6 AND OMW 7 FOR MECHANICAL FASTENER, WASHER PLATE, AND INSTALLATION OPTIONS.
2. STRUCTURAL ENGINEER SHALL DETERMINE INCREASED WIND LOAD CAPACITY USING ENGINEERING JUDGEMENT WHEN ADDITIONAL FASTENERS ARE USED AS ILLUSTRATED.
3. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Mechanical Fastening - 9 Pattern Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/25/2024

File Name:


OMW 6a




Construction Products Group

www.tremcocpg.com


SURFACE FLUSH WASHER MECHANICAL FASTENER

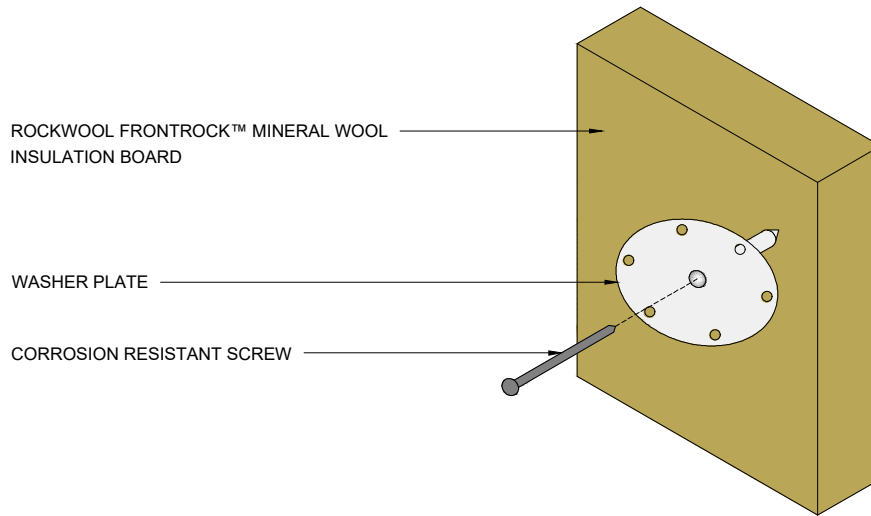

COUNTERSUNK WASHER MECHANICAL FASTENER WITH THERMAL PLUG

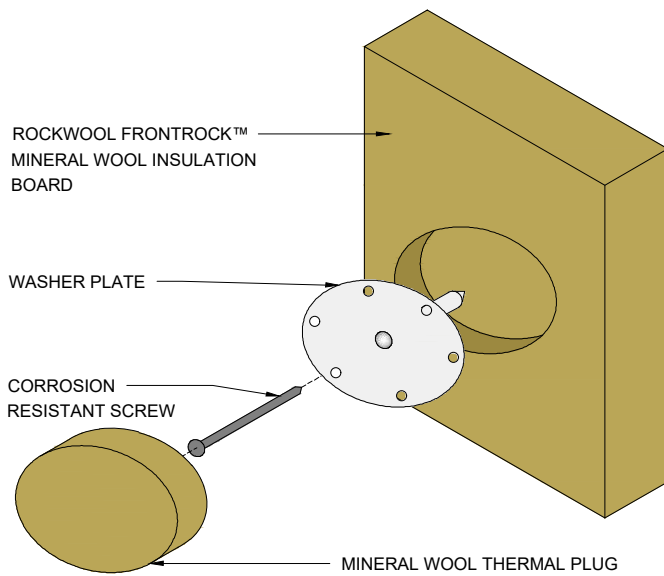

COUNTERSUNK WASHER WITH SPREADER WASHER MECHANICAL FASTENER WITH THERMAL PLUG

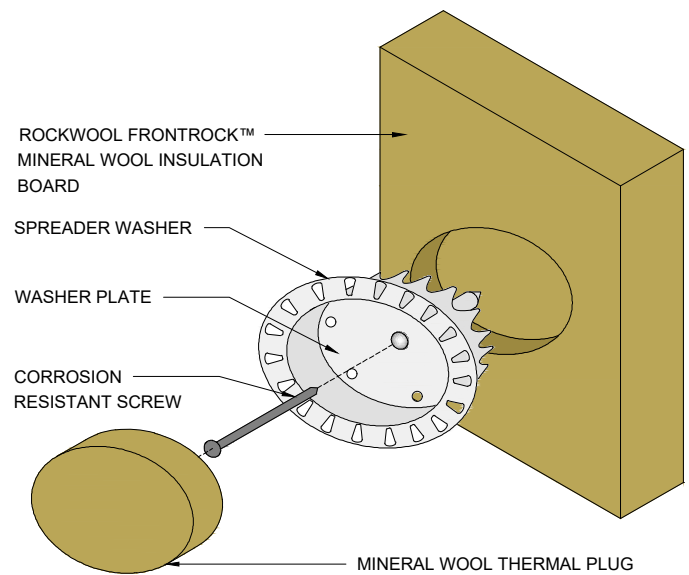

NOTE:

1. REFER TO OWM 6 AND OMW 6a FOR MECHANICAL FASTENER LAYOUTS AND ASSOCIATED WIND LOAD VALUES.
2. REFER TO DS982 FOR FASTENER SPECIFICATION.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Fastener Options

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024

File Name:


OMW 7




Construction Products Group

www.tremcocpg.com

MINERAL WOOL DRAINAGE STARTER BOARD

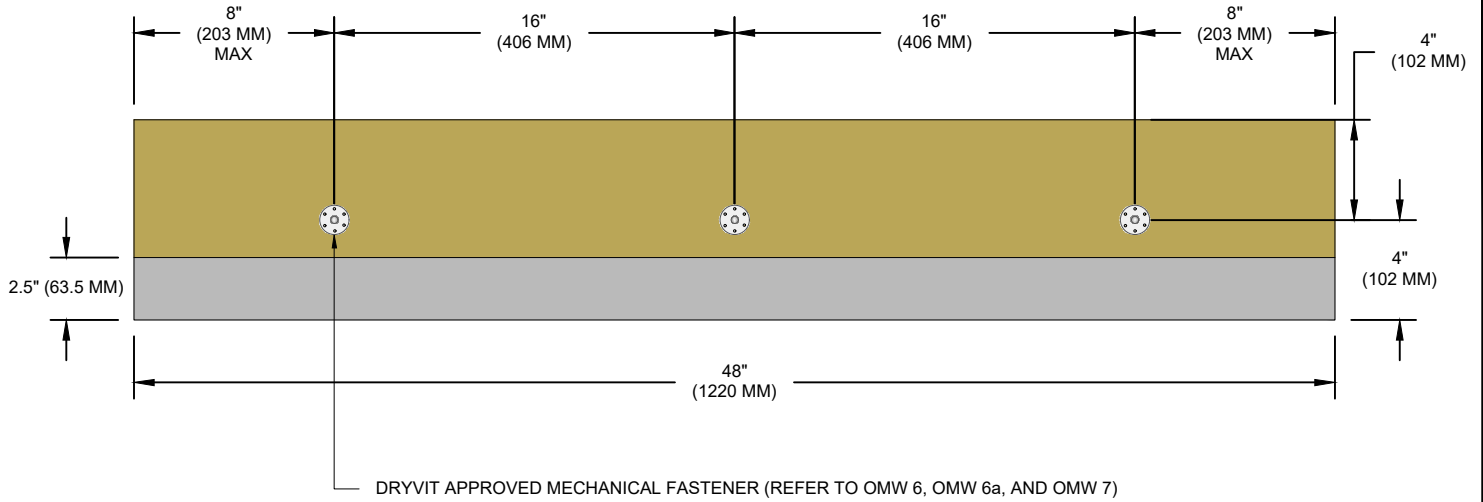

MINERAL WOOL DRAINAGE STARTER BOARD PROFILE

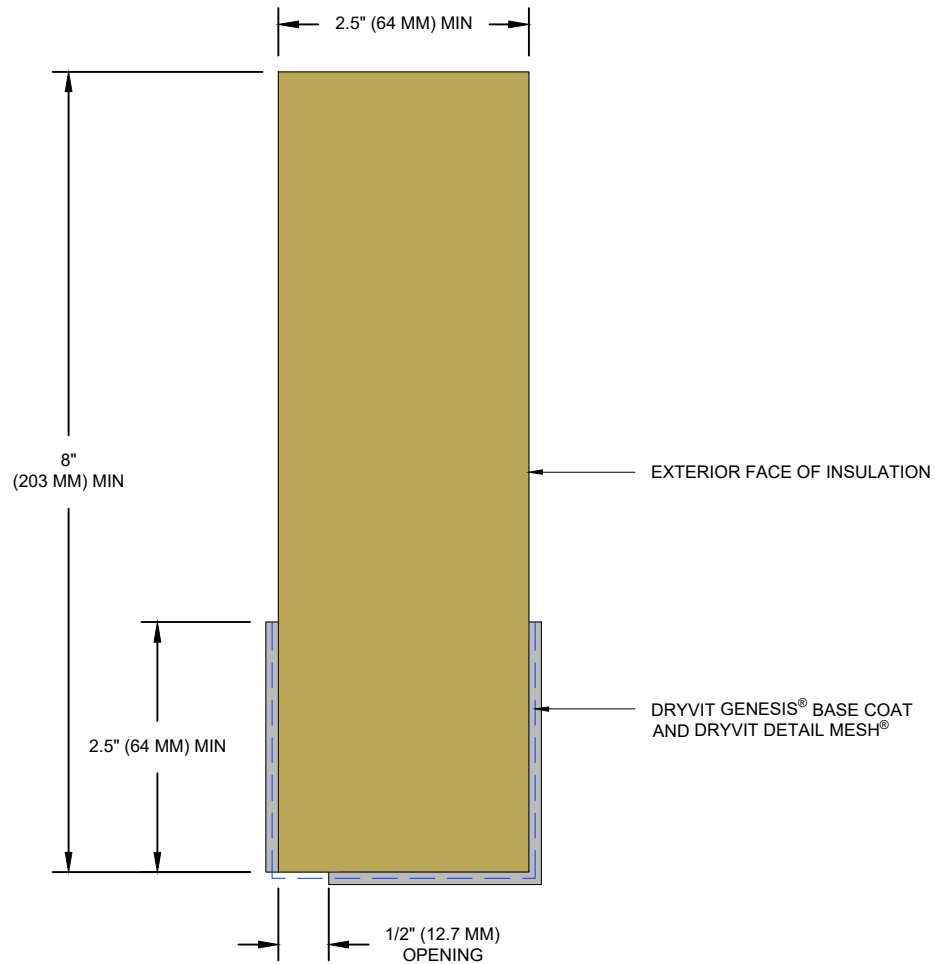

NOTE:

1. PROVIDE ONE FASTENER PER STUD TO SECURE STARTER BOARD COMPONENTS.
2. SEALANT JOINTS SHALL BE DESIGNED AND INSTALLED AS TO NOT BLOCK OPENING AT BACK OF SYSTEM (NOT SHOWN).

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.



Dryvit Technical Support: 800-556-7752

Detail: Field-Fabricated Starter Board

Drawn by: HDE

Checked by: CW

Scale: NTS


Date: 2/28/2024

File Name:

OMW 8



Construction Products Group

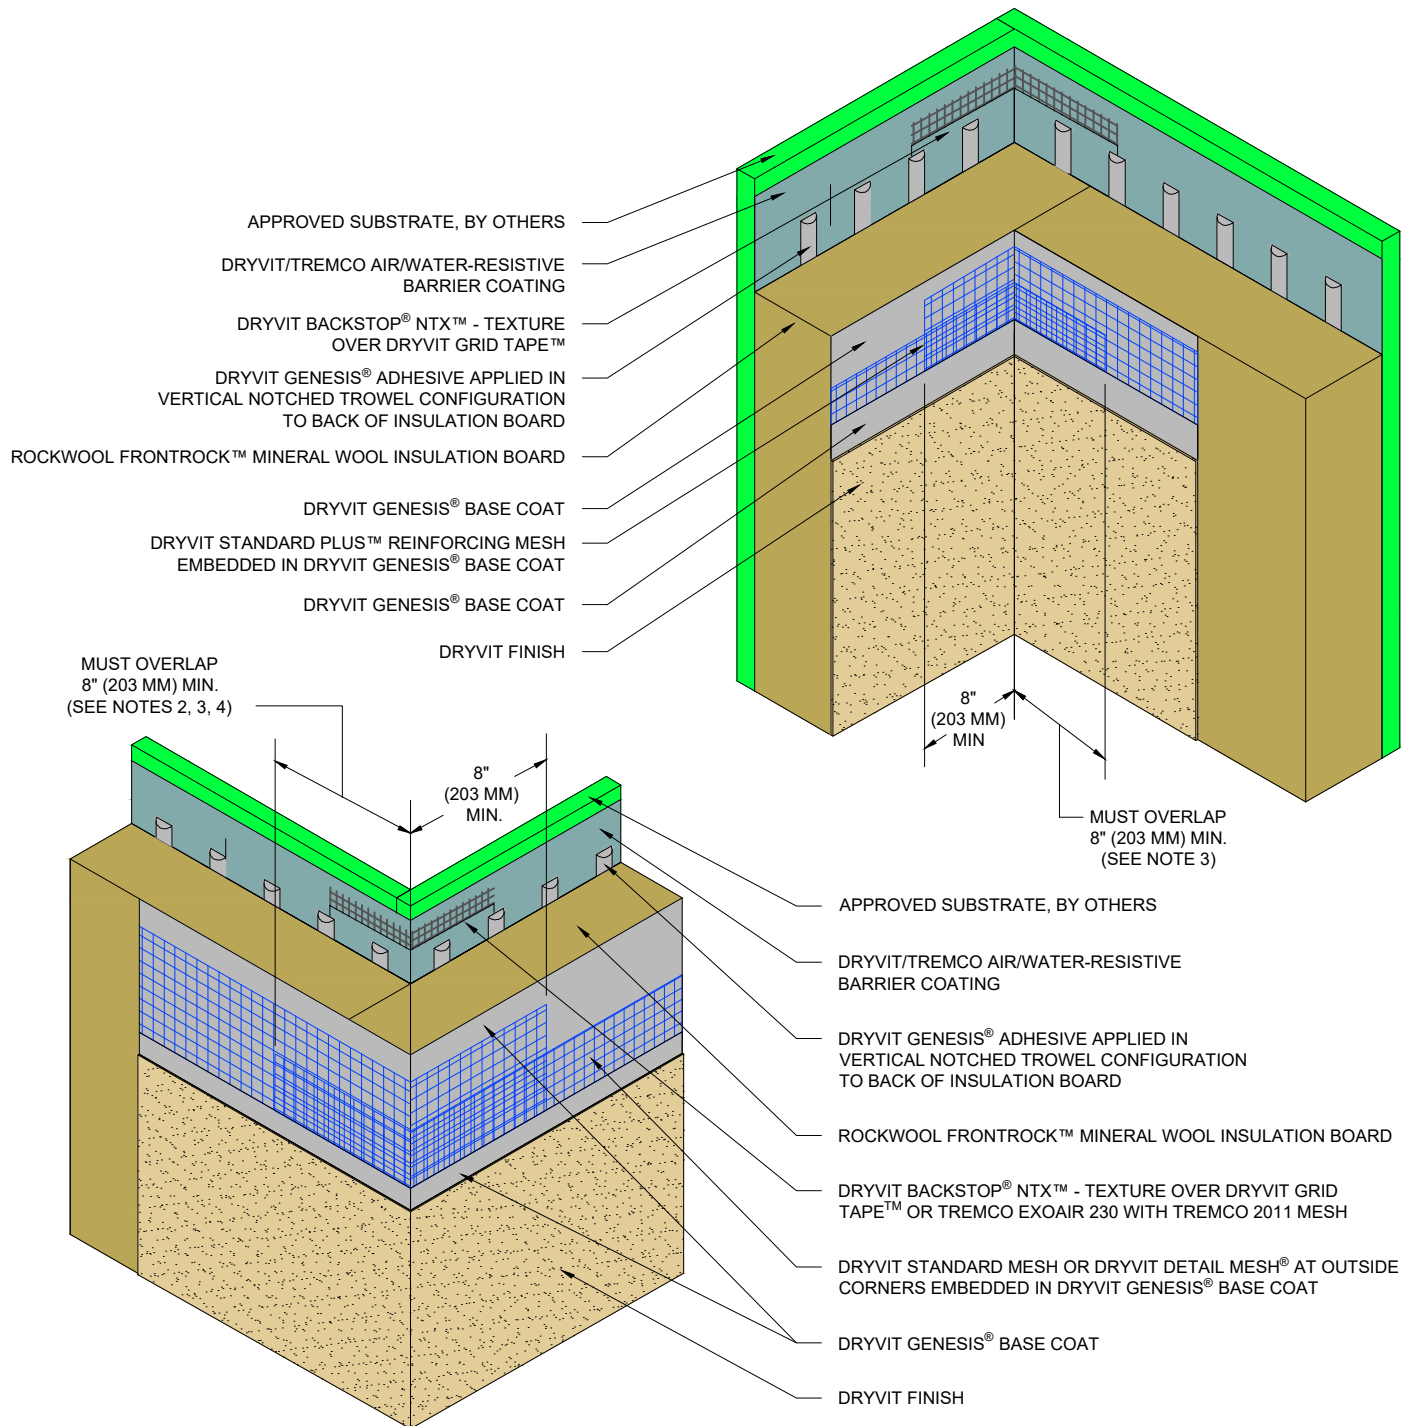

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DOUBLE WRAP OUTSIDE CORNERS WITH STANDARD PLUS™ REINFORCING MESH OR USE CORNER MESH™.
3. DO NOT LAP REINFORCING MESH WITHIN 8" (203 MM) OF A CORNER.
4. INSULATION BOARD EDGES SHALL BE OFFSET AT INSIDE AND OUTSIDE CORNERS.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Inside/Outside Corners

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 9



Construction Products Group

www.tremcocpg.com

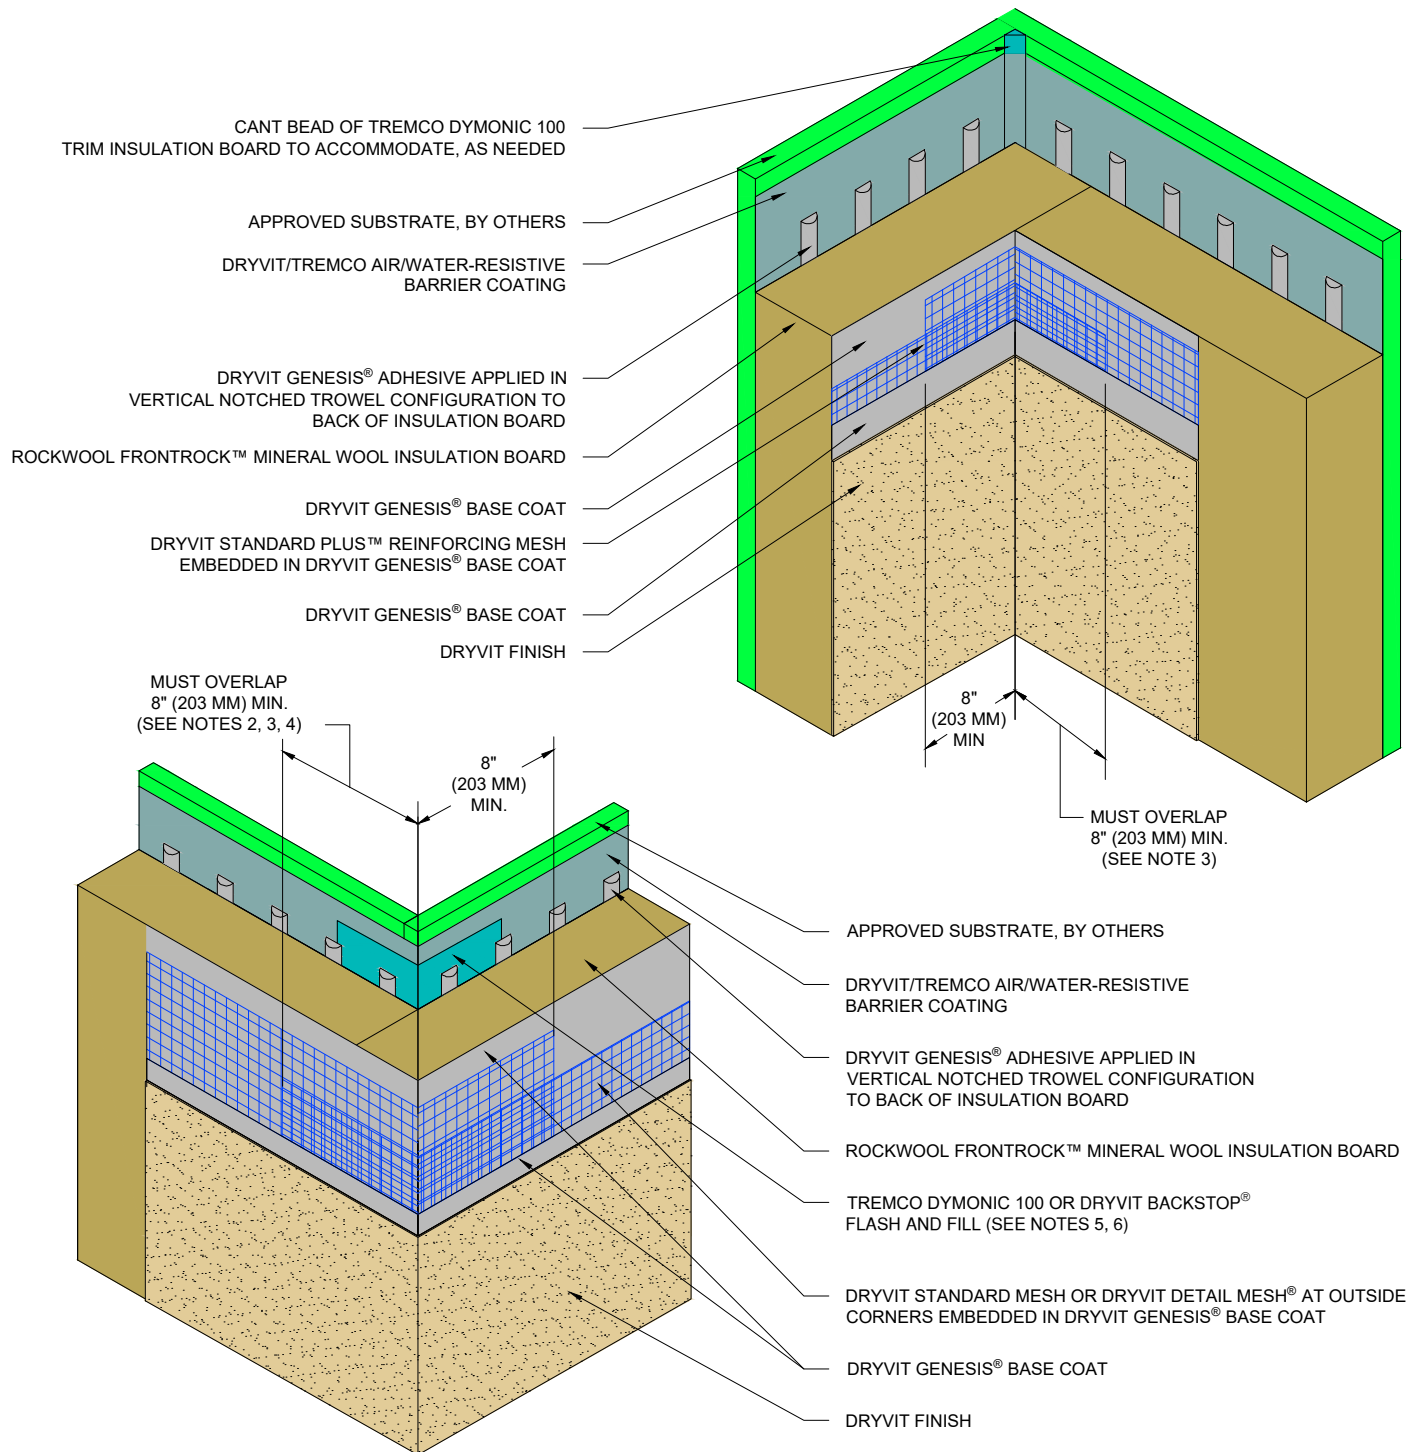

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DOUBLE WRAP OUTSIDE CORNERS WITH STANDARD PLUS™ REINFORCING MESH OR USE CORNER MESH™.
3. DO NOT LAP REINFORCING MESH WITHIN 8" (203 MM) OF A CORNER.
4. INSULATION BOARD EDGES SHALL BE OFFSET AT INSIDE AND OUTSIDE CORNERS.
5. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
6. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
7. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
8. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Inside/Outside Corners - Dryvit Backstop® Flash And Fill or Tremco Dymonic 100 Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 9a



Construction Products Group

www.tremcocpg.com

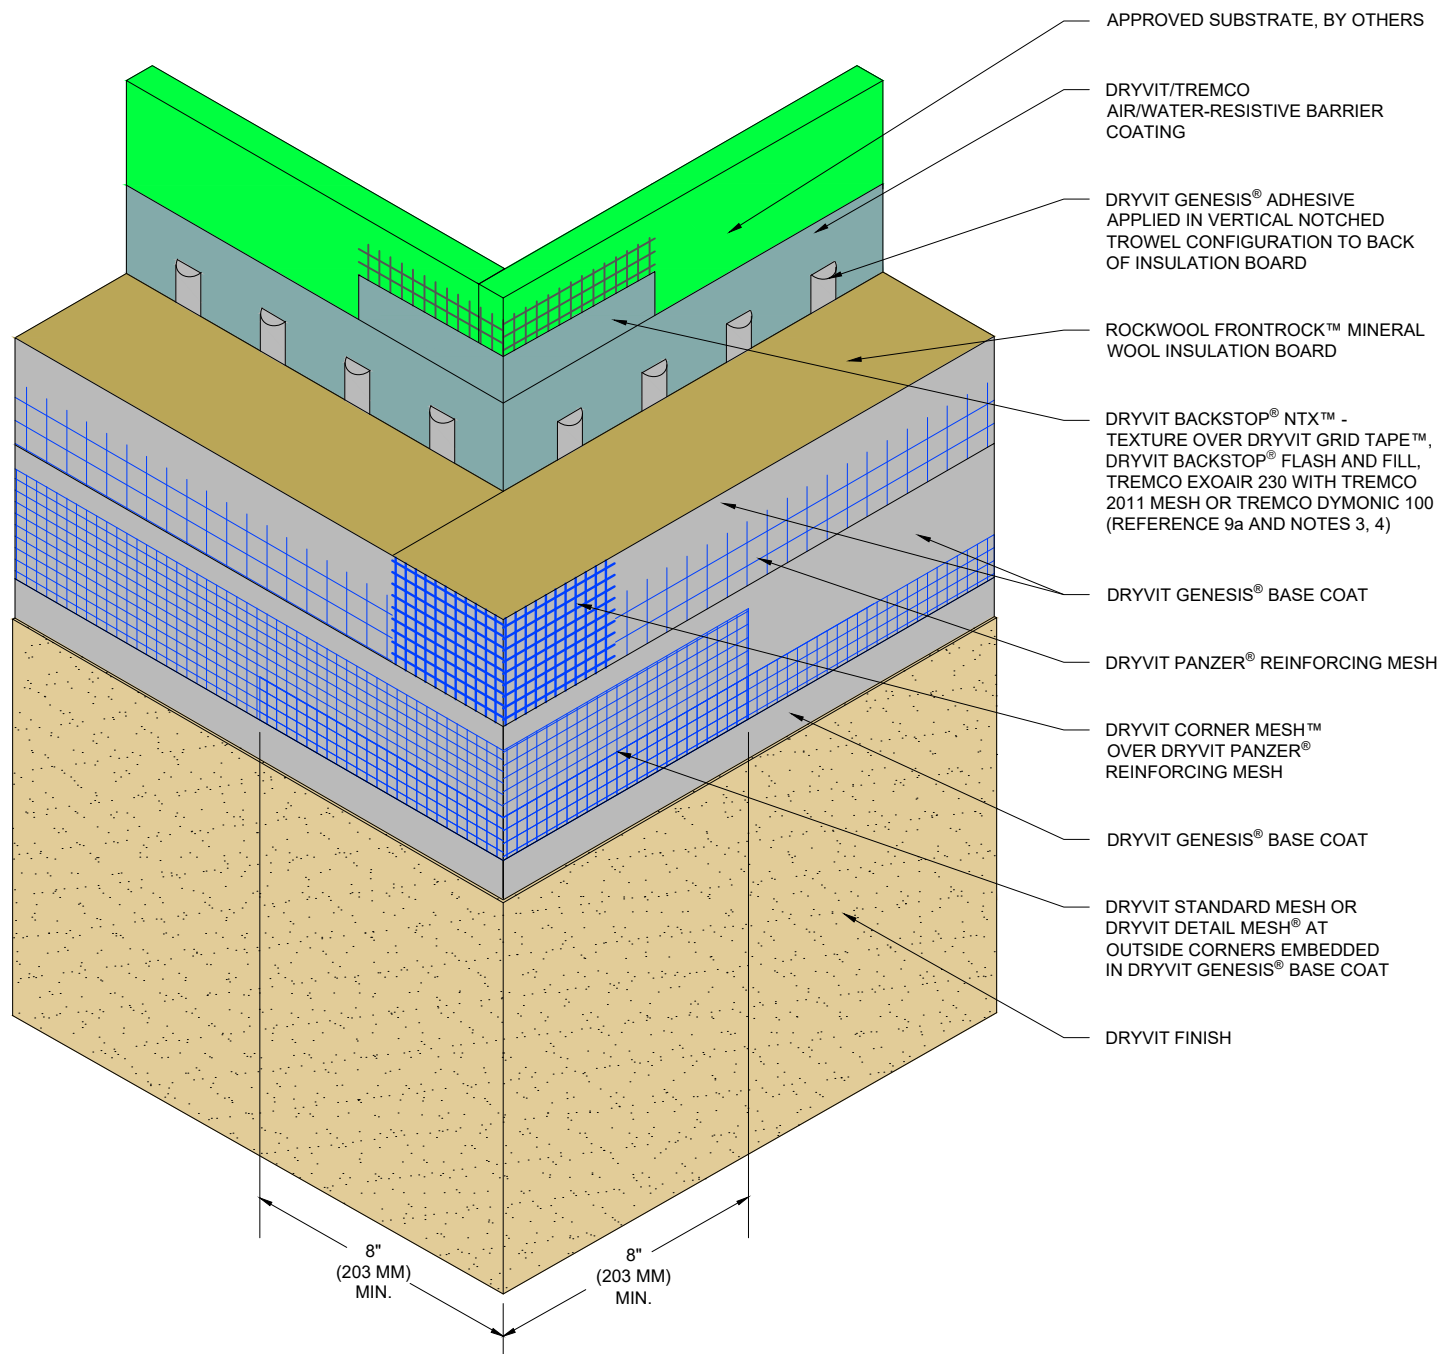

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. INSULATION BOARD EDGES SHALL BE STAGGERED.
3. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
4. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Outside Corner - High Impact

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 10a



Construction Products Group

www.tremcocpg.com

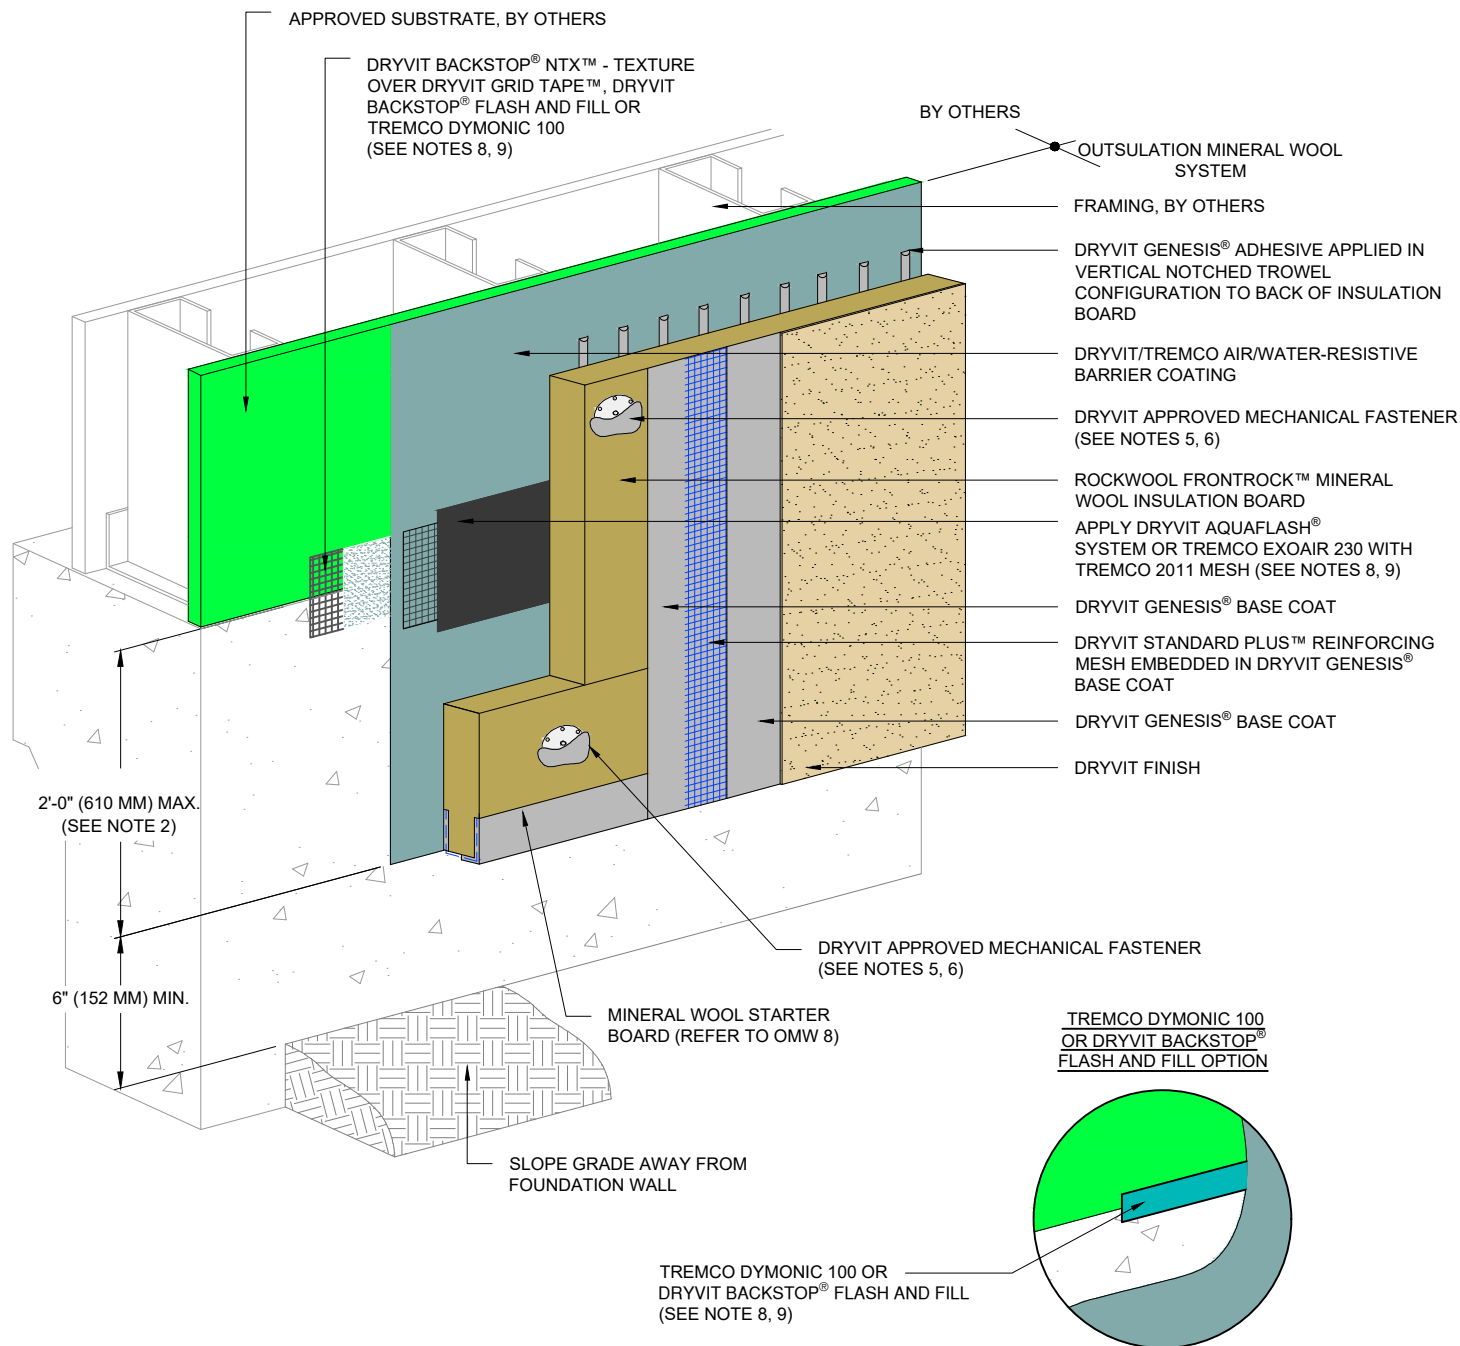

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 2 FT (610 MM) DIMENSION IS EXCEEDED.
3. INSTALL INSULATION BOARD IN RUNNING BOND PATTERN.
4. TIGHTLY BUTT ALL INSULATION BOARDS.
5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
6. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
7. FOR ADDITIONAL BACKSTOP® NTX™ DETAILS, REFER TO DRYVIT PUBLICATION DS840.
8. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
9. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
10. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination At Grade

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 11



Construction Products Group

www.tremcocpg.com

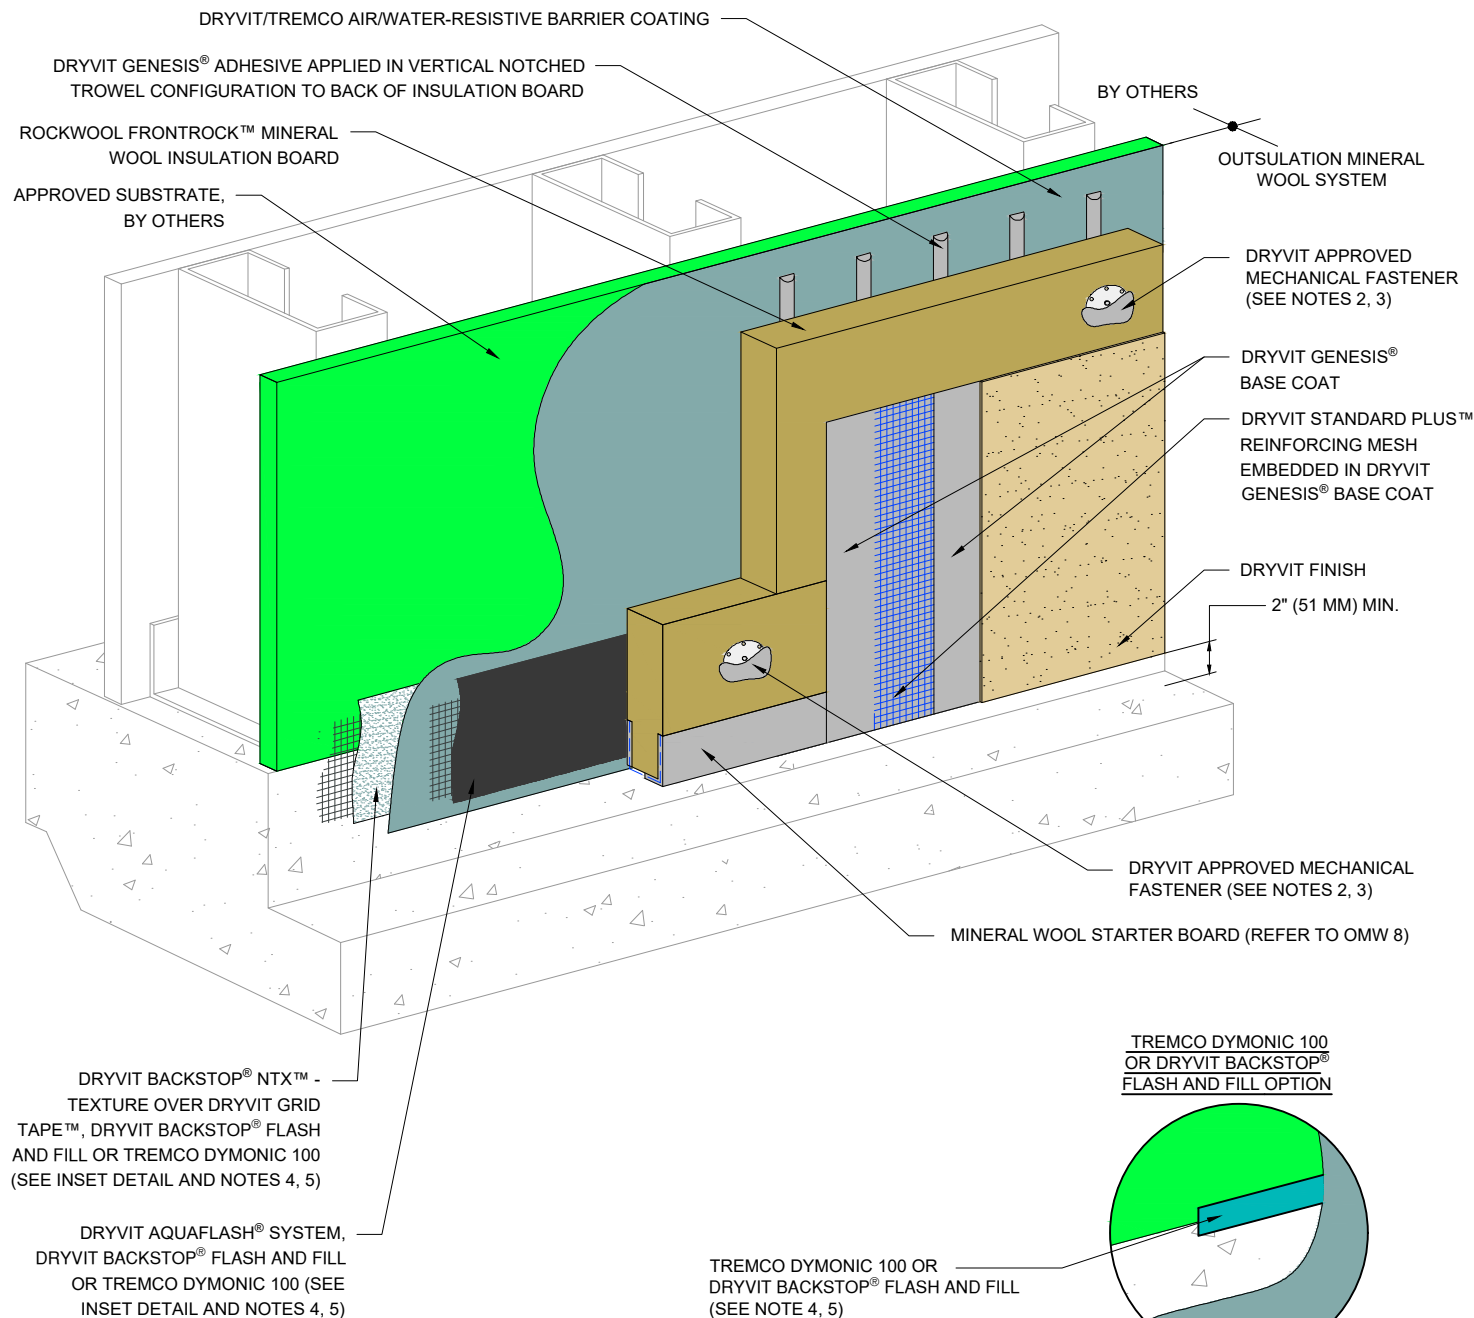


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
3. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
4. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
5. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System

 Dryvit Technical Support: 800-556-7752	Detail: Termination At Concrete Curb				File Name: OMW 12	 Construction Products Group
	Drawn by: HDE	Checked by: CW	Scale: NTS	Date: 2/28/2024		
	www.tremcocpg.com					

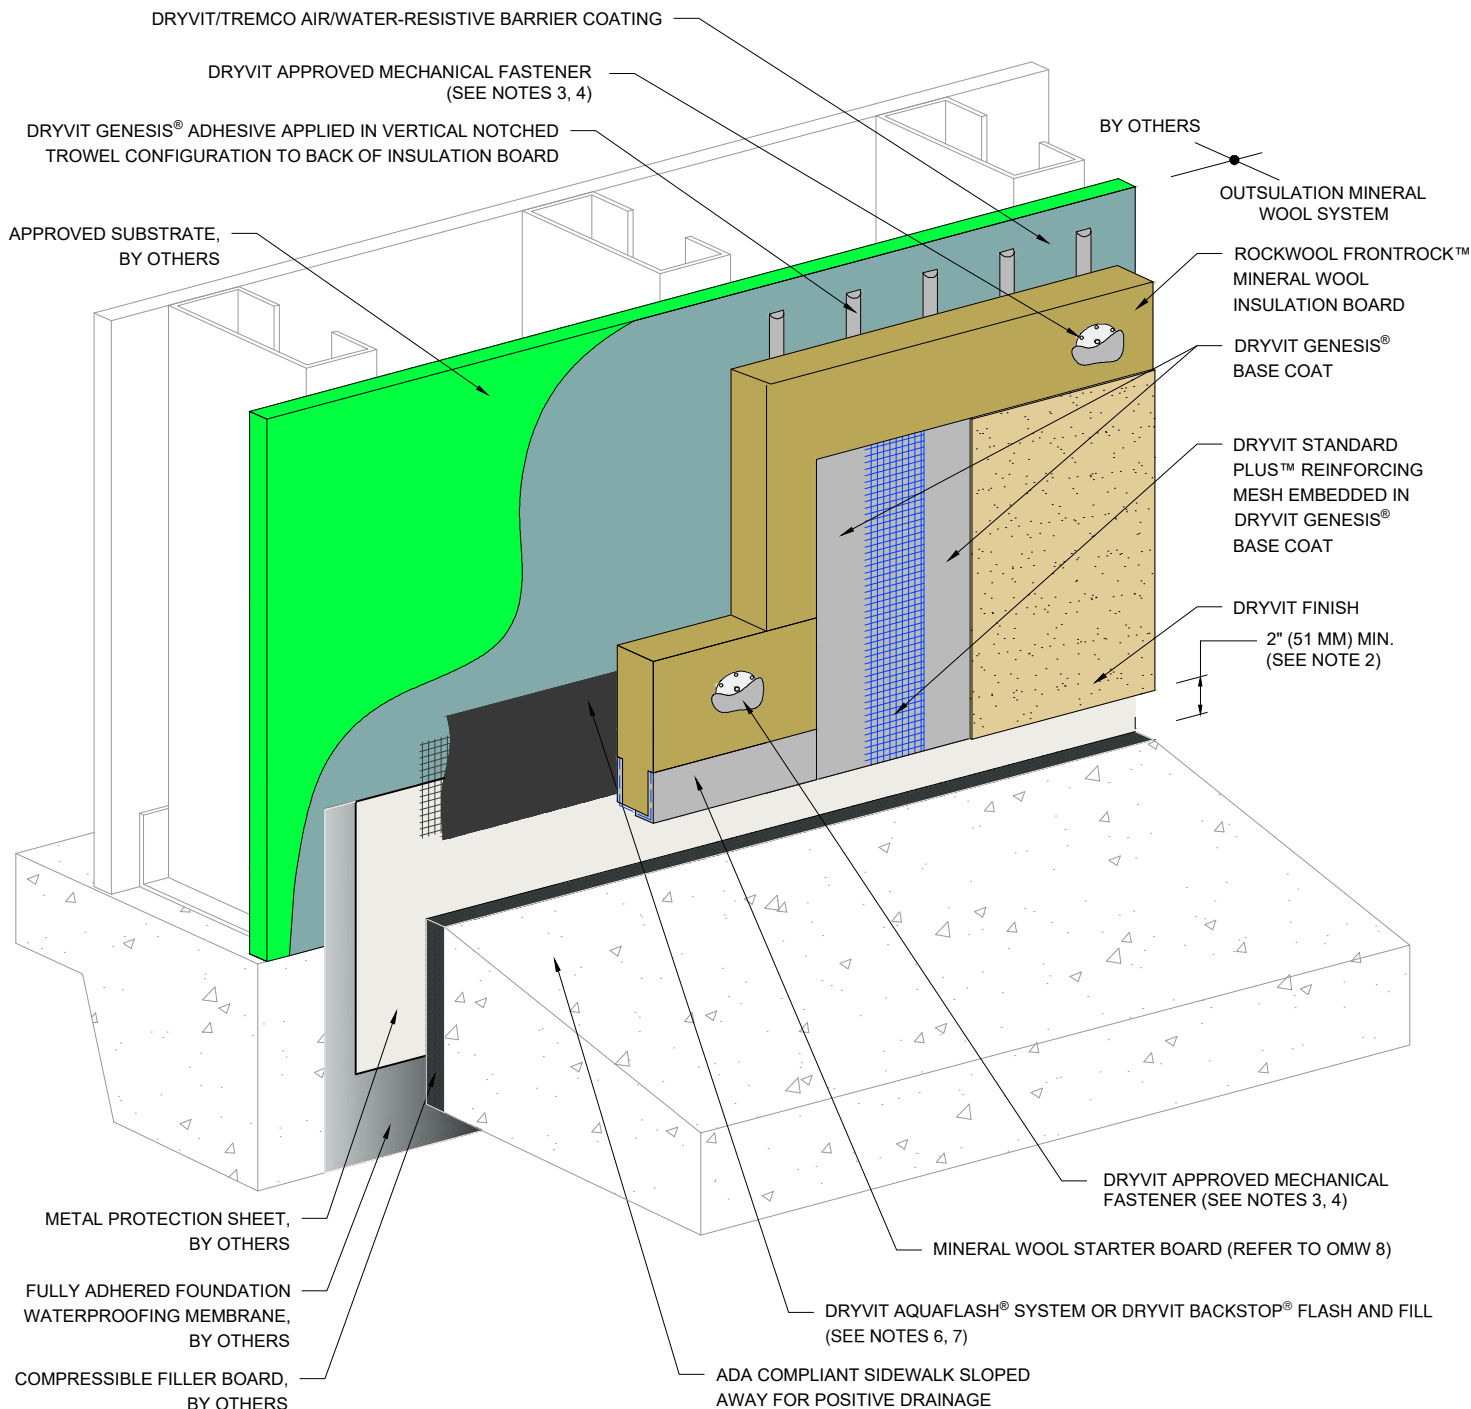

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. TO PREVENT DEBRIS ACCUMULATION IT IS RECOMMENDED TO TERMINATE SYSTEM 2" (51 MM) ABOVE SIDEWALK.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination At ADA Compliant Sidewalk

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 13



Construction Products Group

www.tremcocpg.com

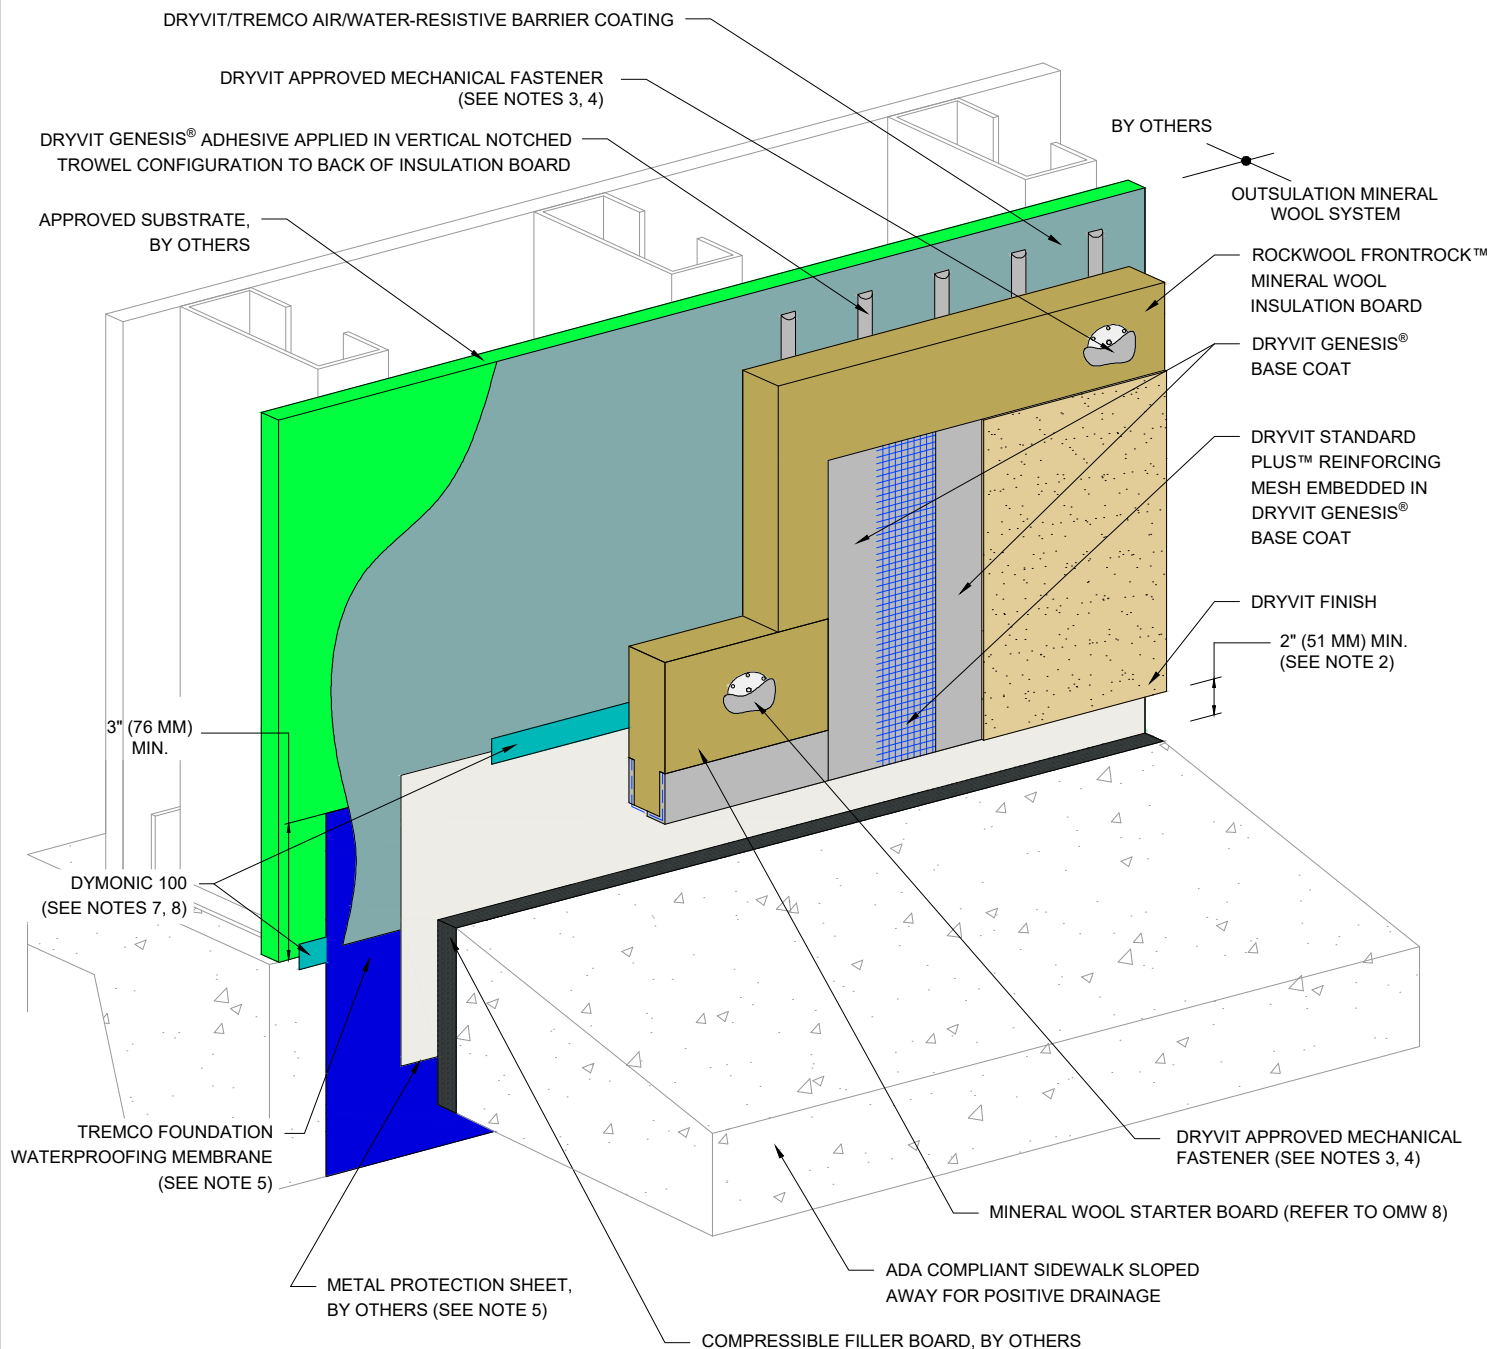

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. TO PREVENT DEBRIS ACCUMULATION IT IS RECOMMENDED TO TERMINATE SYSTEM 2" (51 MM) ABOVE SIDEWALK.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTTTLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. TRANSITION DEPENDENT ON FOUNDATION WATERPROOFING, CONTACT TREMCO FOR MORE INFORMATION.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at ADA Compliant Sidewalk -
Tremco Dymonic 100/Tremco Waterproofing Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 13a



Construction Products Group

www.tremcocpg.com

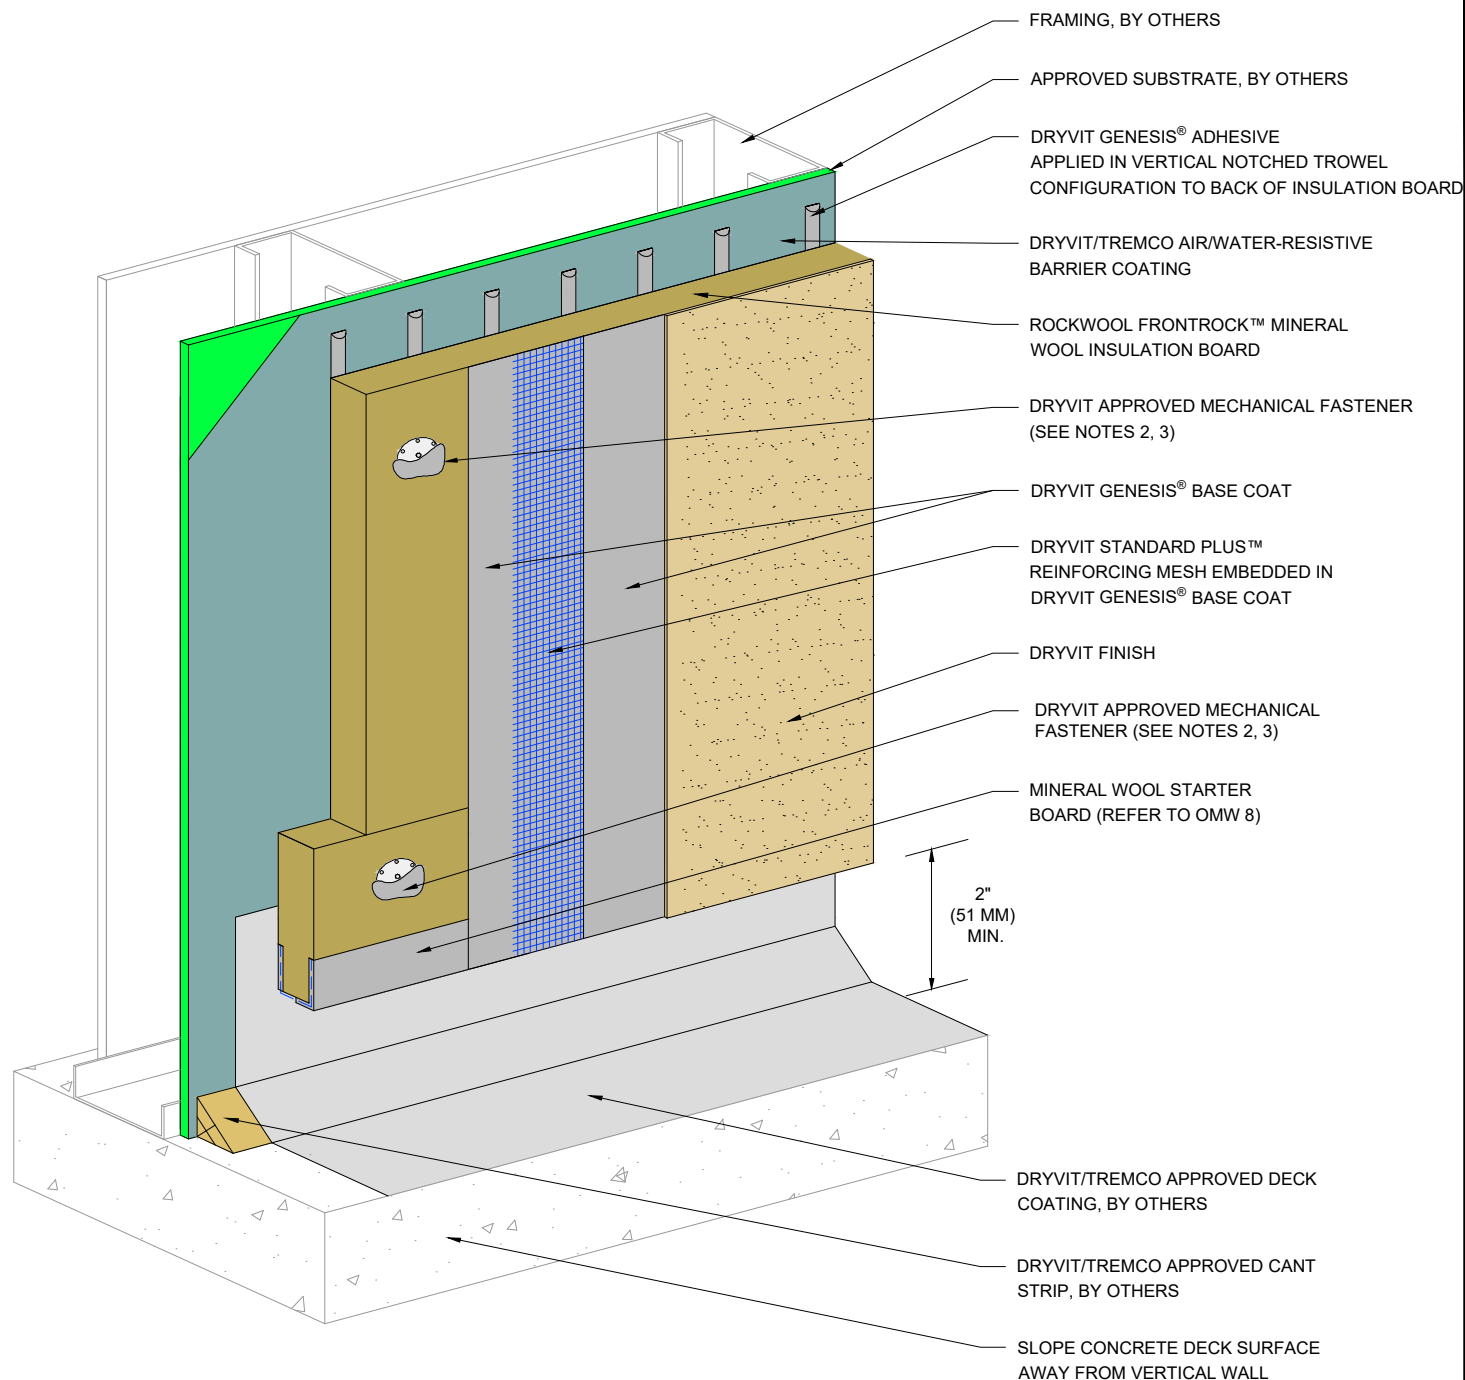

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
3. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
4. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at Waterproof Deck

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 14



Construction Products Group

www.tremcocpg.com

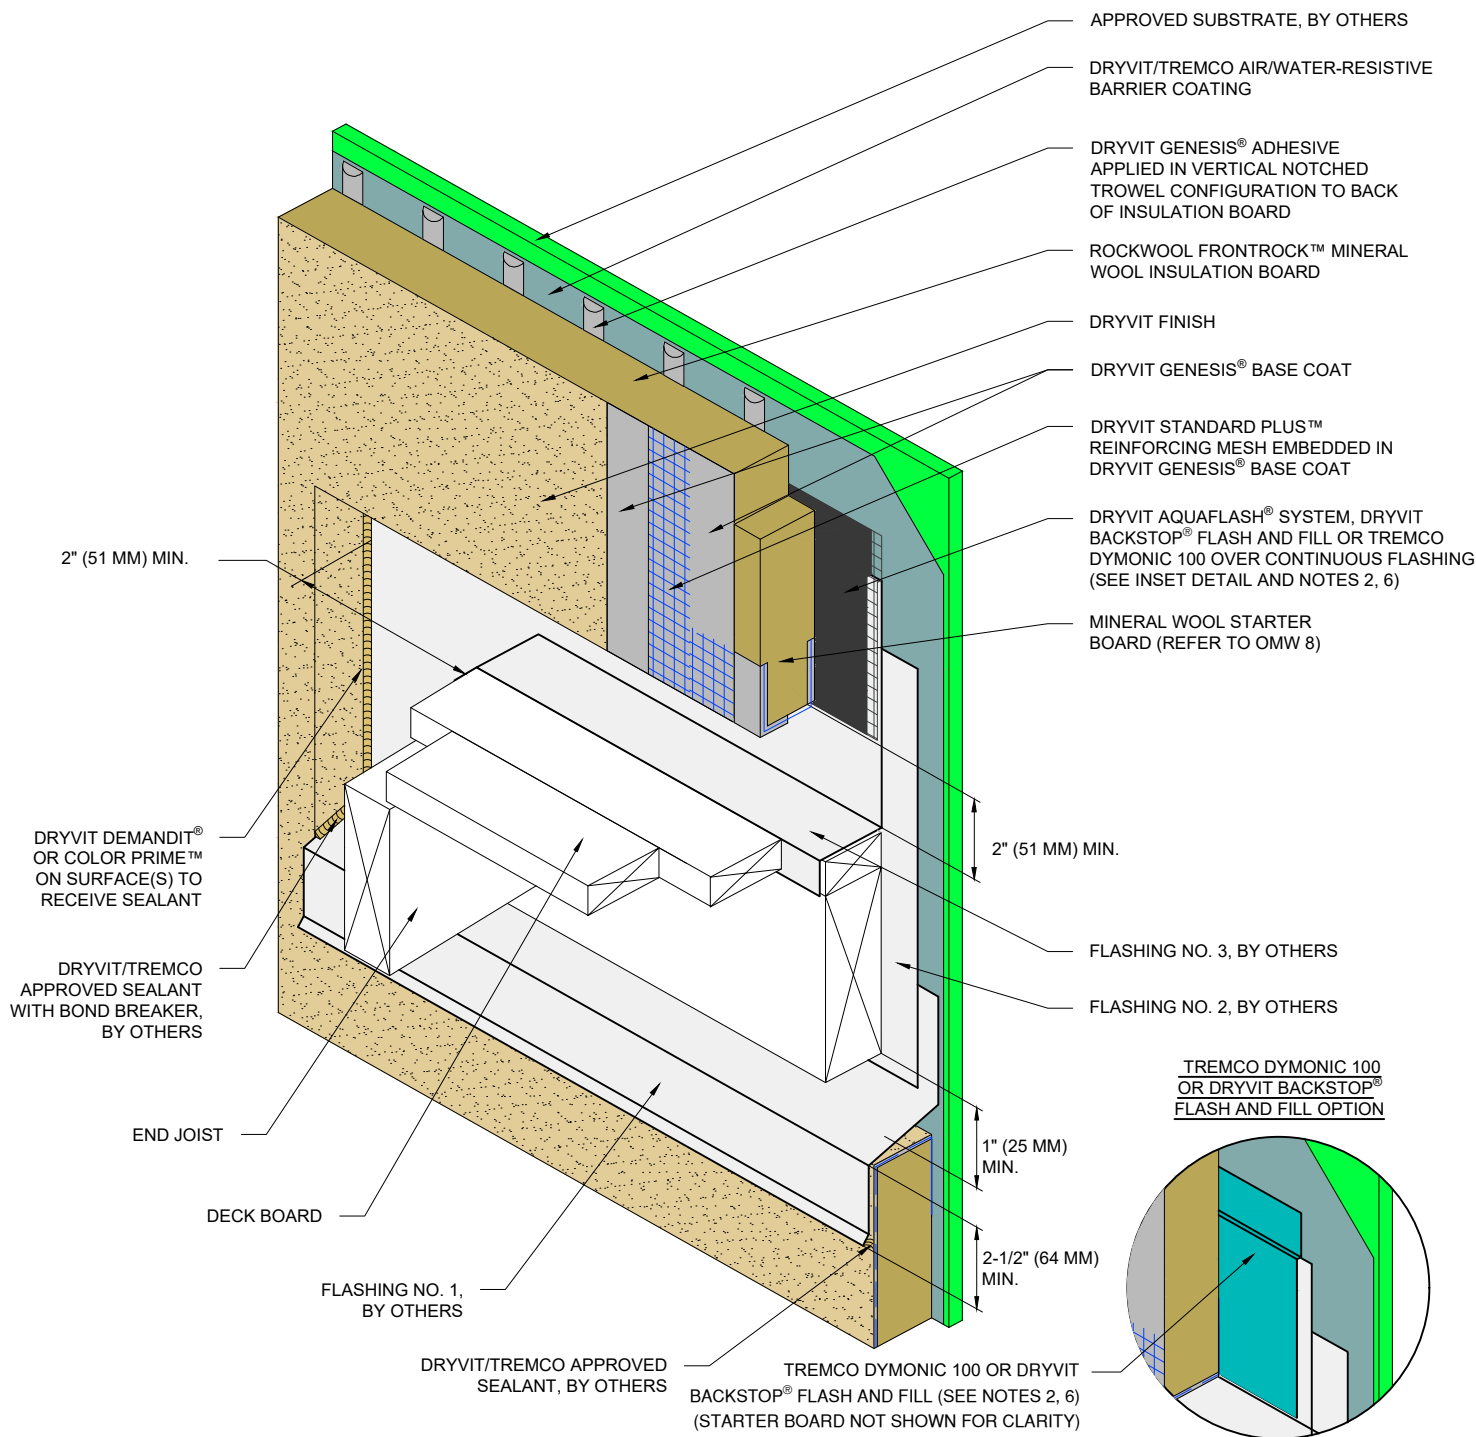

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. DETAIL DOES NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS REQUIRE JOB SPECIFIC FLASHING DETAILS.
4. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
7. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at Wood Framed Deck

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024



File Name:

OMW 15

www.tremcocpg.com



Construction Products Group

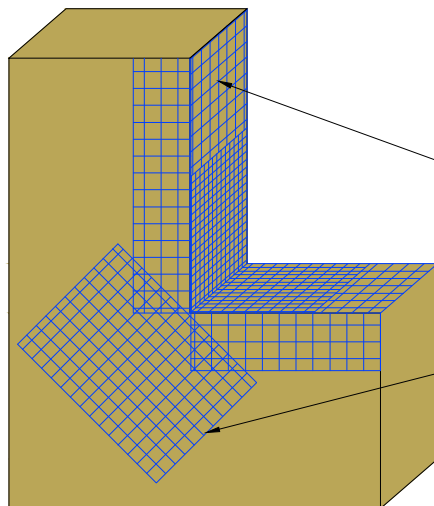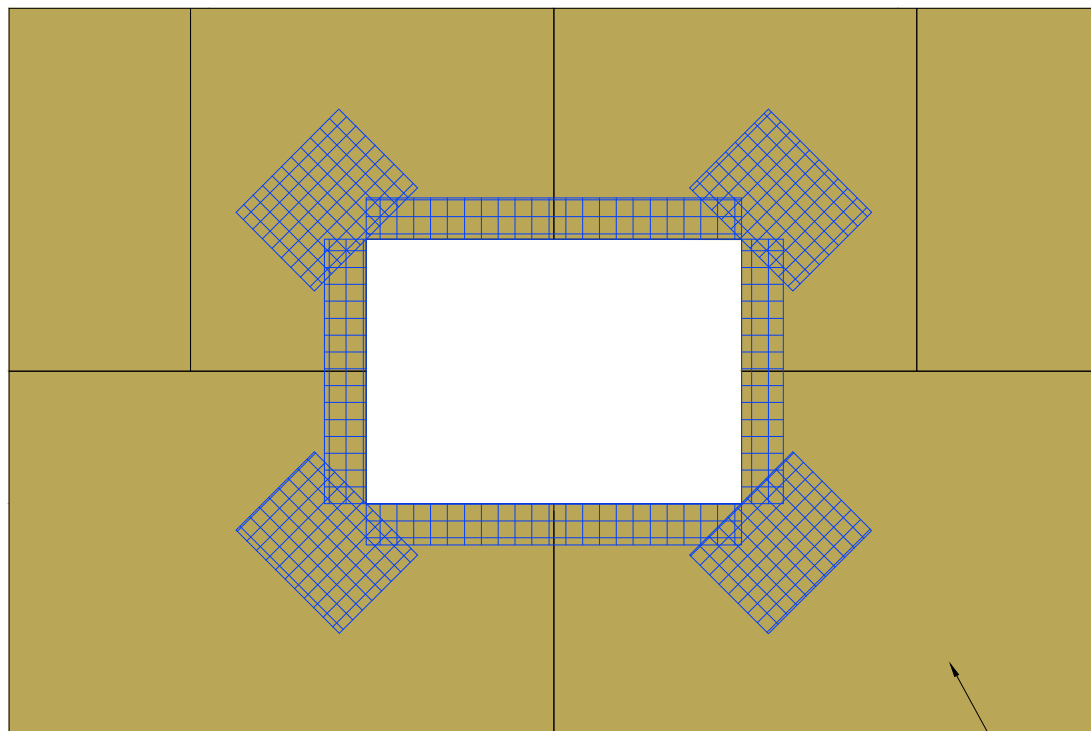

ROCKWOOL FRONTROCK™
MINERAL WOOL INSULATION
BOARD
(SEE NOTE 2)

DRYVIT DETAIL MESH® WRAPPED
TO BACKSIDE OF INSULATION
BOARD MIN. 2-1/2" (64 MM)

DRYVIT DETAIL REINFORCING MESH
9 1/2" (241 MM) X 12" (305 MM) (TYP.)
(SEE NOTE 3)

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LOCATE INSULATION BOARDS SUCH THAT BOARD EDGES DO NOT ALIGN WITH CORNERS OF PENETRATION.
3. APPLY A PIECE OF 9 1/2" (241 MM) X 12" (305 MM) DETAIL REINFORCING MESH DIAGONALLY AT EACH CORNER.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Insulation Preparation At Wall Penetrations

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 16



Construction Products Group

www.tremcocpg.com

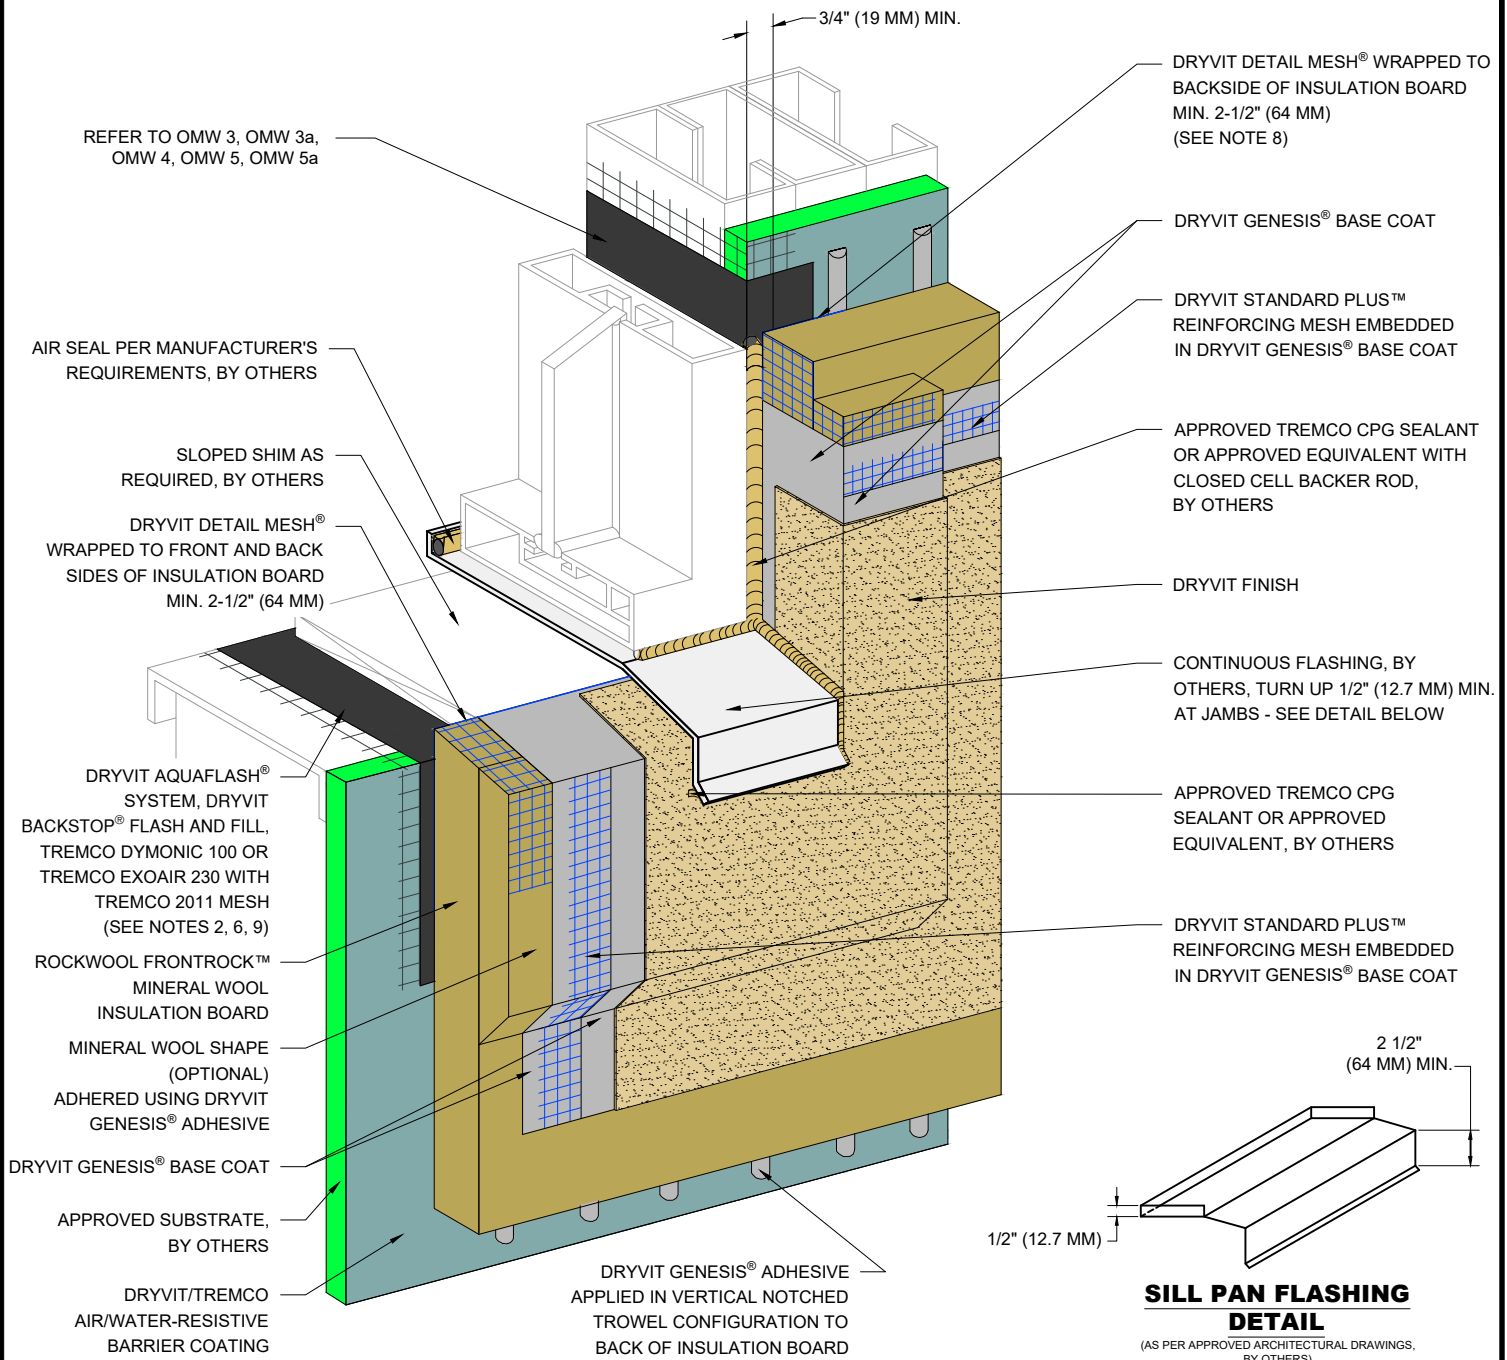

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. DRYVIT BACKSTOP® NTX™ - TEXTURE OVER GRID TAPE™ IS AN ALTERNATIVE OPTION AT JAMB AND HEAD CONDITION PER DETAIL OMW 4.
7. SILL PAN FLASHING MUST HAVE WATER TIGHT SEAMS.
8. EDGE WRAPPING METHOD IS ACCEPTABLE AT SILL AND JAMB IN LIEU OF BACK WRAPPING. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT INSULATION BOARD EDGE AND MUST EXTEND ONTO SUBSTRATE 2-1/2" (64 MM) MIN.
9. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Storefront Window Sill - Jamb

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 17



Construction Products Group

www.tremcocpg.com

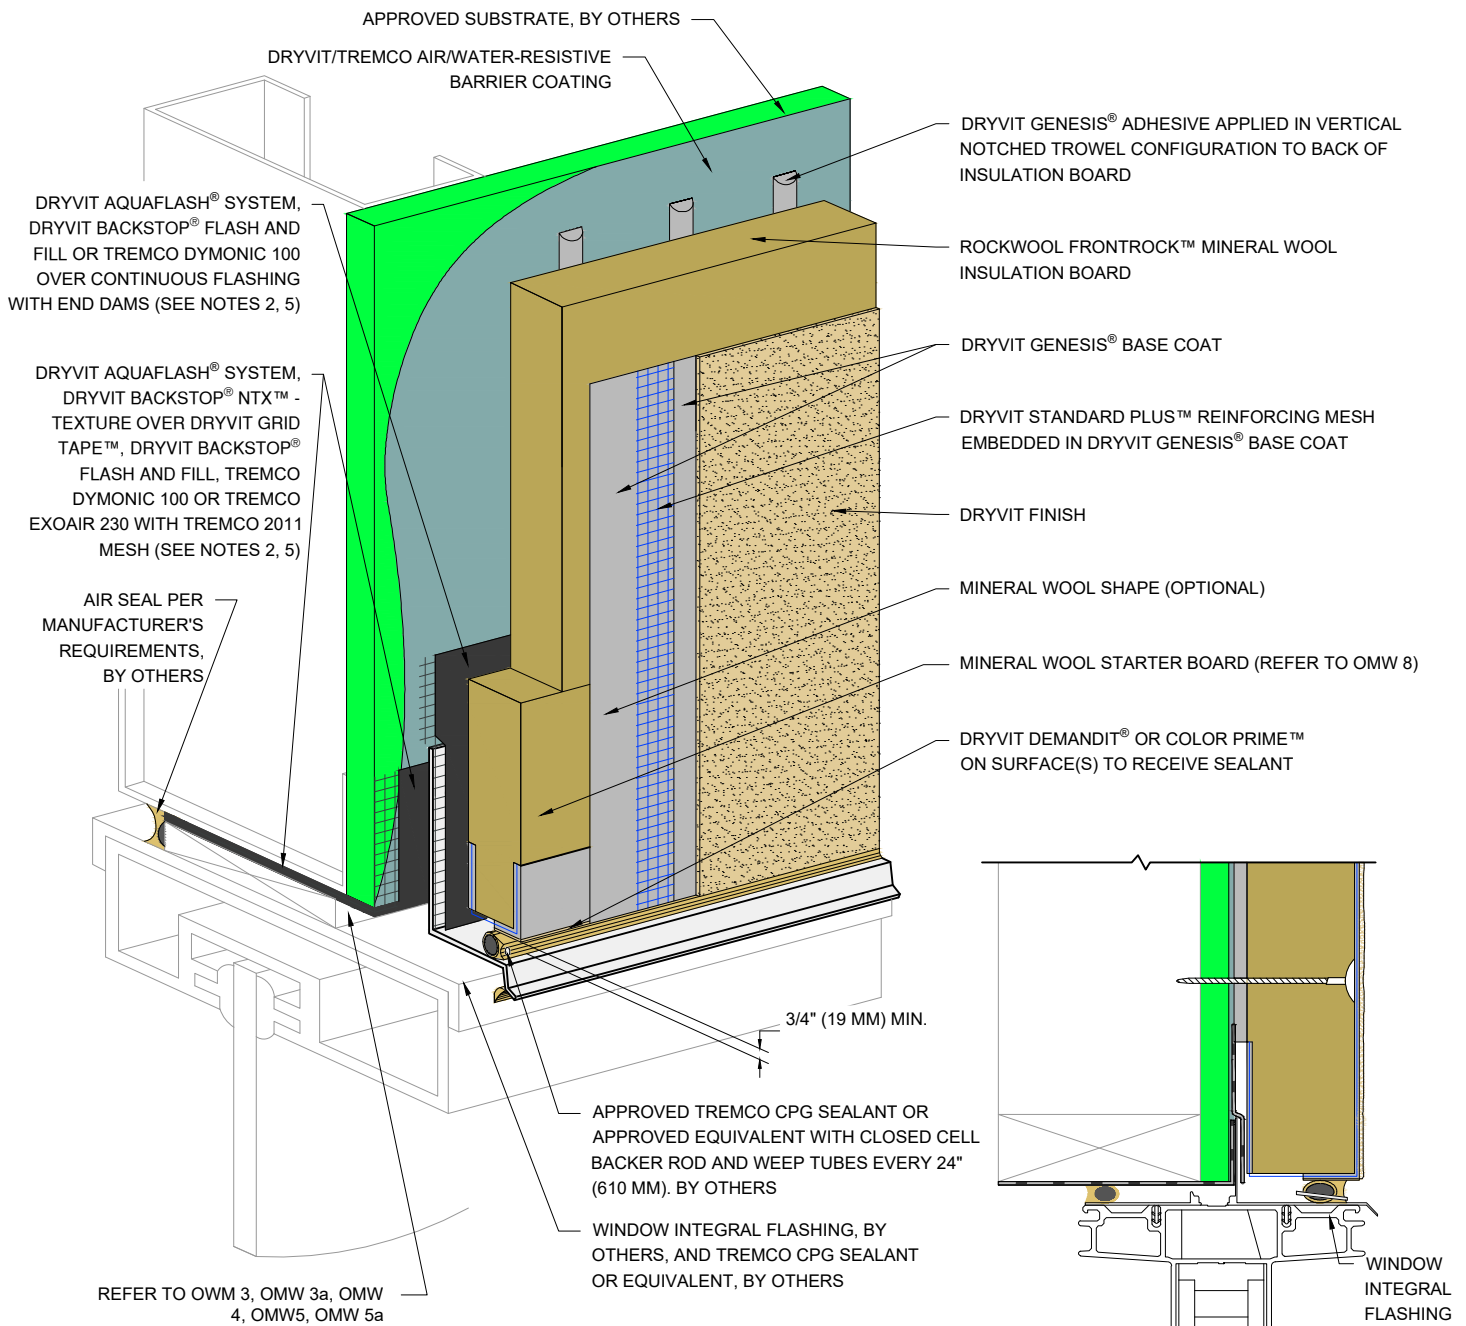

STOREFRONT WINDOW

FLANGED WINDOW

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Storefront and Flanged Window Head

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 18




Construction Products Group


www.tremcocpg.com

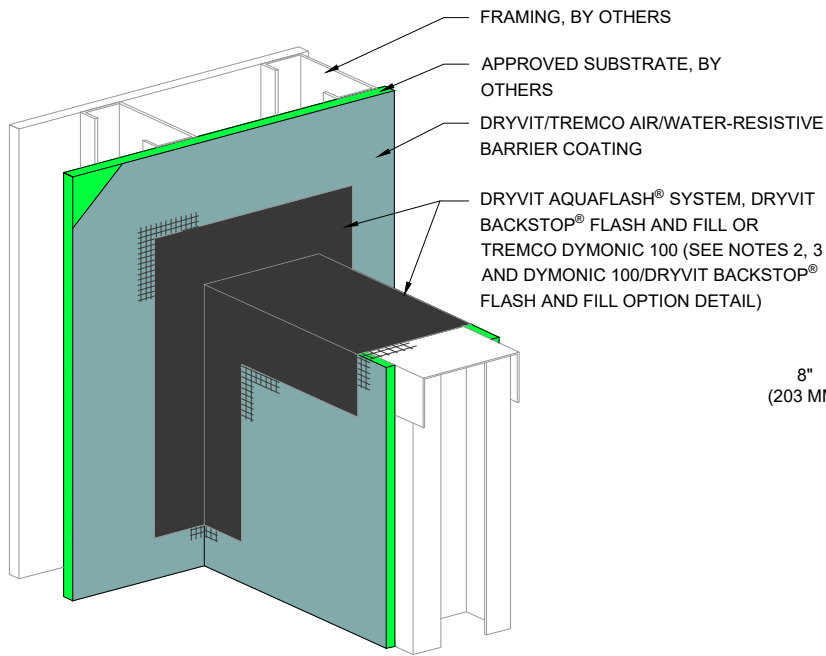


STEP #1

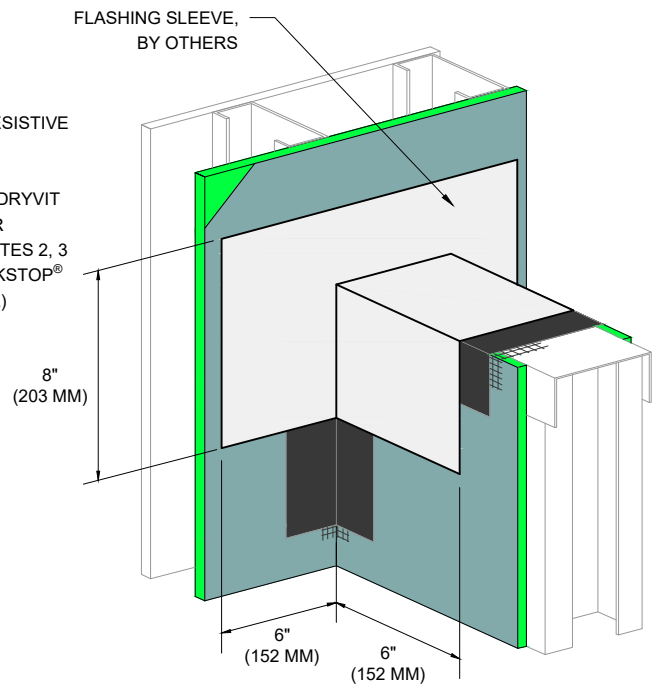

STEP #2

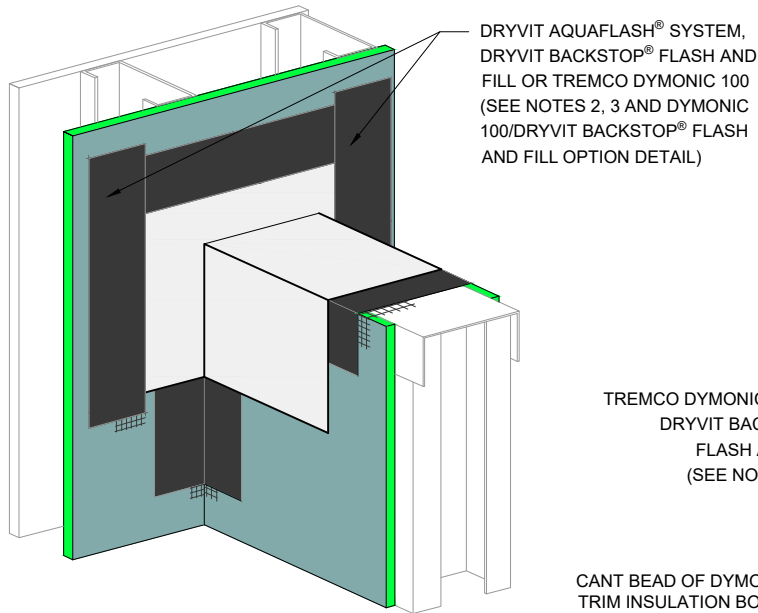

STEP #3

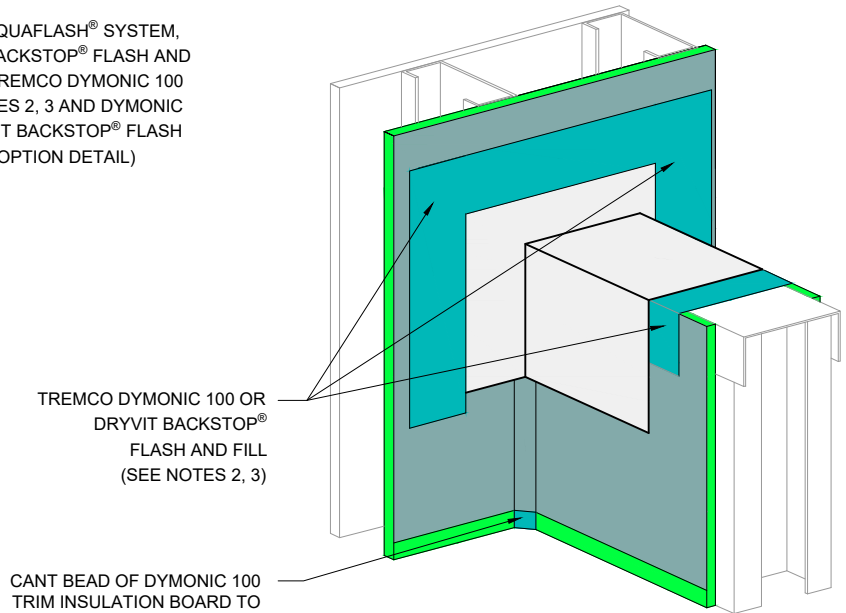

**TREMCO DYMONIC 100 OR
DRYVIT BACKSTOP® FLASH AND FILL
OPTION**

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD OR STANDARD PLUS MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Preparation At Parapet/ Wall Intersection

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 19



Construction Products Group

www.tremcocpg.com

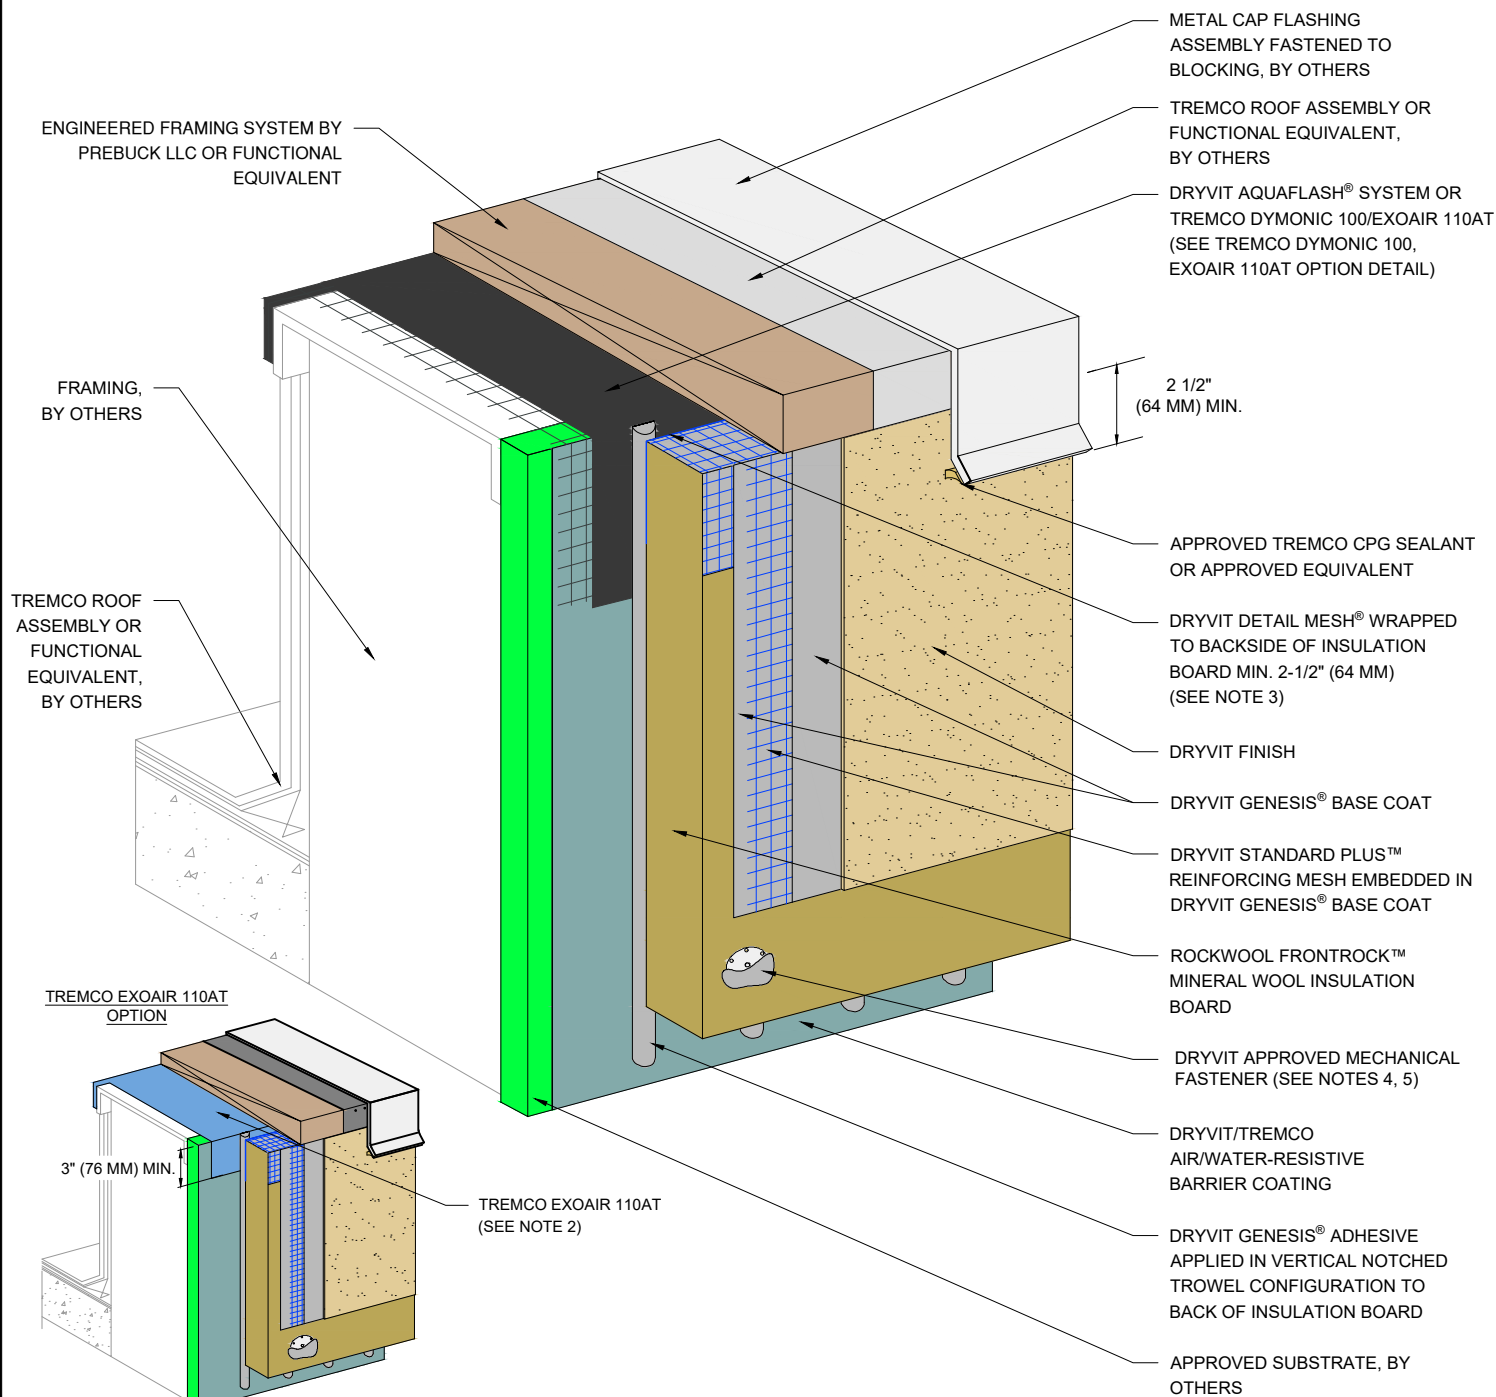

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. TREMCO DYMONIC 100 OR DRYVIT BACKSTOP® FLASH AND FILL MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. EDGE WRAPPING METHOD IS ACCEPTABLE IN LIEU OF BACK WRAPPING WITH THE EXCEPTION OF EXOAIR 110AT OPTION. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT INSULATION BOARD EDGE AND EXTEND ONTO SUBSTRATE 2-1/2" (64 MM) MIN.
4. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
5. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination At Parapet - Cap Flashing

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 20



Construction Products Group

www.tremcocpg.com

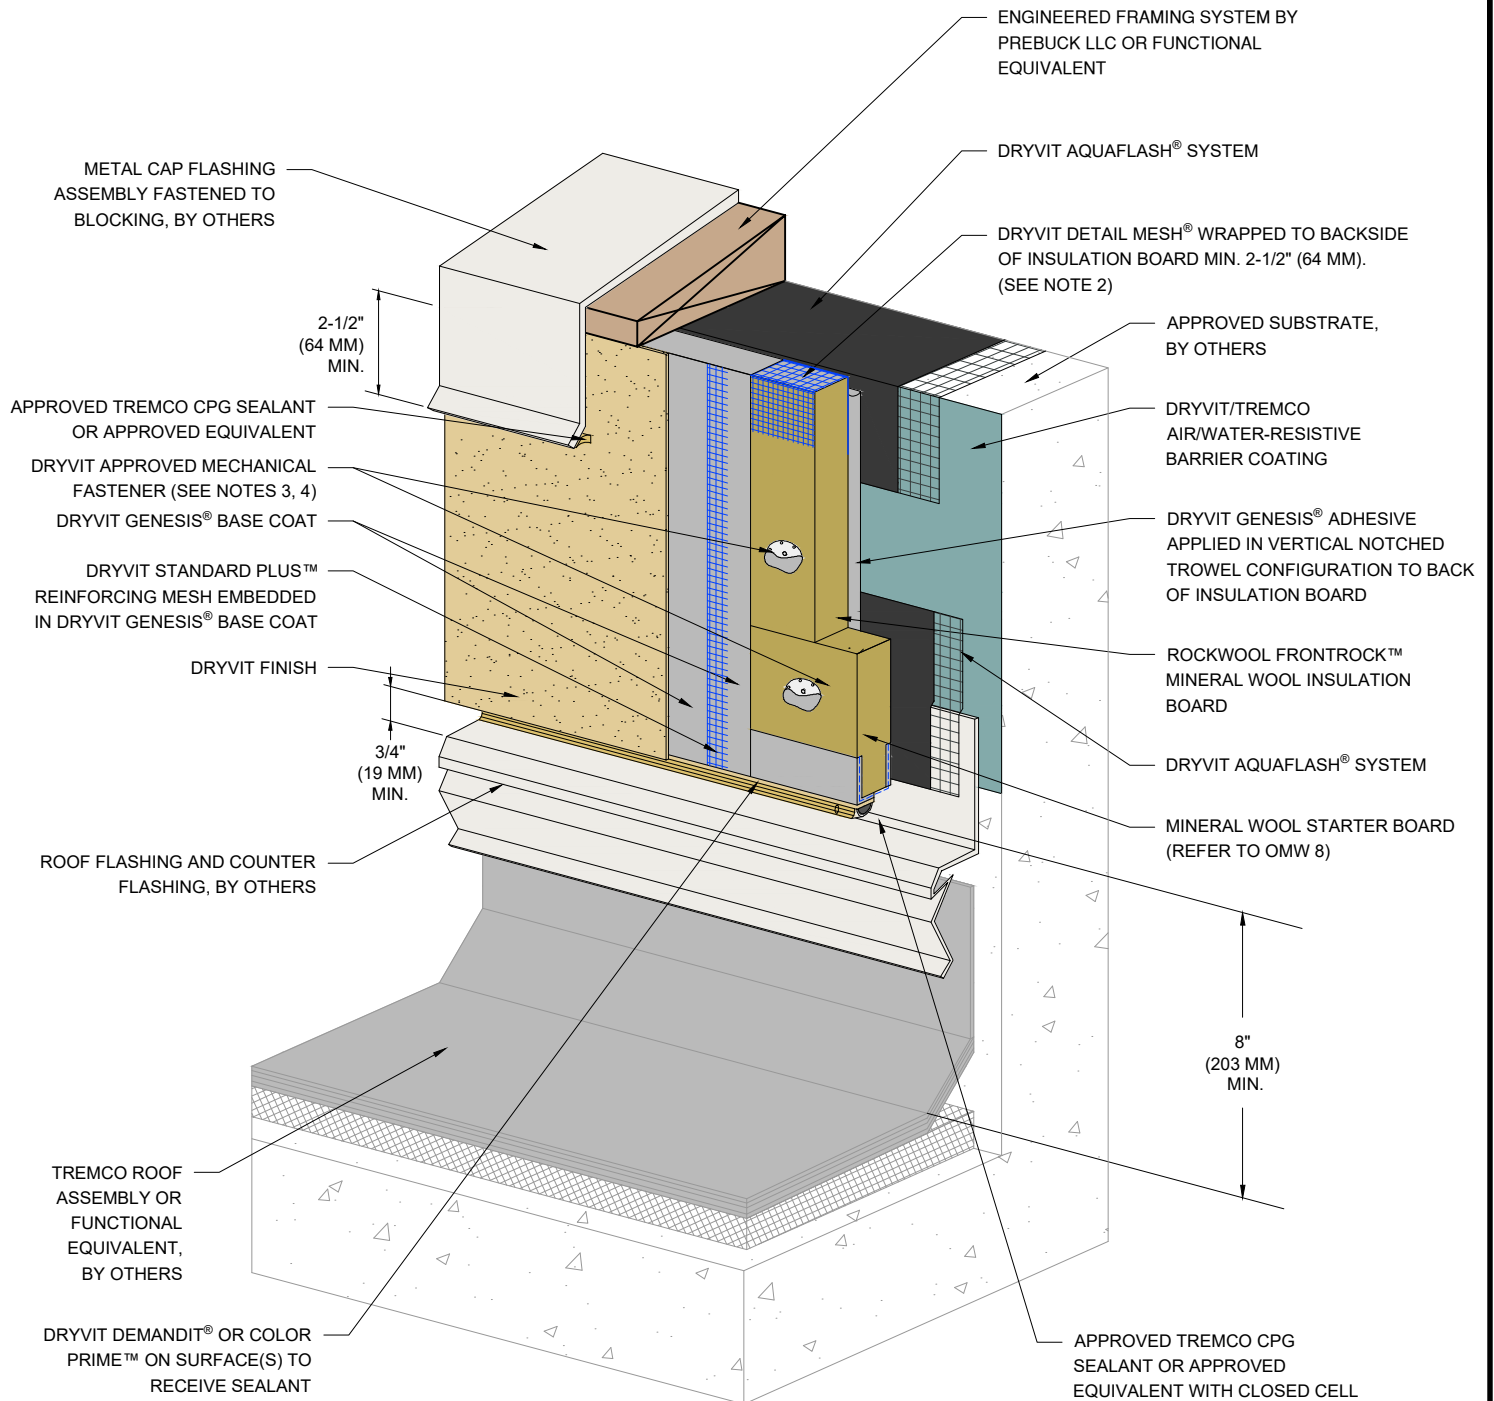

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EDGE WRAPPING METHOD IS ACCEPTABLE IN LIEU OF BACK WRAPPING. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT INSULATION BOARD EDGE AND EXTEND ONTO SUBSTRATE 2-1/2" (64 MM) MIN.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination At Roof Membrane

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 21

www.tremcocpg.com



Construction Products Group

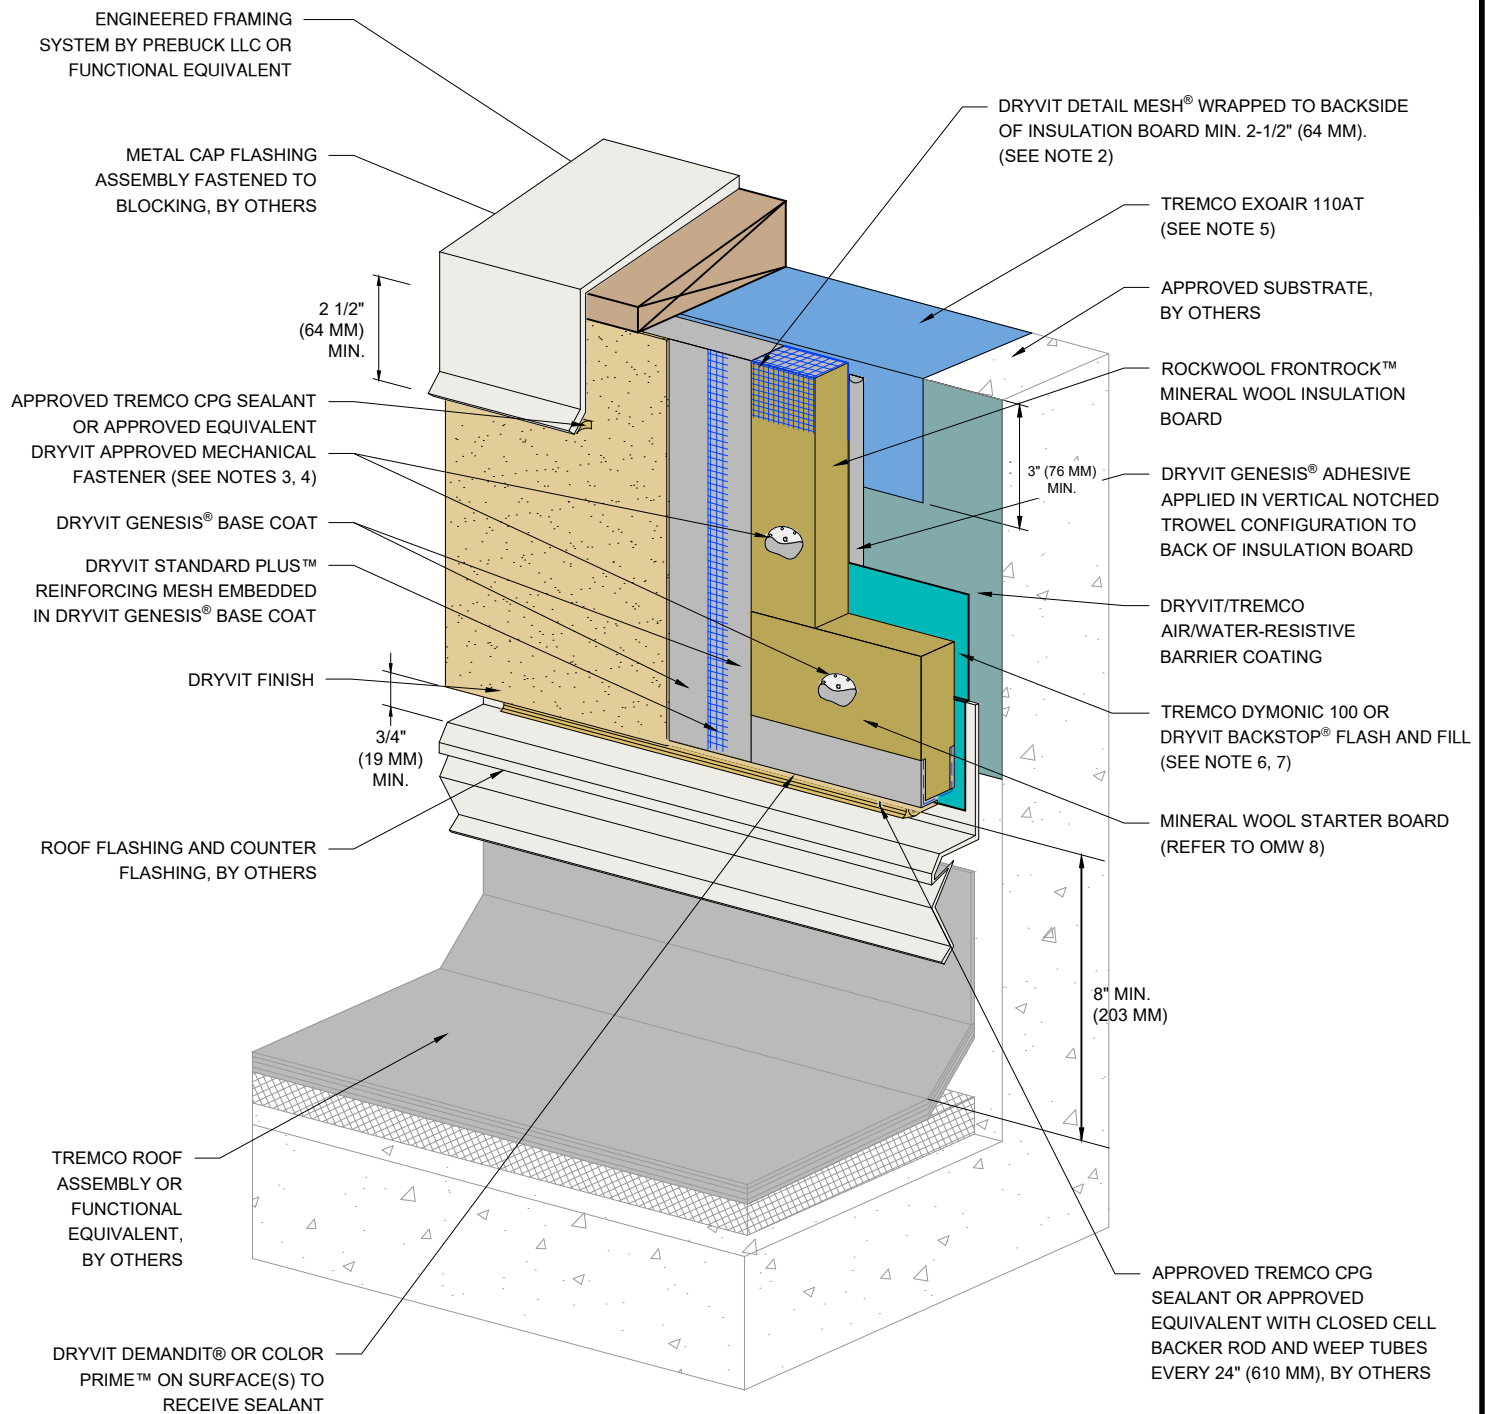

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EDGE WRAPPING METHOD IS ACCEPTABLE IN LIEU OF BACK WRAPPING. DRYVIT REINFORCING MESH MUST BE FULLY EMBEDDED IN DRYVIT BASE COAT AT INSULATION BOARD EDGE AND EXTEND ONTO SUBSTRATE 2-1/2" (64 MM) MIN.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. DYMONIC 100 OR DRYVIT BACKSTOP® FLASH AND FILL MAY BE USED IN LIEU OF TREMCO EXOAIR 110AT.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
8. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at Roof Membrane -
Tremco ExoAir 110AT/Dymonic 100

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 21a



Construction Products Group

www.tremcocpg.com

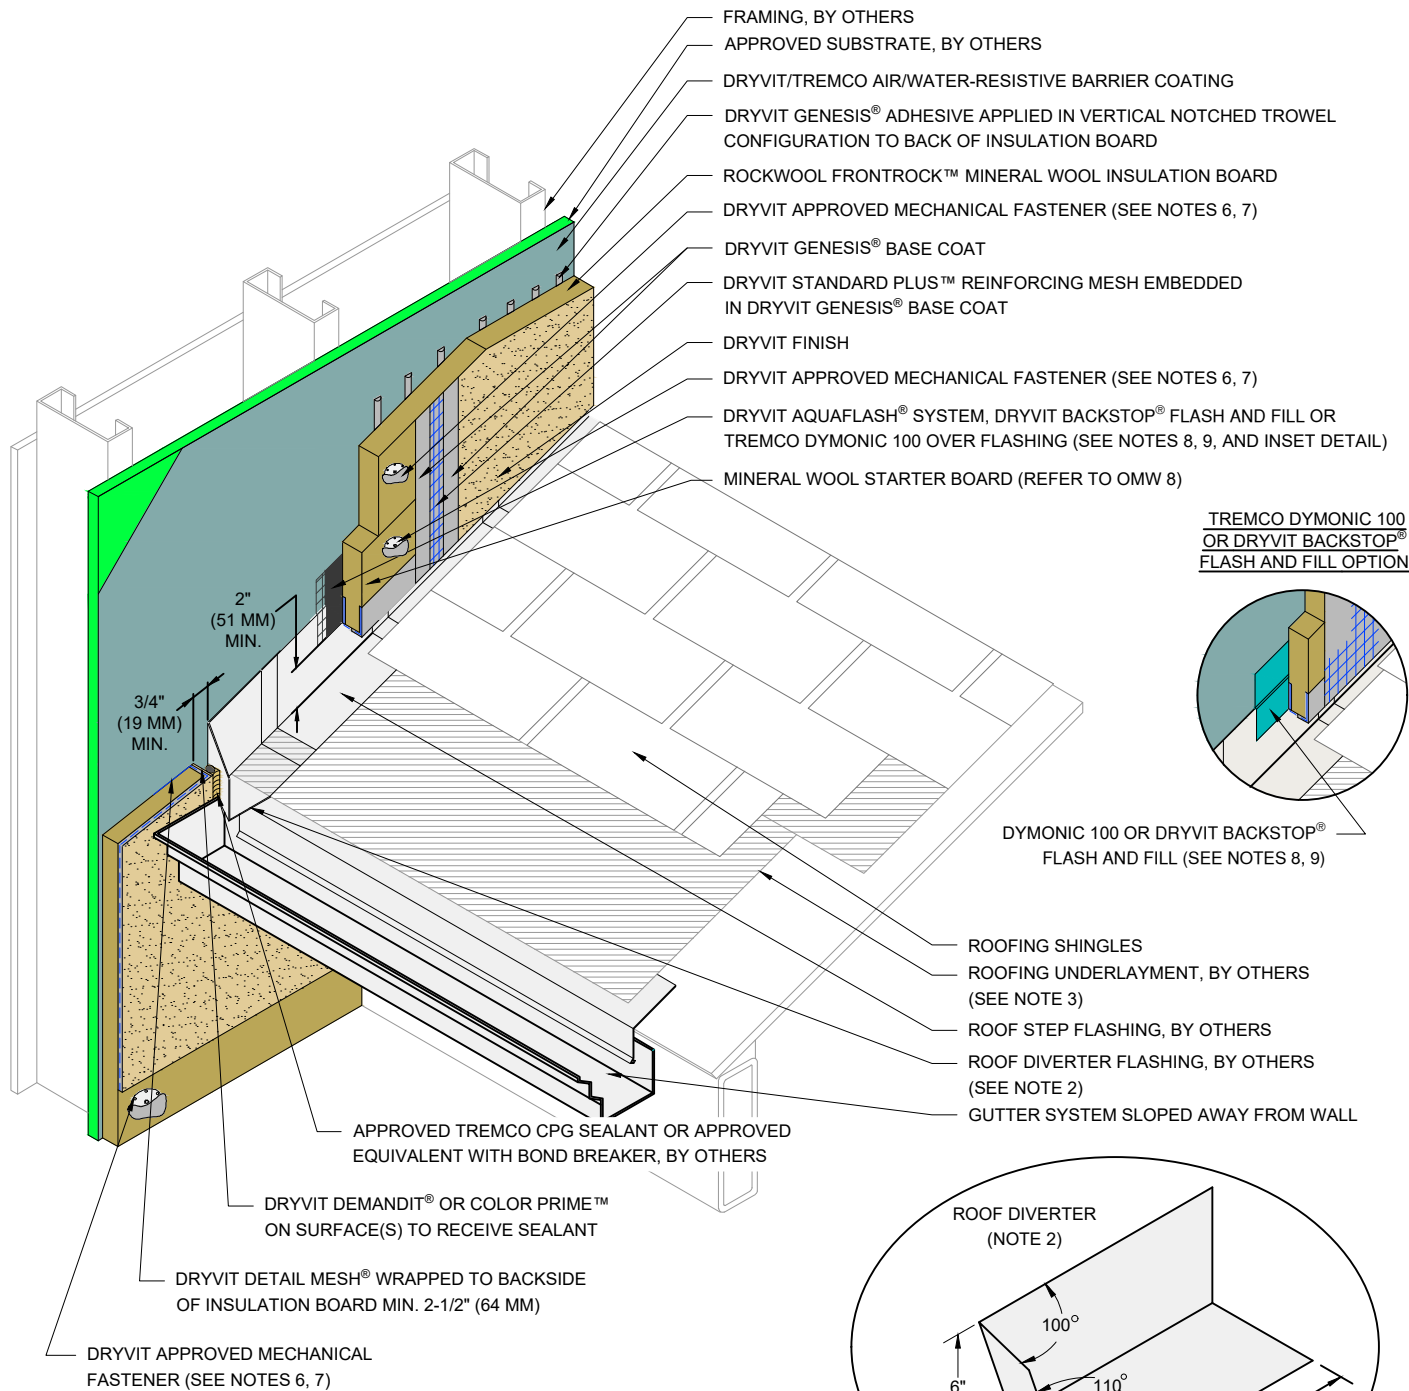

NOTE:

1. EXTEND DIVERter FLASHING (KICKOUT) A MINIMUM OF 1" (25 MM) BEYOND FACE OF THE SYSTEM.
2. ROOF DIVERter TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAUGE WITH WATER TIGHT SEAMS.
3. EXTEND ROOFING UNDERLAYMENT 5" (127 MM) UP VERTICAL WALL BEHIND METAL FLASHING.
4. METAL FLASHINGS ARE 10" (254 MM) X 2" (51 MM) LONGER THAN THE EXPOSED PORTION OF THE ROOFING SHINGLE AND ARE BENT IN HALF TO ALLOW FOR TWO 5" (127 MM) LEGS. ALTHOUGH NOT SHOWN, METAL FLASHINGS ARE STEP FLASHED (INTERWOVEN) WITH ROOFING SHINGLES.
5. FOR ADDITIONAL SLOPED ROOF DETAILS, REFER TO DRYVIT PUBLICATION DS106.
6. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
7. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
8. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
9. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

10. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at Sloped Roof

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 22



Construction Products Group


www.tremcocpg.com

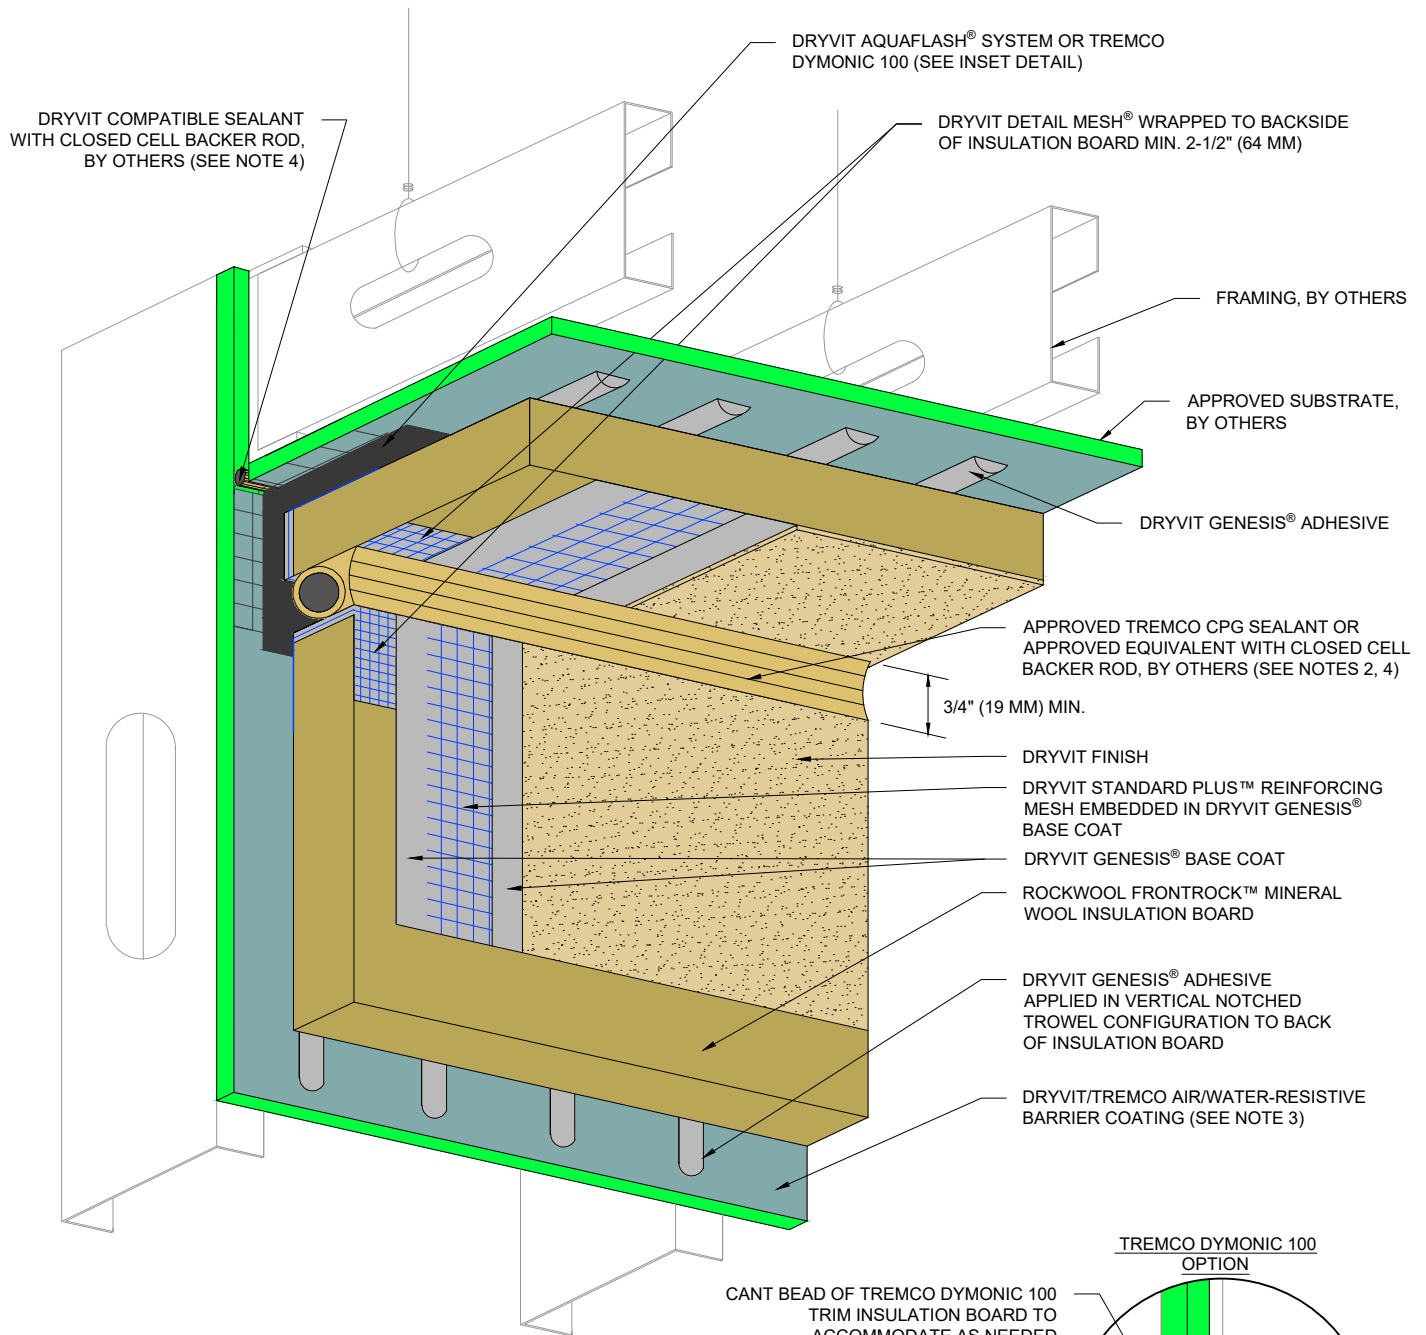

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT DEMANDIT® OR COLOR PRIME™ ON SURFACES TO RECEIVE SEALANT.
3. DRYVIT/TREMCO AIR/WATER-RESISTIVE BARRIER IS REQUIRED OVER VERTICAL SUBSTRATES. APPLICATION OVER HORIZONTAL SOFFIT SUBSTRATE IS OPTIONAL UNLESS REQUIRED AS PART OF A CONTINUOUS AIR BARRIER SYSTEM.
4. SEALANT JOINT IS REQUIRED FOR SUSPENDED SOFFITS. OPTIONAL FOR RIGIDLY FRAMED.
5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

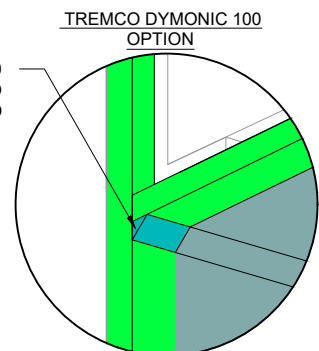

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Vertical Wall/Suspended Soffit Transition

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 23



Construction Products Group

www.tremcocpg.com

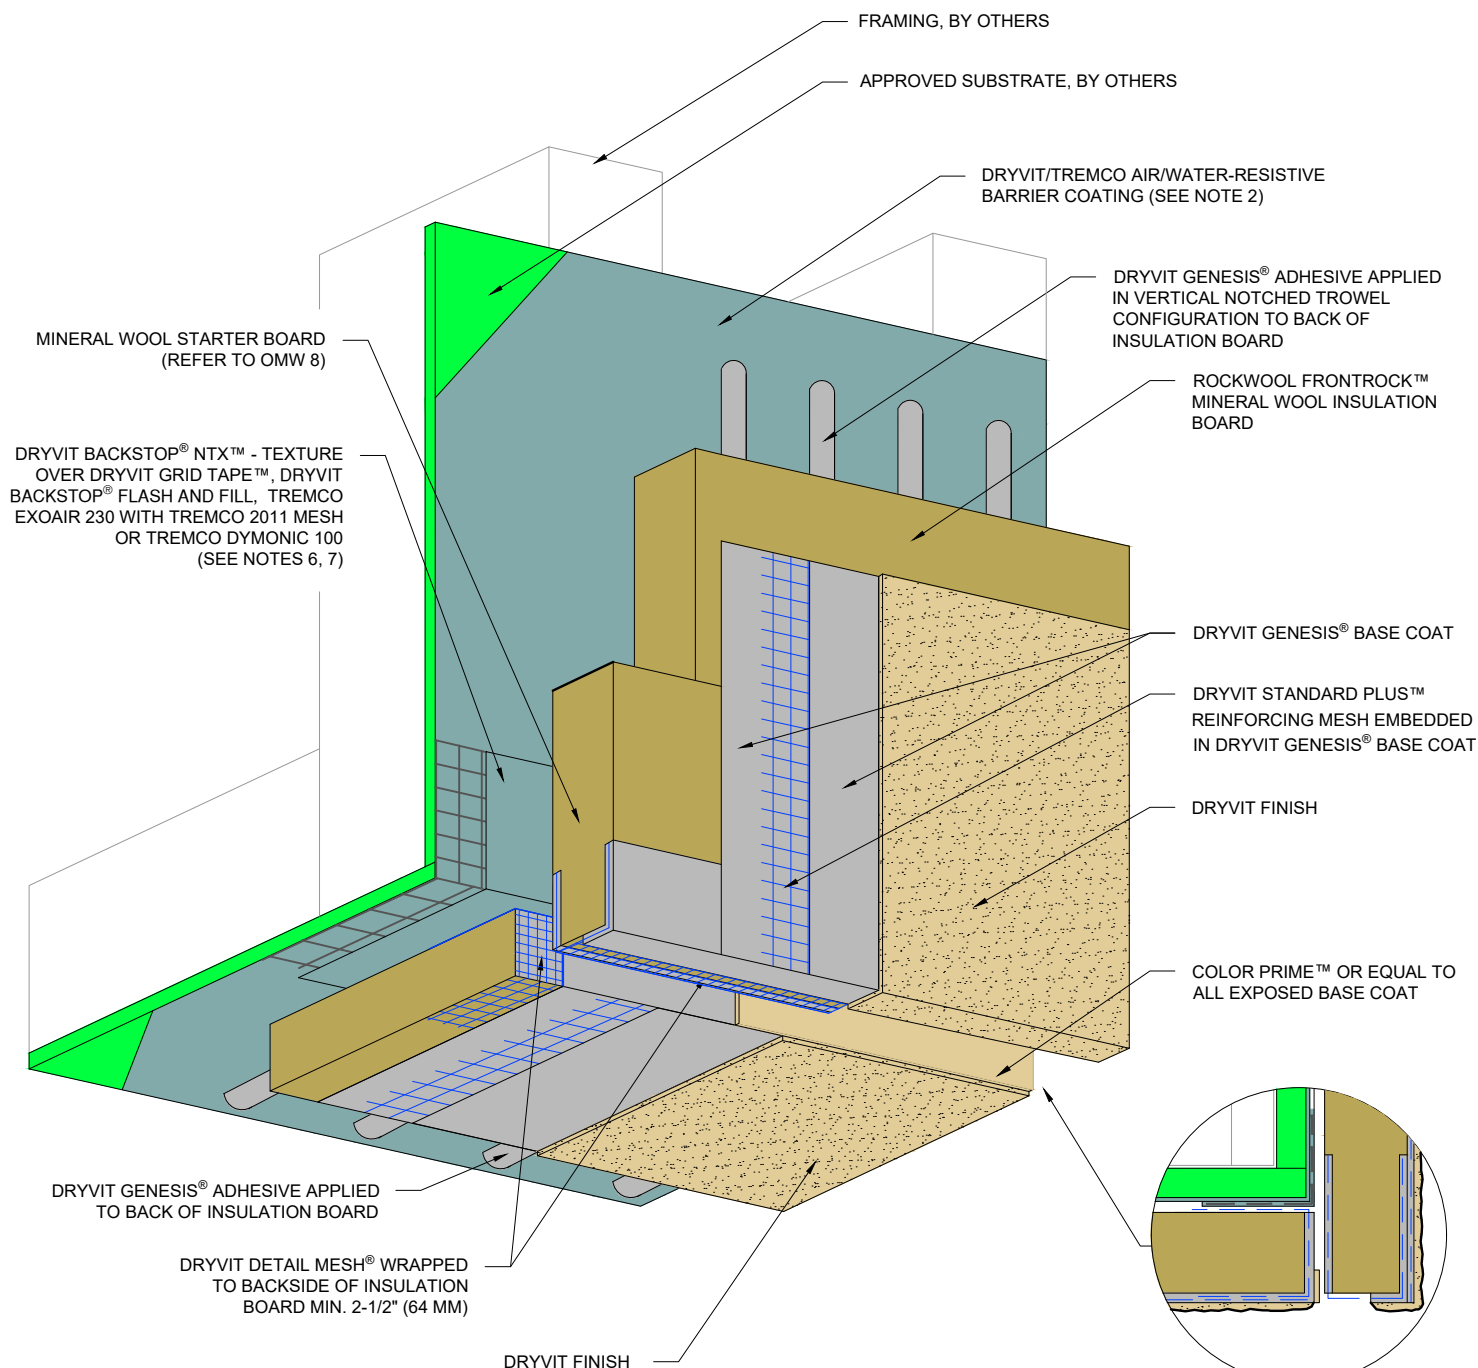

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. DRYVIT/TREMCO AIR/WATER-RESISTIVE BARRIER IS REQUIRED OVER VERTICAL SUBSTRATES, APPLICATION OVER HORIZONTAL SOFFIT SUBSTRATE IS OPTIONAL UNLESS REQUIRED AS PART OF A CONTINUOUS AIR BARRIER SYSTEM.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
7. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Transition At Soffit/Fascia Intersection

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 24



Construction Products Group

www.tremcocpg.com

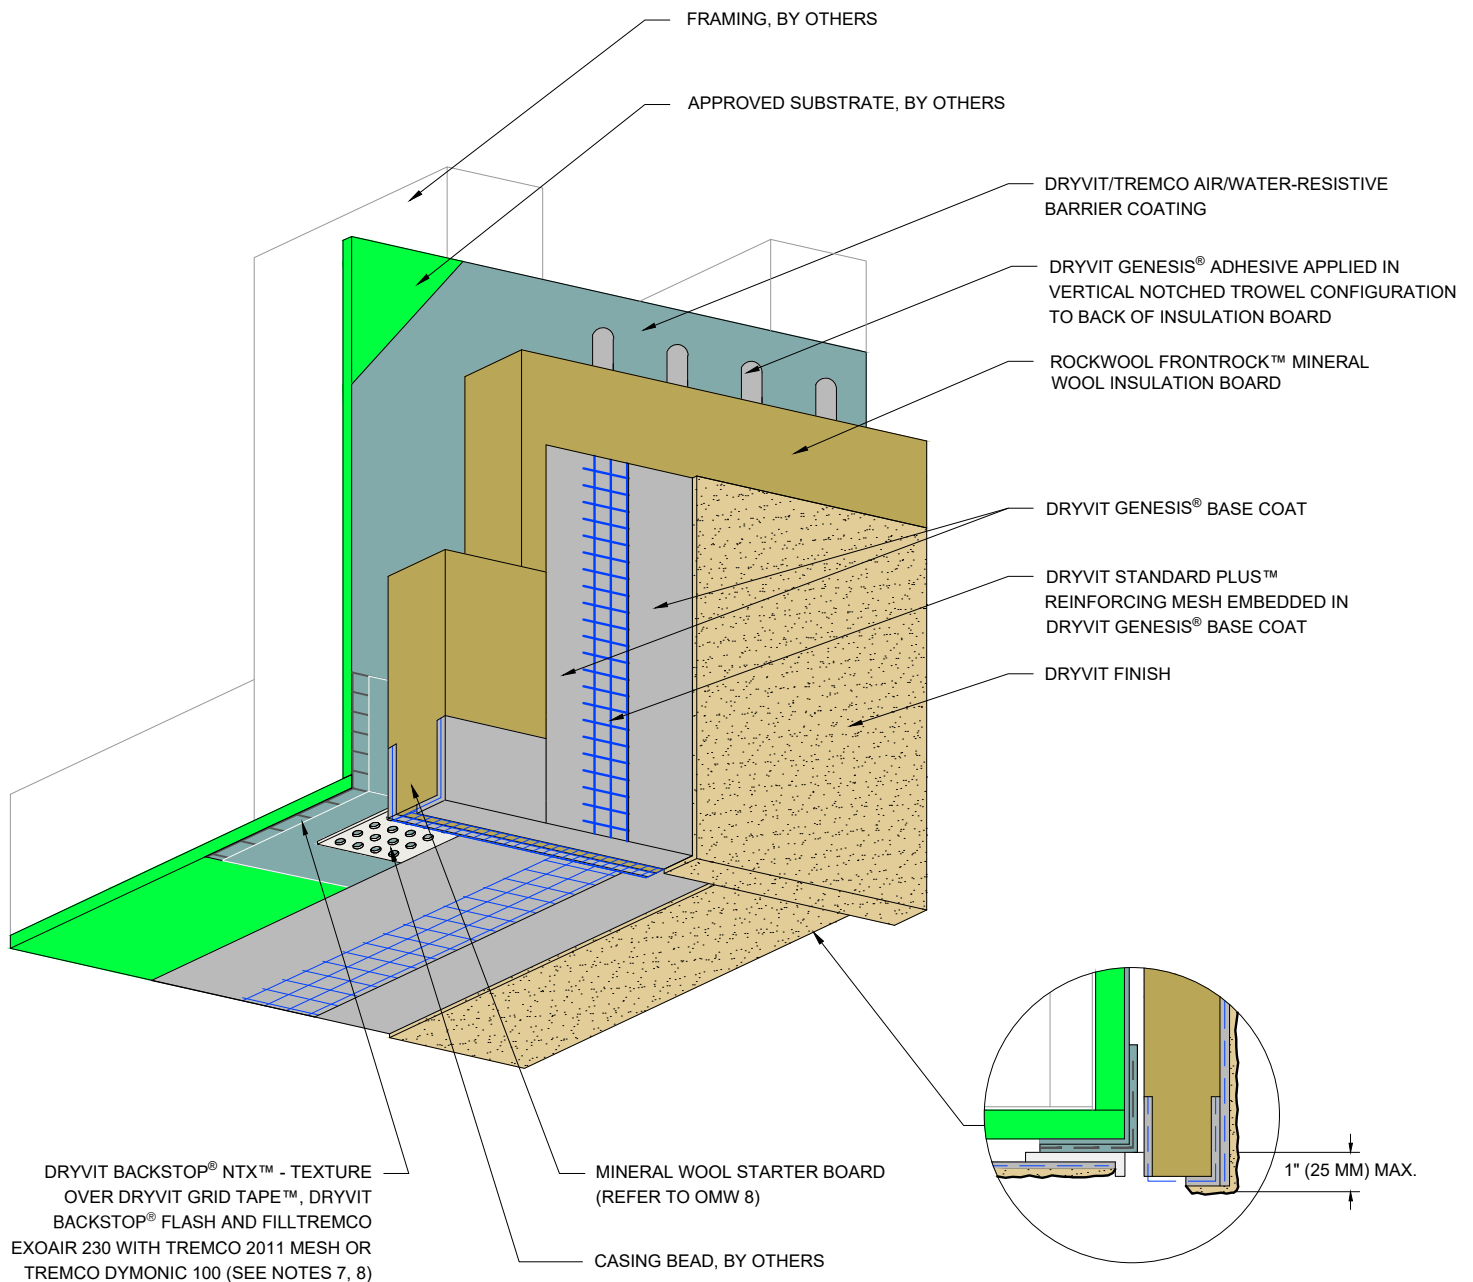

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. SOFFITS WITHOUT INSULATION REQUIRE EXPANSION JOINTS EVERY 20 FT (6.1 M).
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. REFER TO DRYVIT PUBLICATION DS173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.
7. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
8. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Fascia/Uninsulated Soffit Transition

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 25



Construction Products Group

www.tremcocpg.com

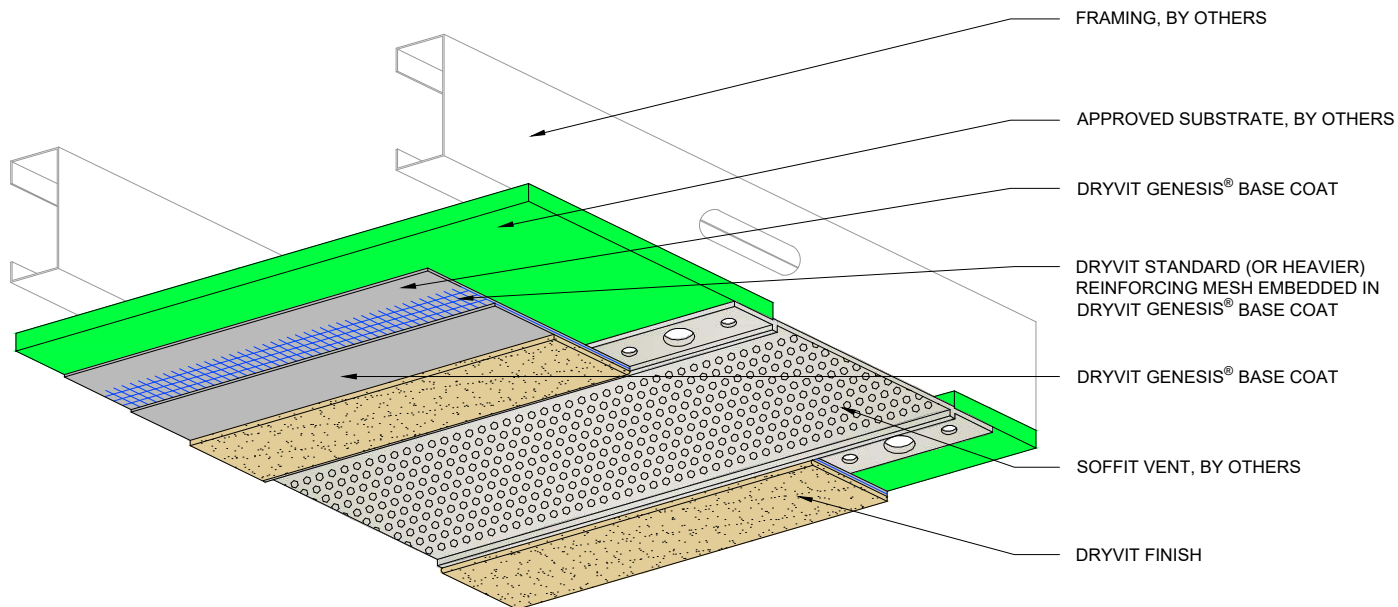

NOTE:

1. CONTROL JOINTS ARE RECOMMENDED EVERY 20 FT (6.1 M).
2. REFER TO DRYVIT PUBLICATION DS173 FOR SPECIFIC REQUIREMENTS FOR SOFFIT AREAS.
3. SEAL ALL BUTT JOINTS, INTERSECTIONS, AND ENDS OF VENTS WITH COMPATIBLE SEALANT.
4. SEE DRYVIT PUBLICATION DS842 FOR ADDITIONAL DIRECT APPLIED DETAILS.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Termination at Uninsulated Soffit Vent

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 26



Construction Products Group

www.tremcocpg.com

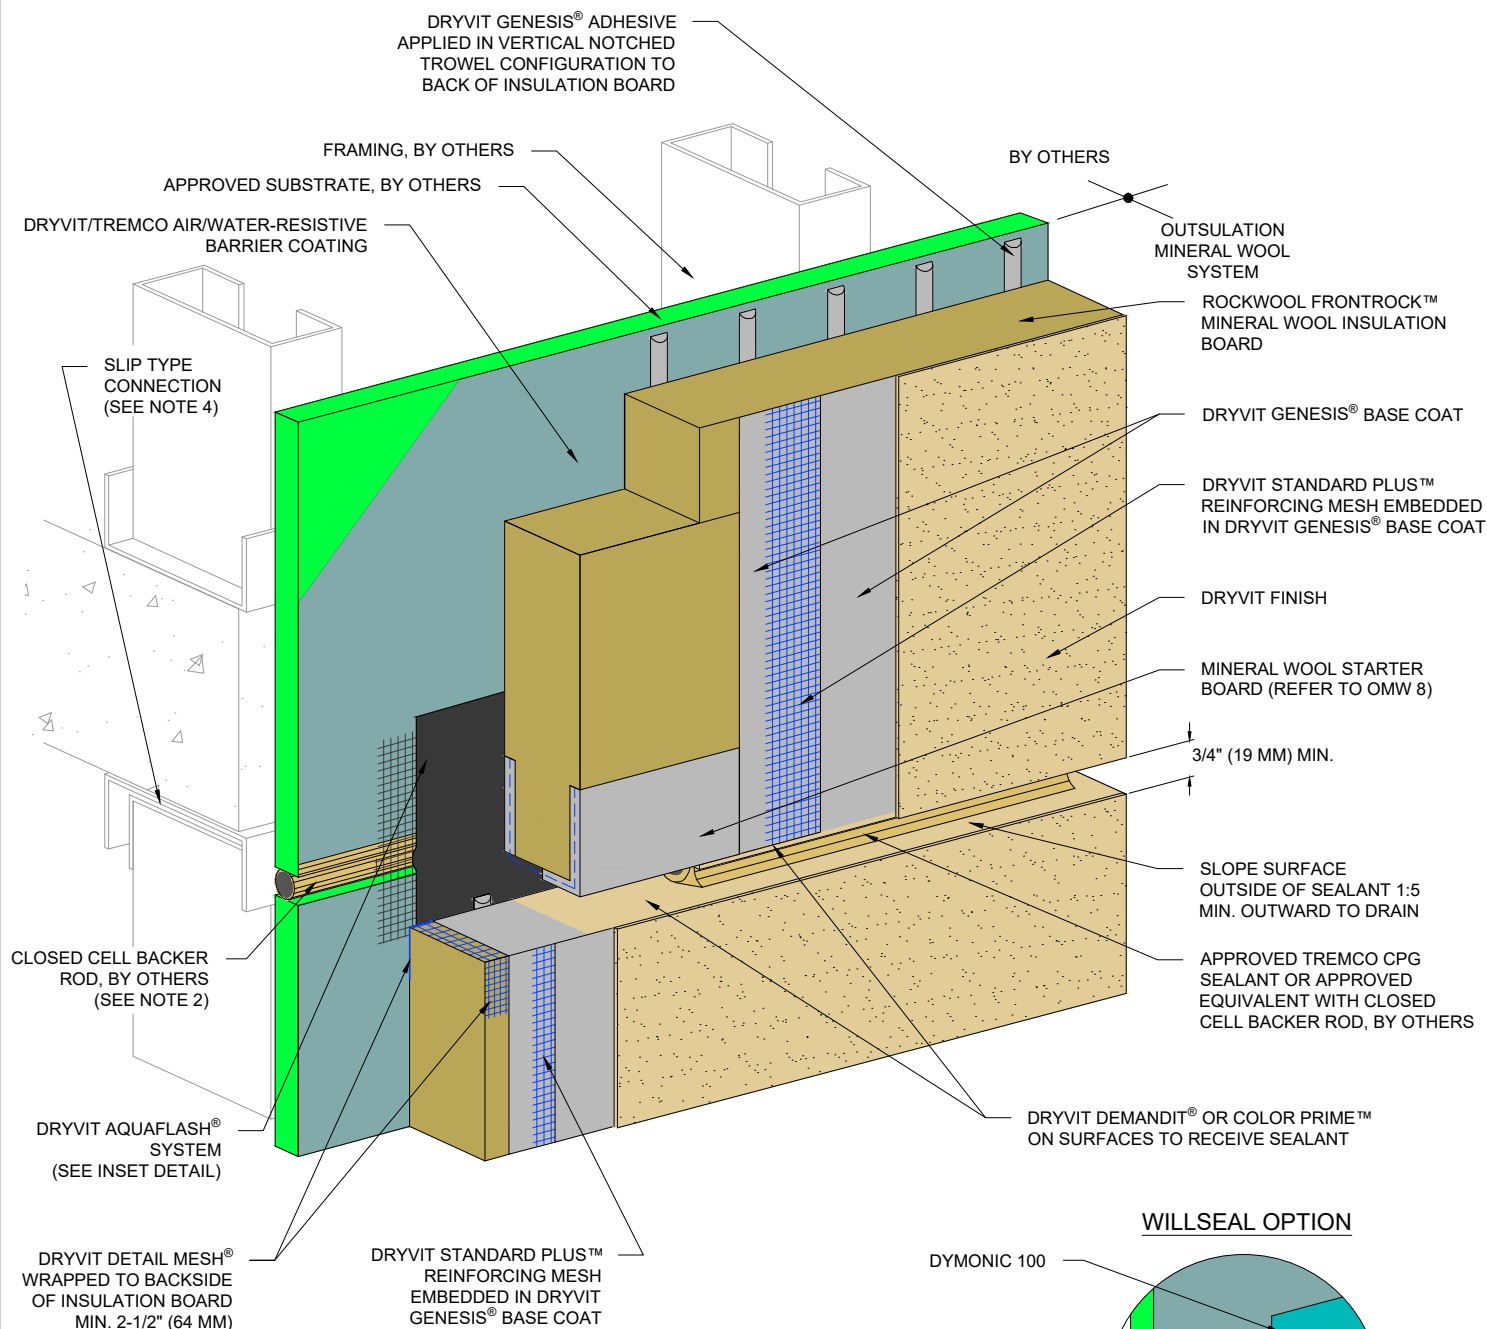


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING
3. EXPANSION JOINT IN THE OUTSULATION MINERAL WOOL SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.
4. FOR STEEL FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE MOVEMENT AT SLIP CONNECTION.
5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
6. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
7. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

WILLSEAL OPTION

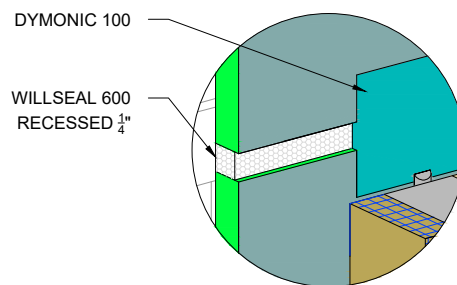

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Horizontal Joint at Floor Line without Weeps

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 27



Construction Products Group

www.tremcocpg.com

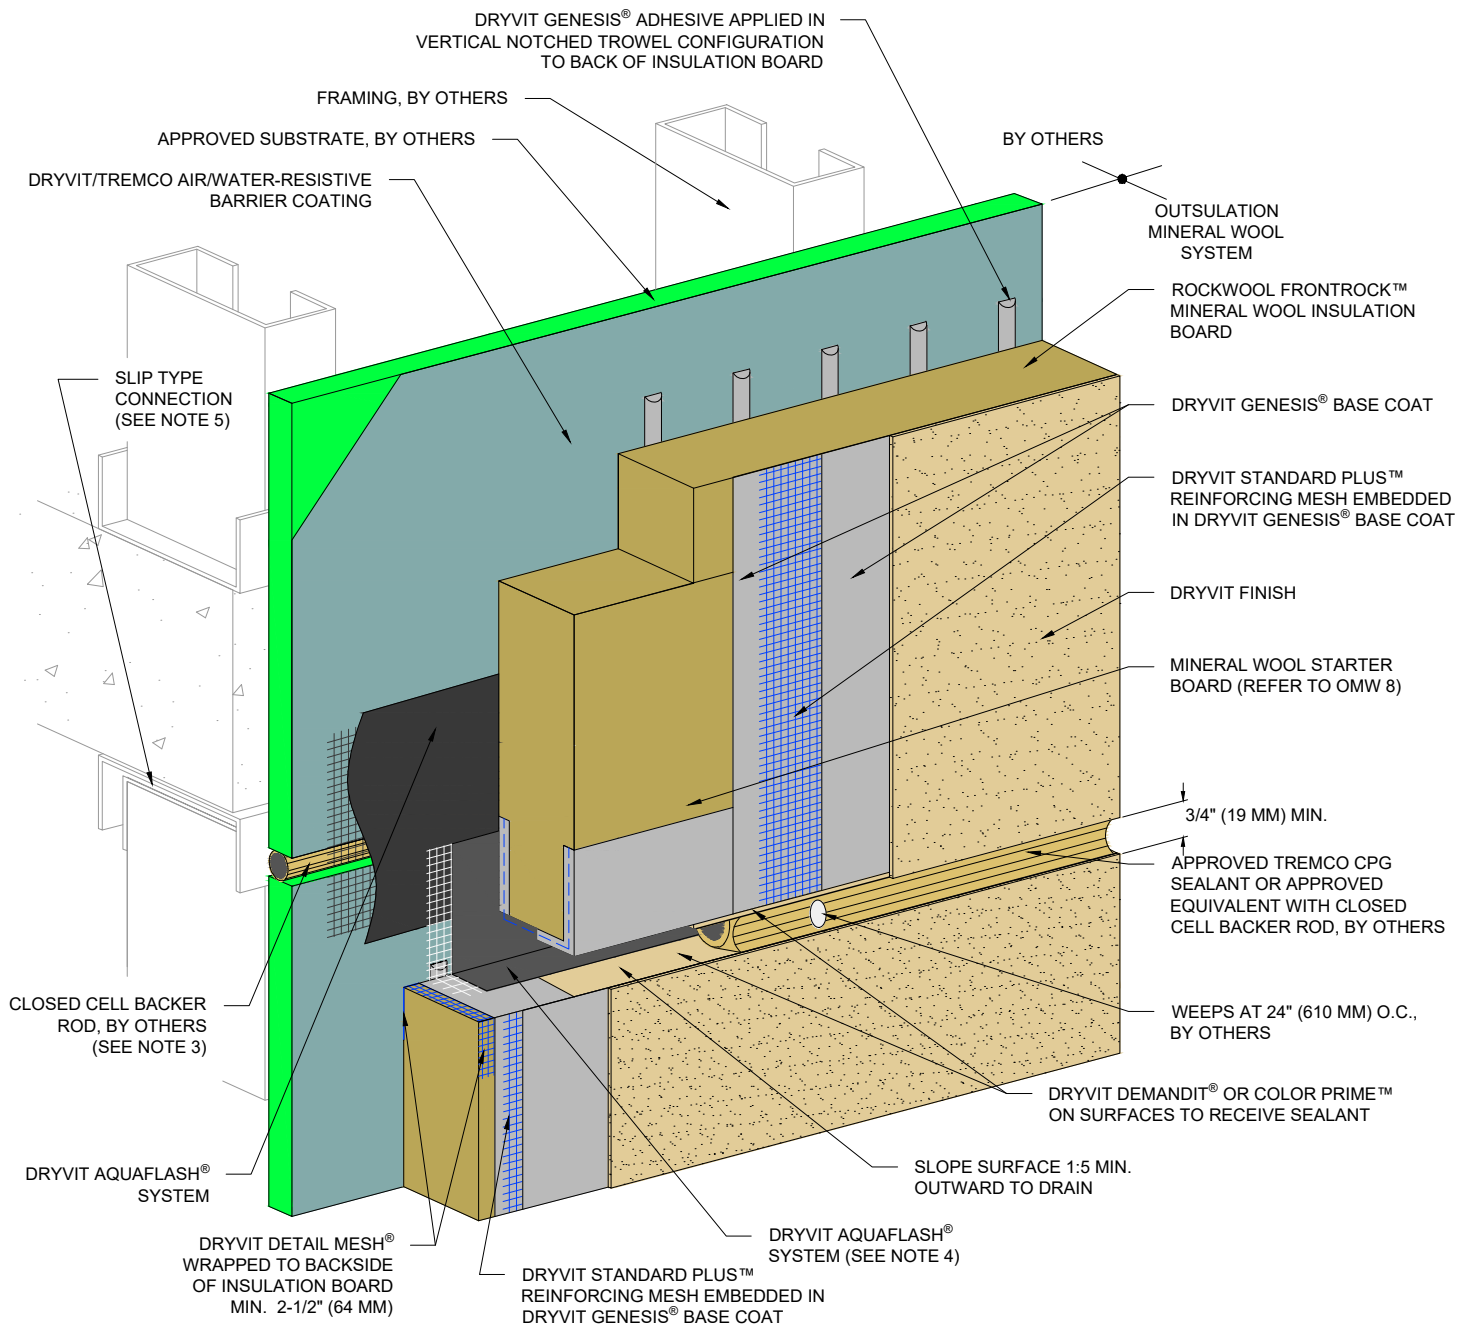

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EXPANSION JOINT IN THE OUTSULATION MINERAL WOOL SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.
3. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING.
4. STOP AQUAFASH® SYSTEM SHORT OF SEALANT BOND LINE.
5. FOR STEEL FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE MOVEMENT AT SLIP CONNECTION.
6. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
7. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
8. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Horizontal Joint at Floor Line with Weeps

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 28



Construction Products Group

www.tremcocpg.com

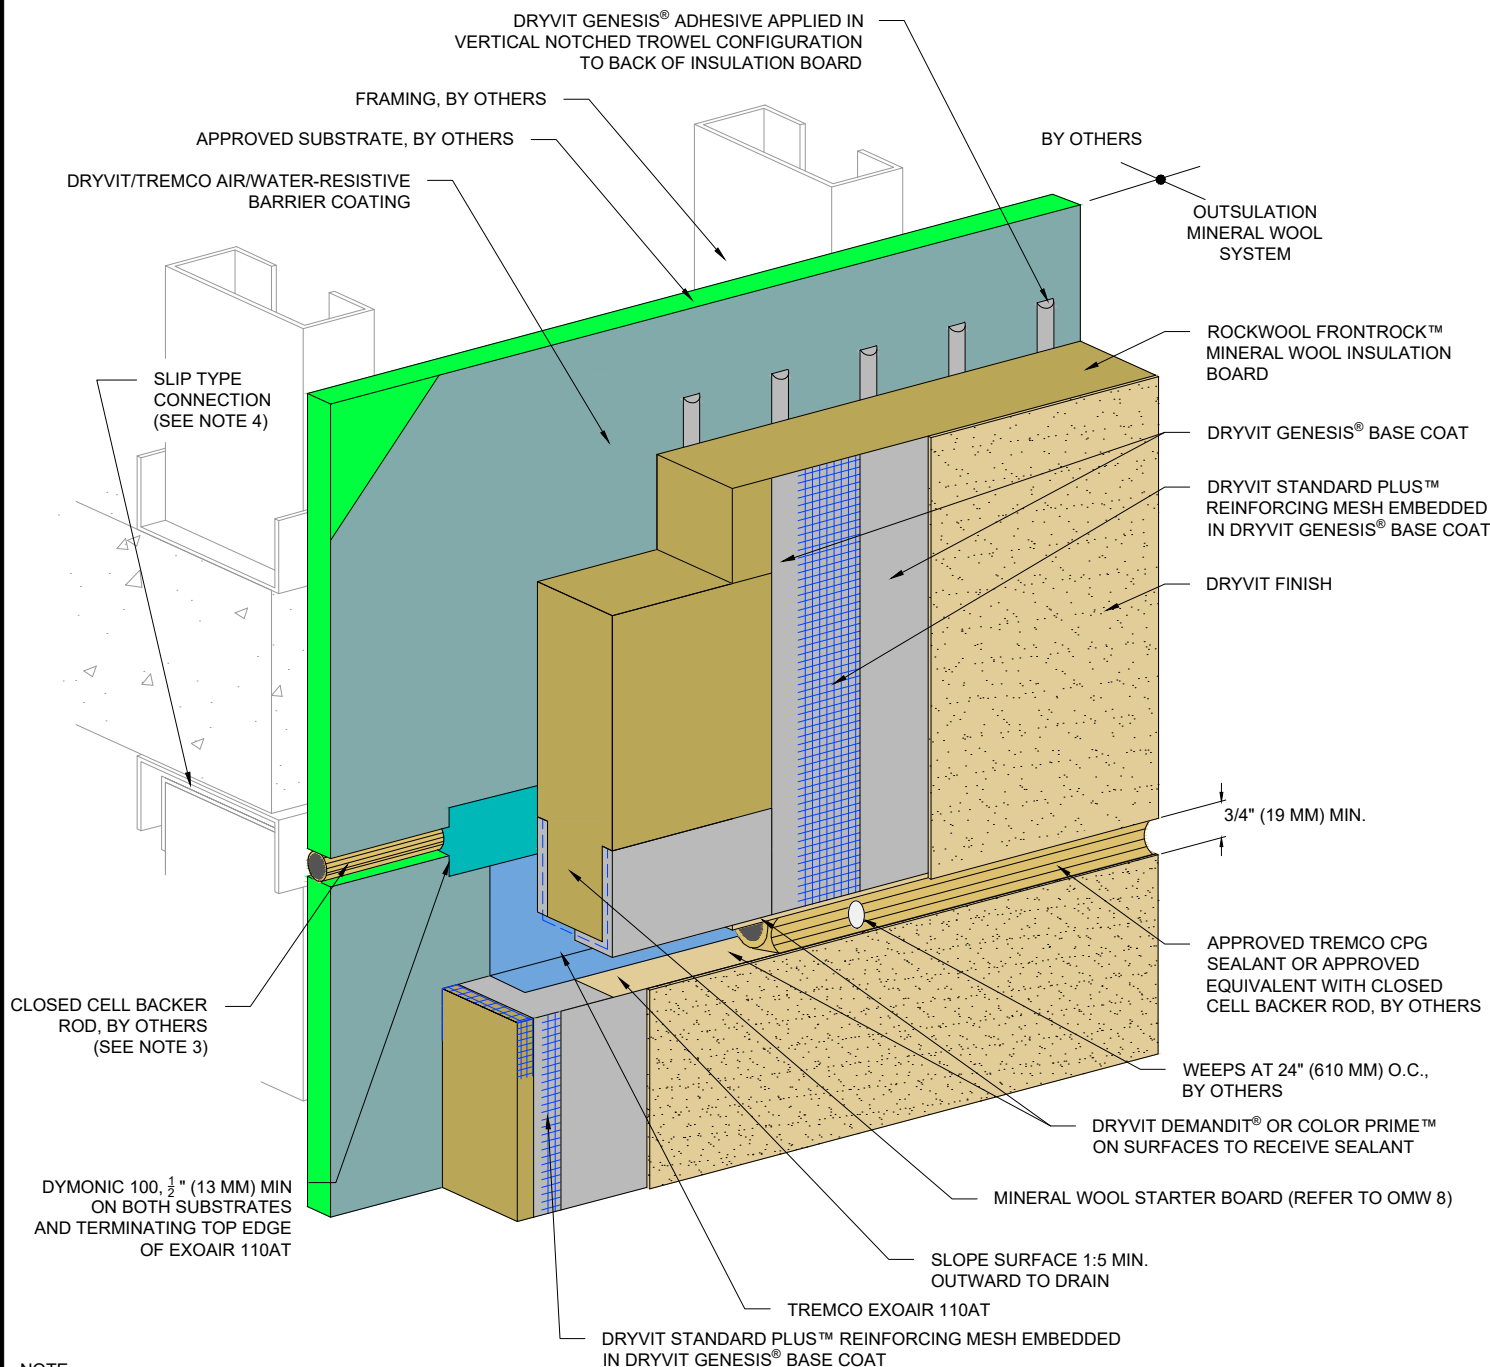

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. EXPANSION JOINT IN THE OUTSULATION MINERAL WOOL SYSTEM IS NECESSARY WHERE SIGNIFICANT DIFFERENTIAL MOVEMENT IS EXPECTED AT FLOOR LINES.
3. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF BREAK IN SHEATHING.
4. FOR STEEL FRAMED CONSTRUCTION: EXPANSION JOINT IS INTENDED TO ACCOMMODATE MOVEMENT AT SLIP CONNECTION.
5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
6. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
7. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
8. EXOAIR 110AT MUST LAP NO LESS THAN 3" ONTO SUBSTRATE. LAPS IN EXOAIR 110AT SHALL BE NO LESS THAN 2". DESIGNER TO VERIFY THE OUTSULATION MINERAL WOOL SYSTEM IS OF ADEQUATE THICKNESS TO MEET THESE REQUIREMENTS.
9. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Horizontal Slip Joint with Weeps -
ExoAir 110AT Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 28a



Construction Products Group

www.tremcocpg.com

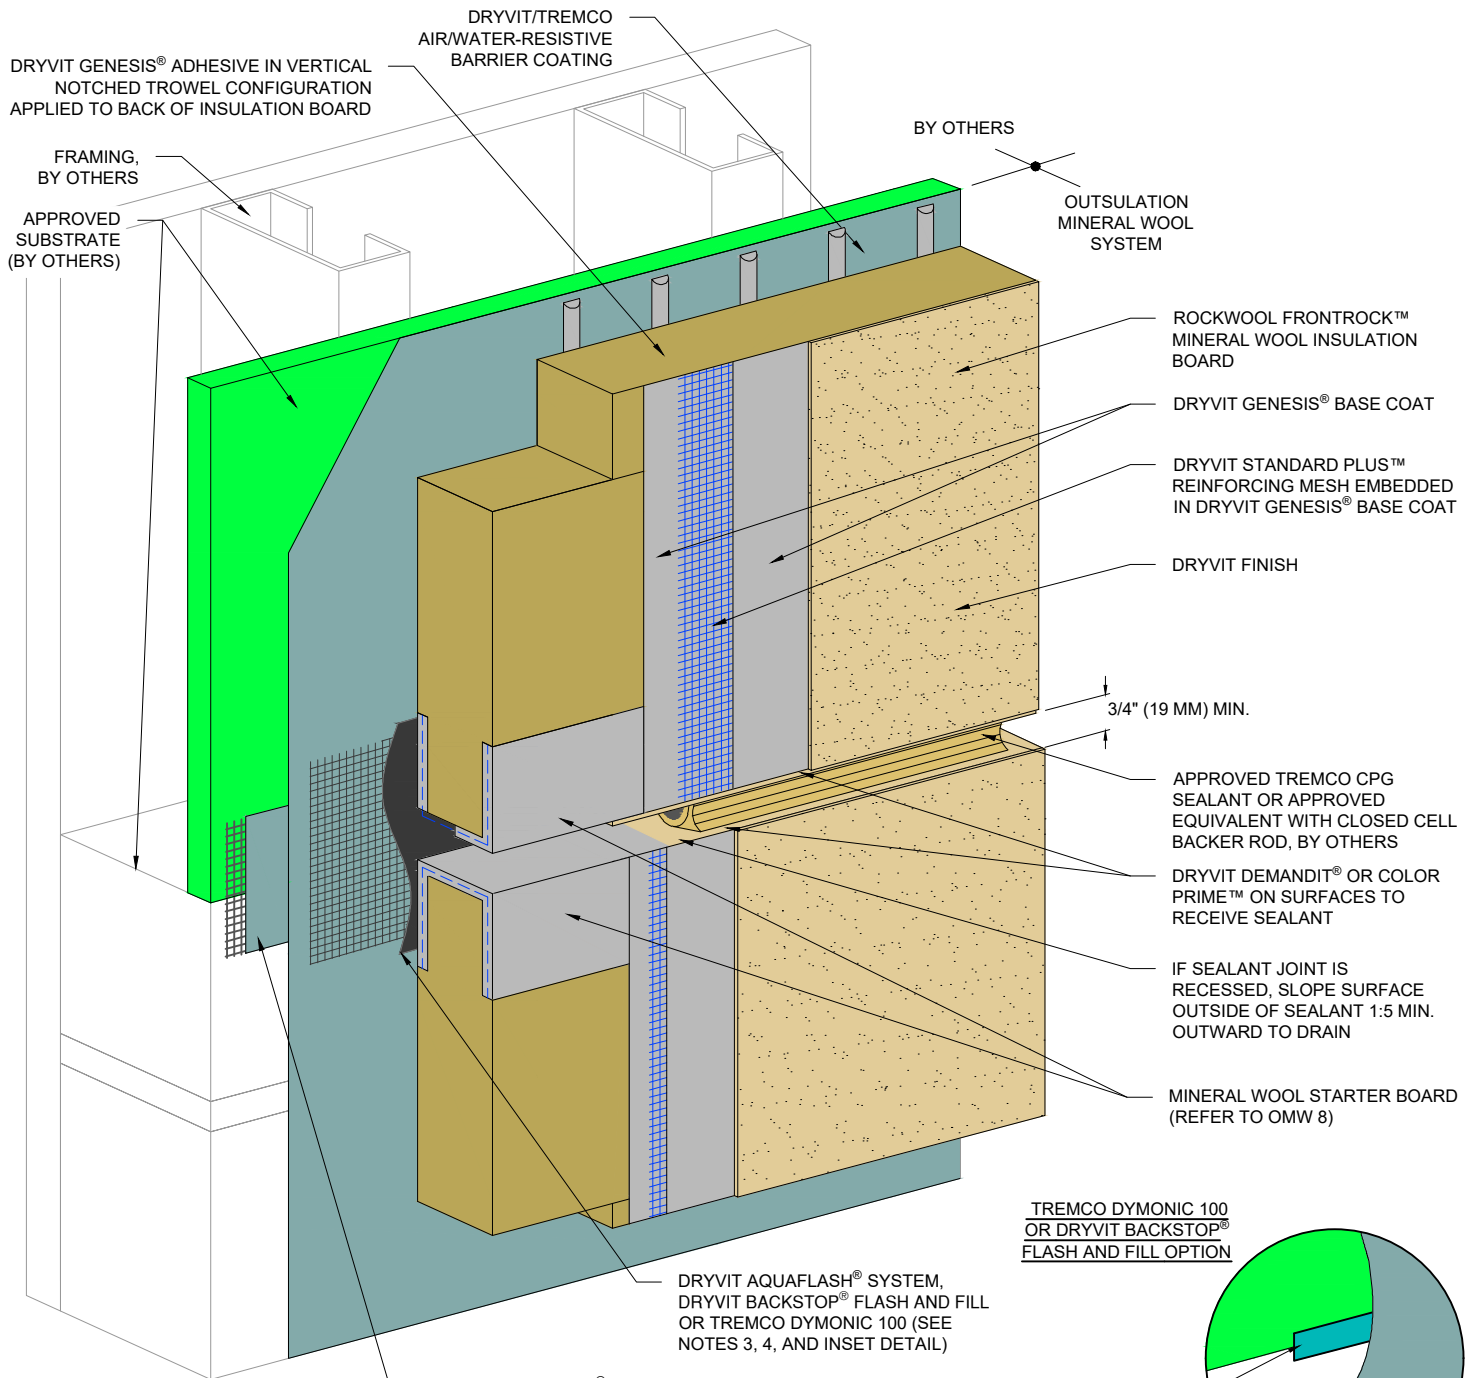

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO DETAIL OMW 28 AND 28a FOR CONFIGURATION REQUIRING WEEPS.
3. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
4. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
6. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
7. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Horizontal Joint - Substrate Change

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 29



Construction Products Group

www.tremcocpg.com

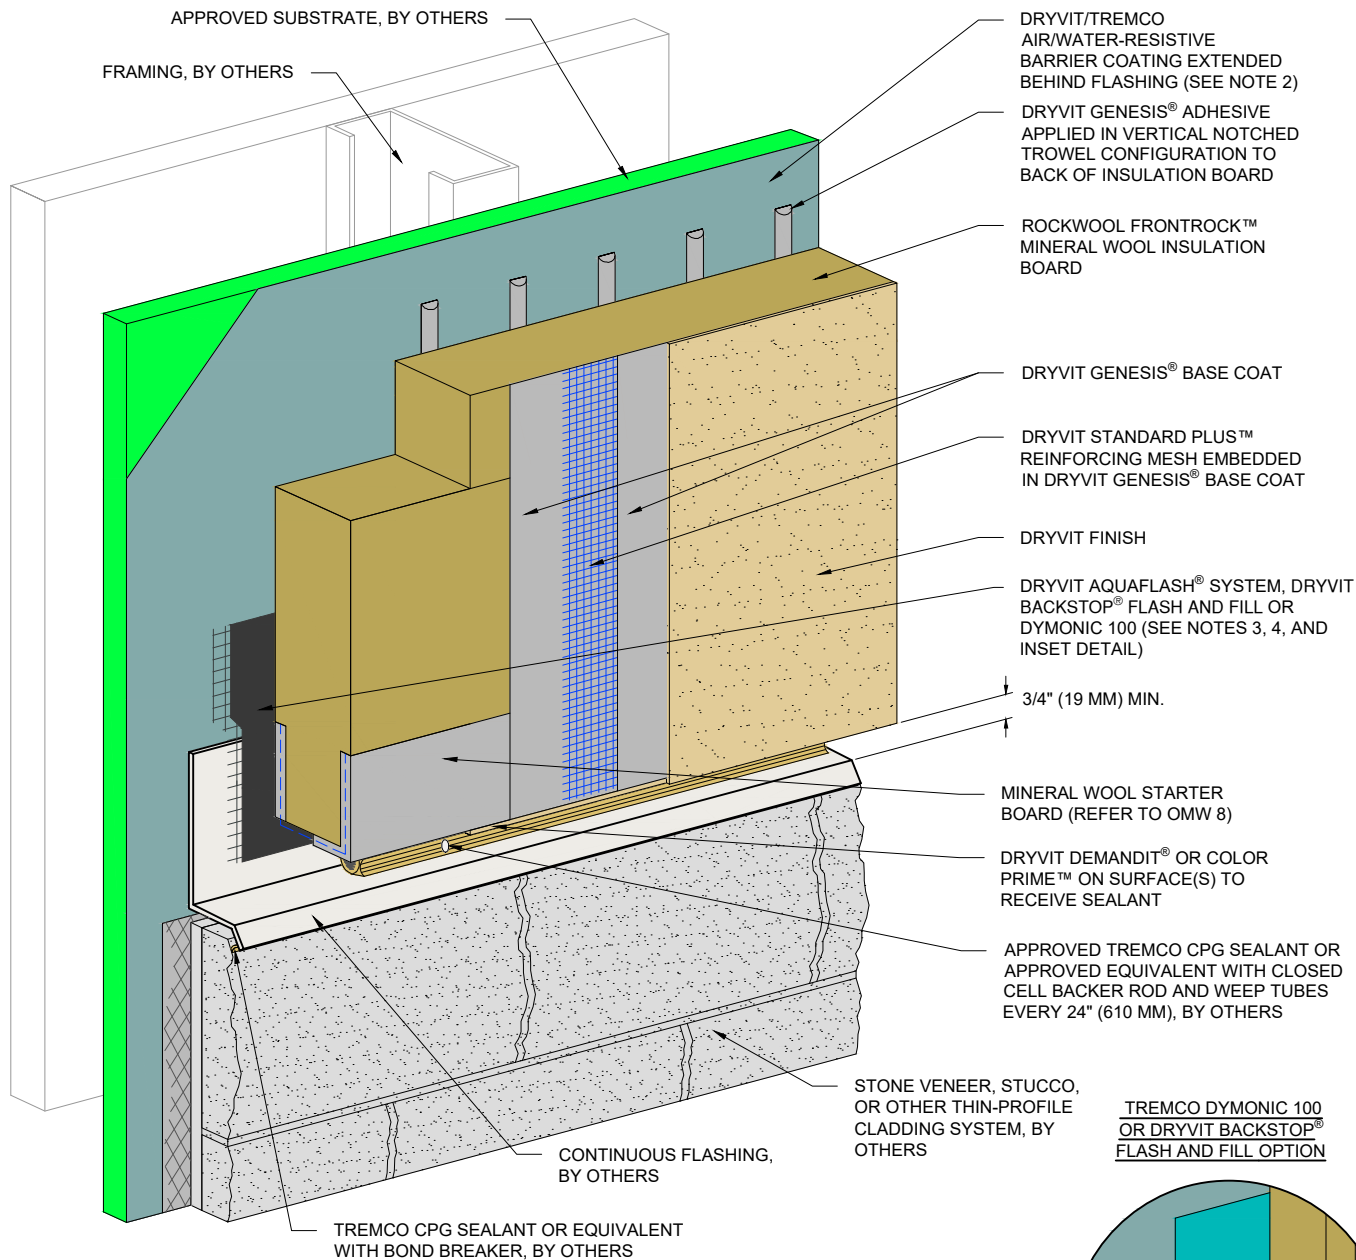

NOTE:

- | | | |
|---|---|---|
| <p>1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.</p> <p>2. FOR INSTALLATION OF DRYVIT/TREMCO AIR/WATER-RESISTIVE BARRIER COATING BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840.</p> <p>3. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.</p> | <p>4. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.</p> <p>5. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.</p> <p>6. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.</p> | <p>7. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.</p> <p>8. DESIGNER SHALL SPECIFY METAL FLASHING DIMENSION SUCH THAT THE AQUAFASH SYSTEM CAN LAP ONTO THE VERTICAL LEG NO LESS THAN 2".</p> <p><small>This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.</small></p> |
|---|---|---|

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Horizontal Termination at Adjacent Thin Profile Cladding

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 30



Construction Products Group

www.tremcocpg.com

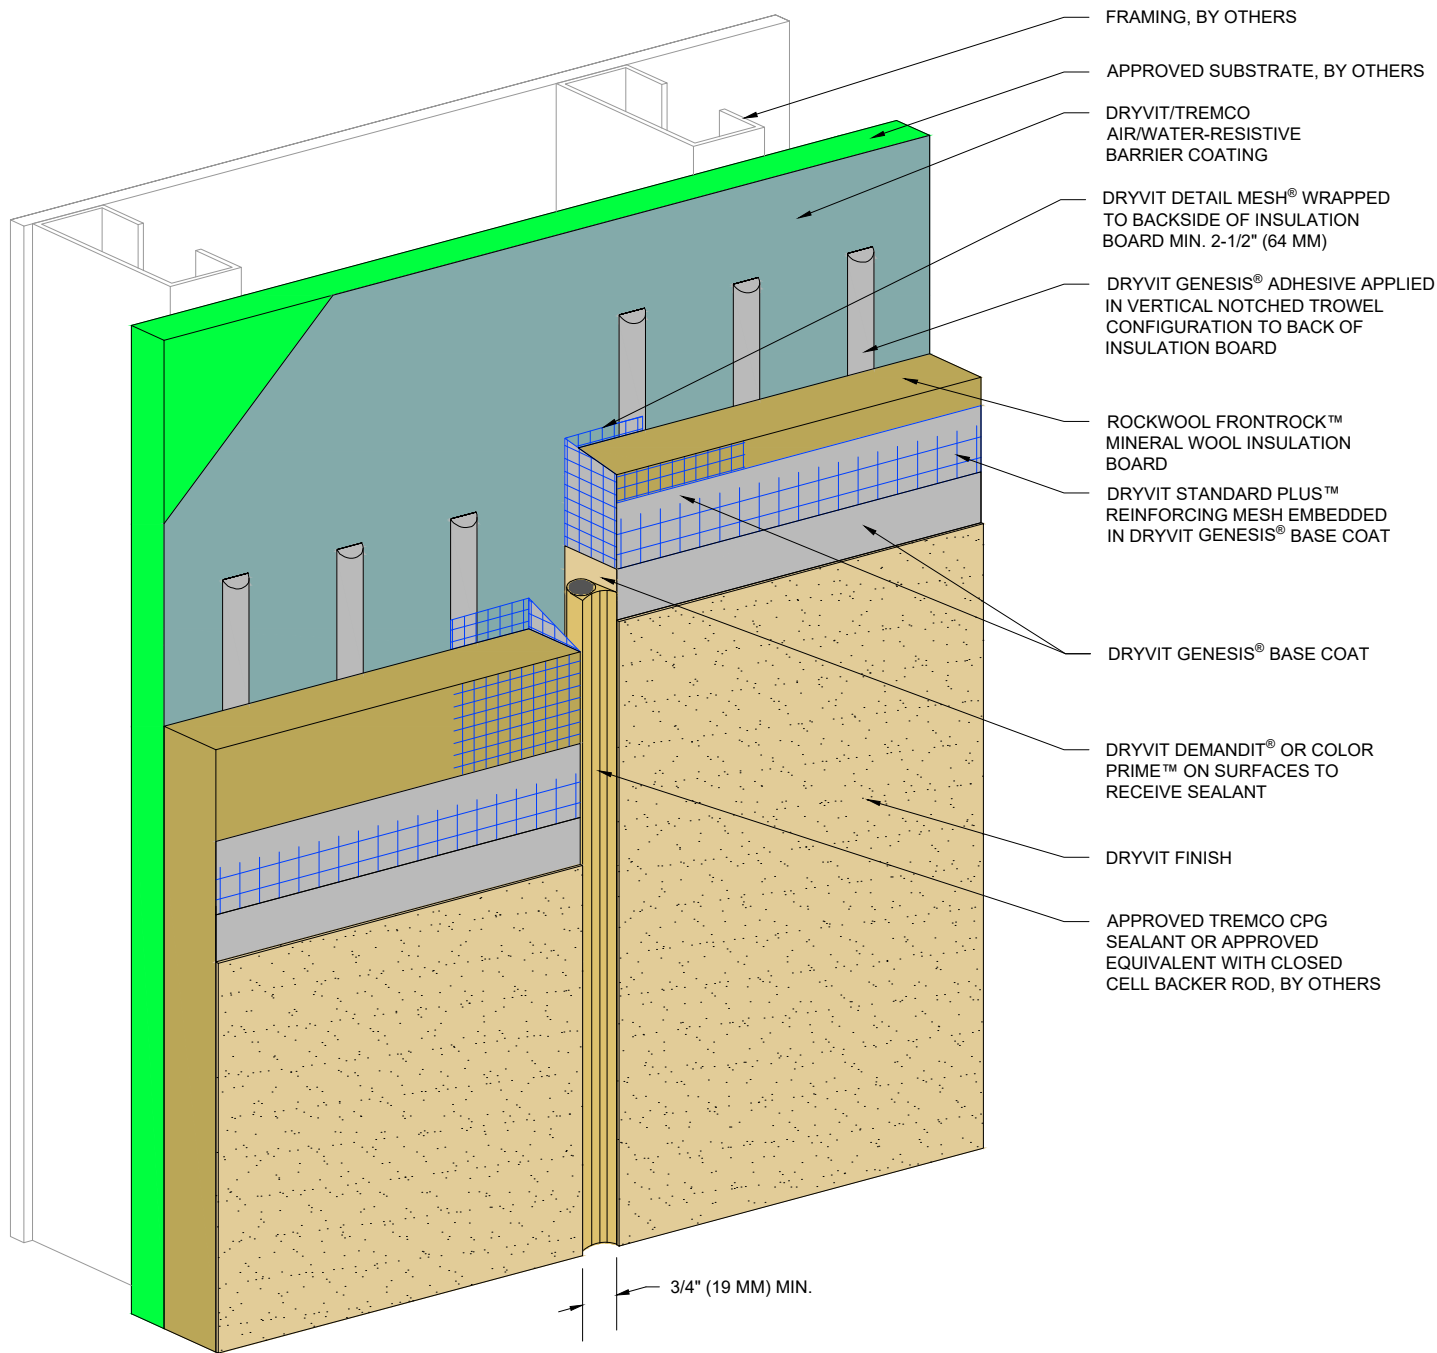

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
 2. OUTSULATION MINERAL WOOL EXPANSION JOINTS ARE REQUIRED IN CONTINUOUS ELEVATIONS AT INTERVALS NOT EXCEEDING 50 FT (15.2 M).
 3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
 4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
 6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
- This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.*

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Vertical EIFS Expansion Joint

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 31



Construction Products Group

www.tremcocpg.com

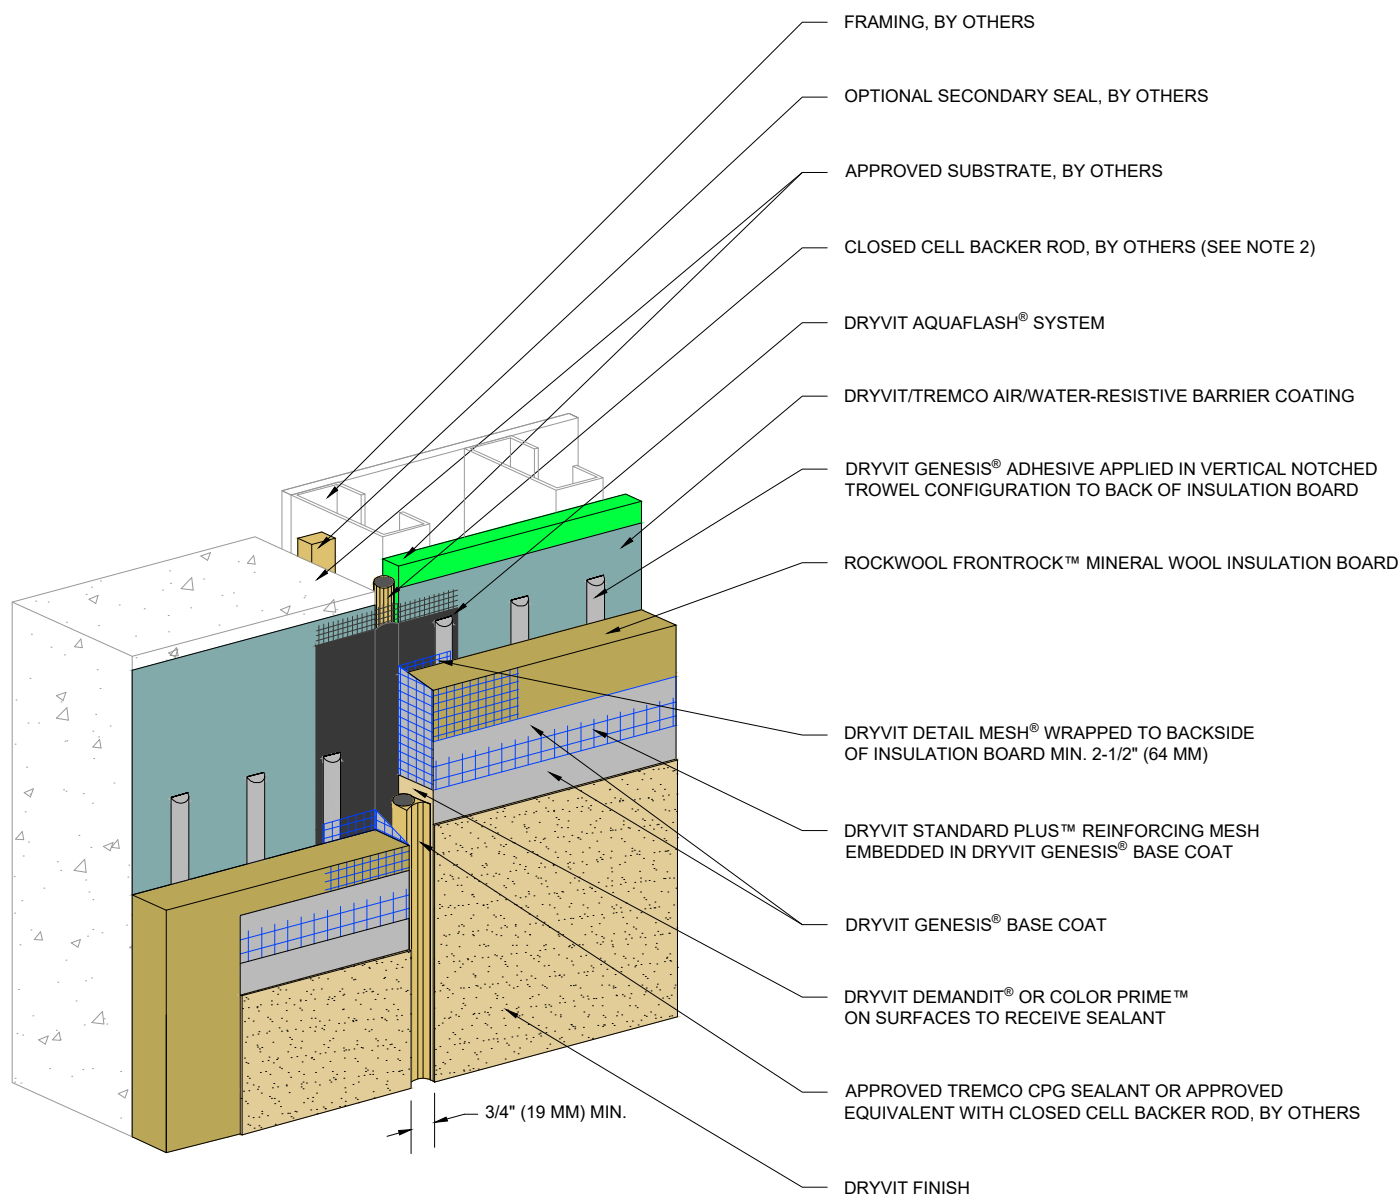

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF SUBSTRATE JOINT.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Through-Wall Expansion Joint

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 32




Construction Products Group

www.tremcocpg.com

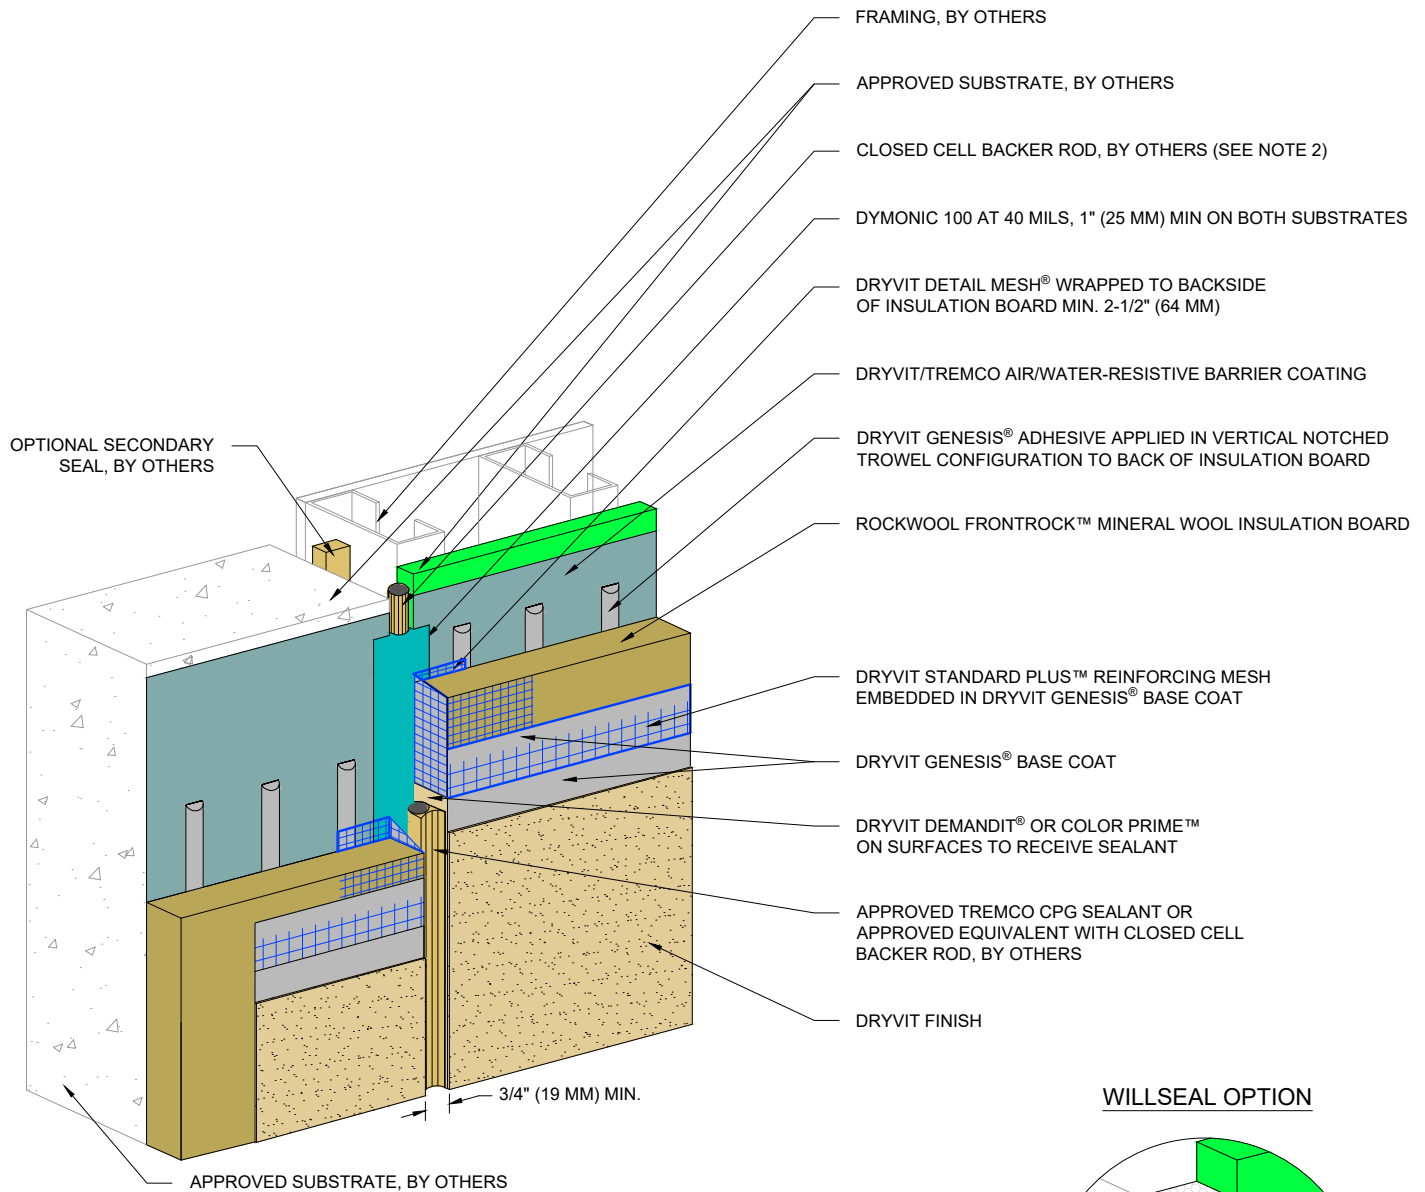

WILLSEAL OPTION

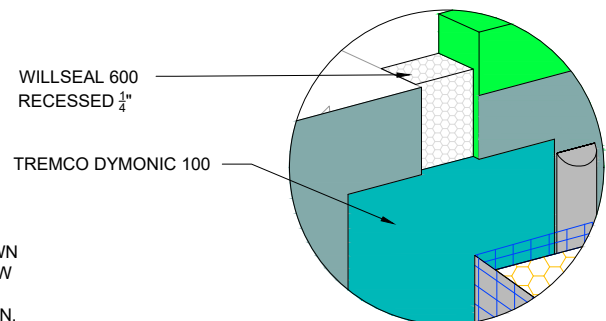

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. LOCATE EXTERNAL SEALANT JOINT WITHIN 2" (51 MM) OF SUBSTRATE JOINT.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Through-Wall Expansion Joint -
Dymonic 100 Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 32a



Construction Products Group

www.tremcocpg.com

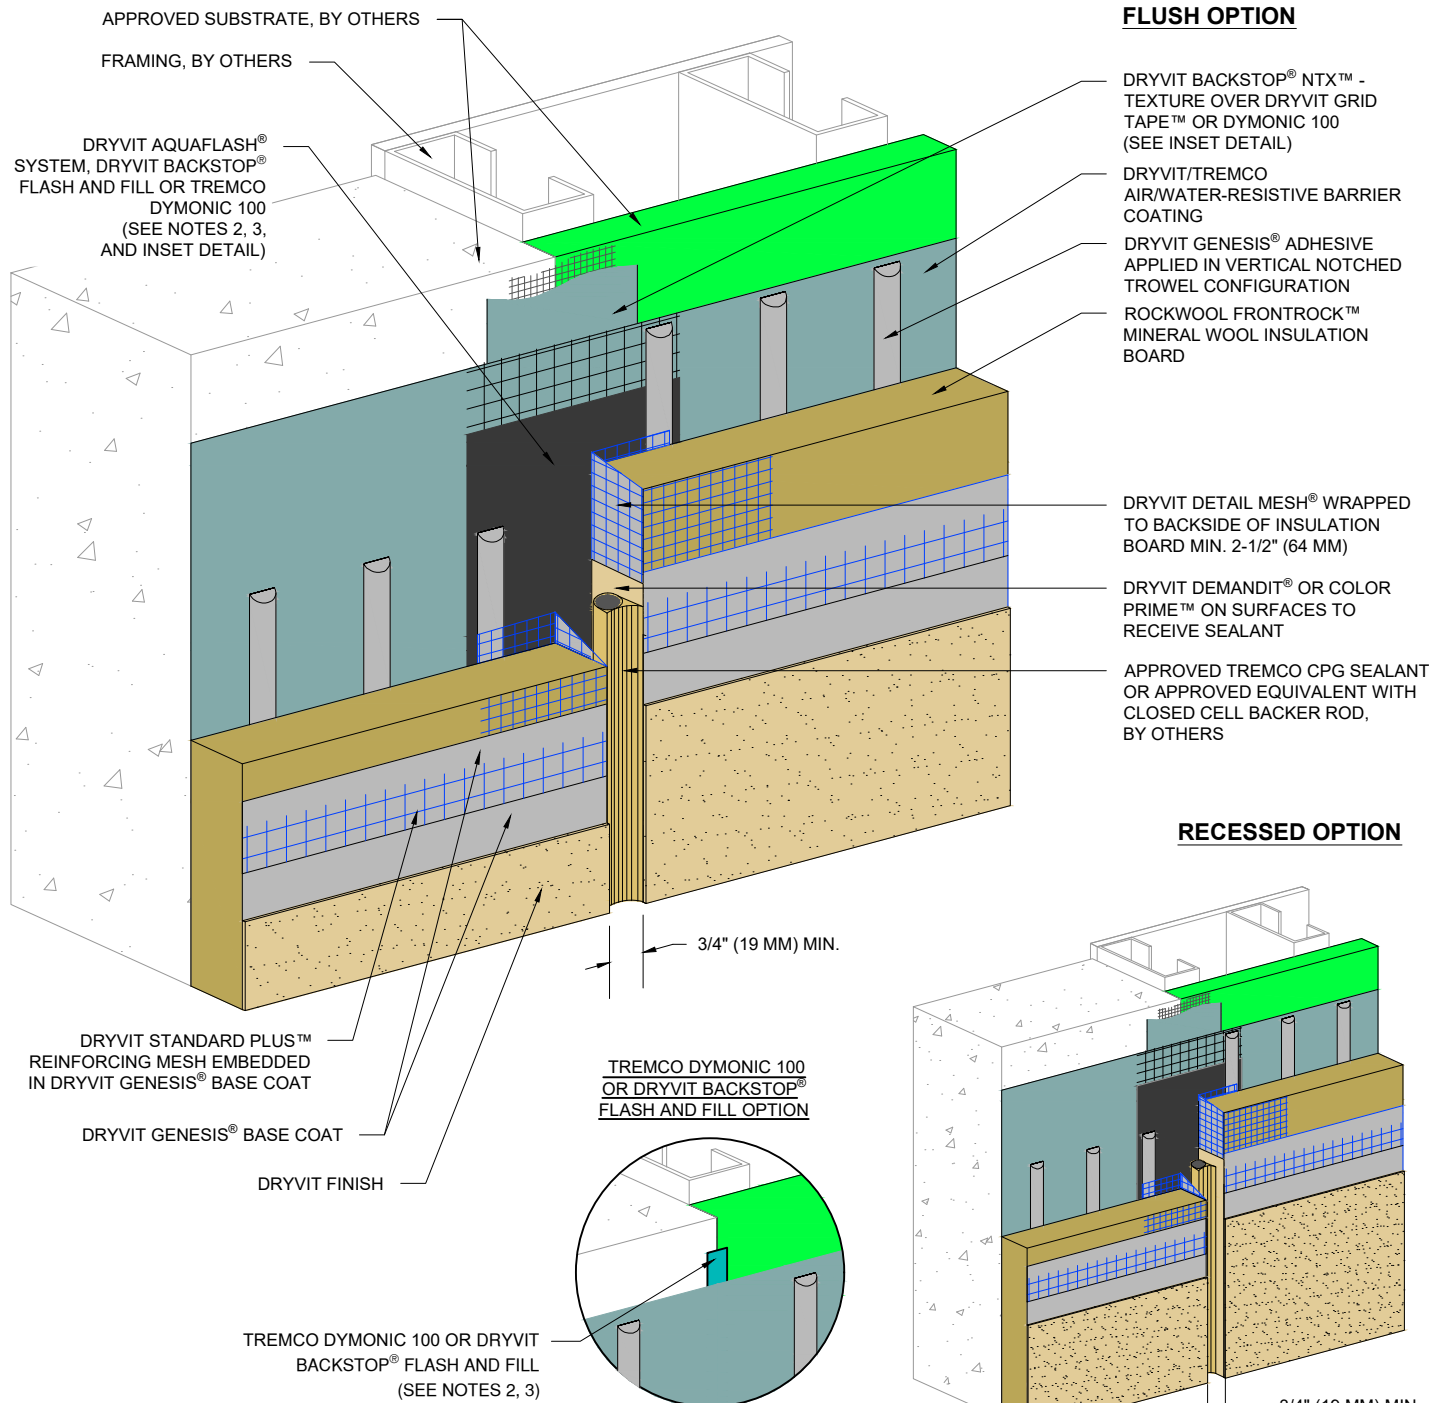

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
4. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Vertical Expansion Joint - Flush and Recessed Options

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 33



Construction Products Group


www.tremcocpg.com

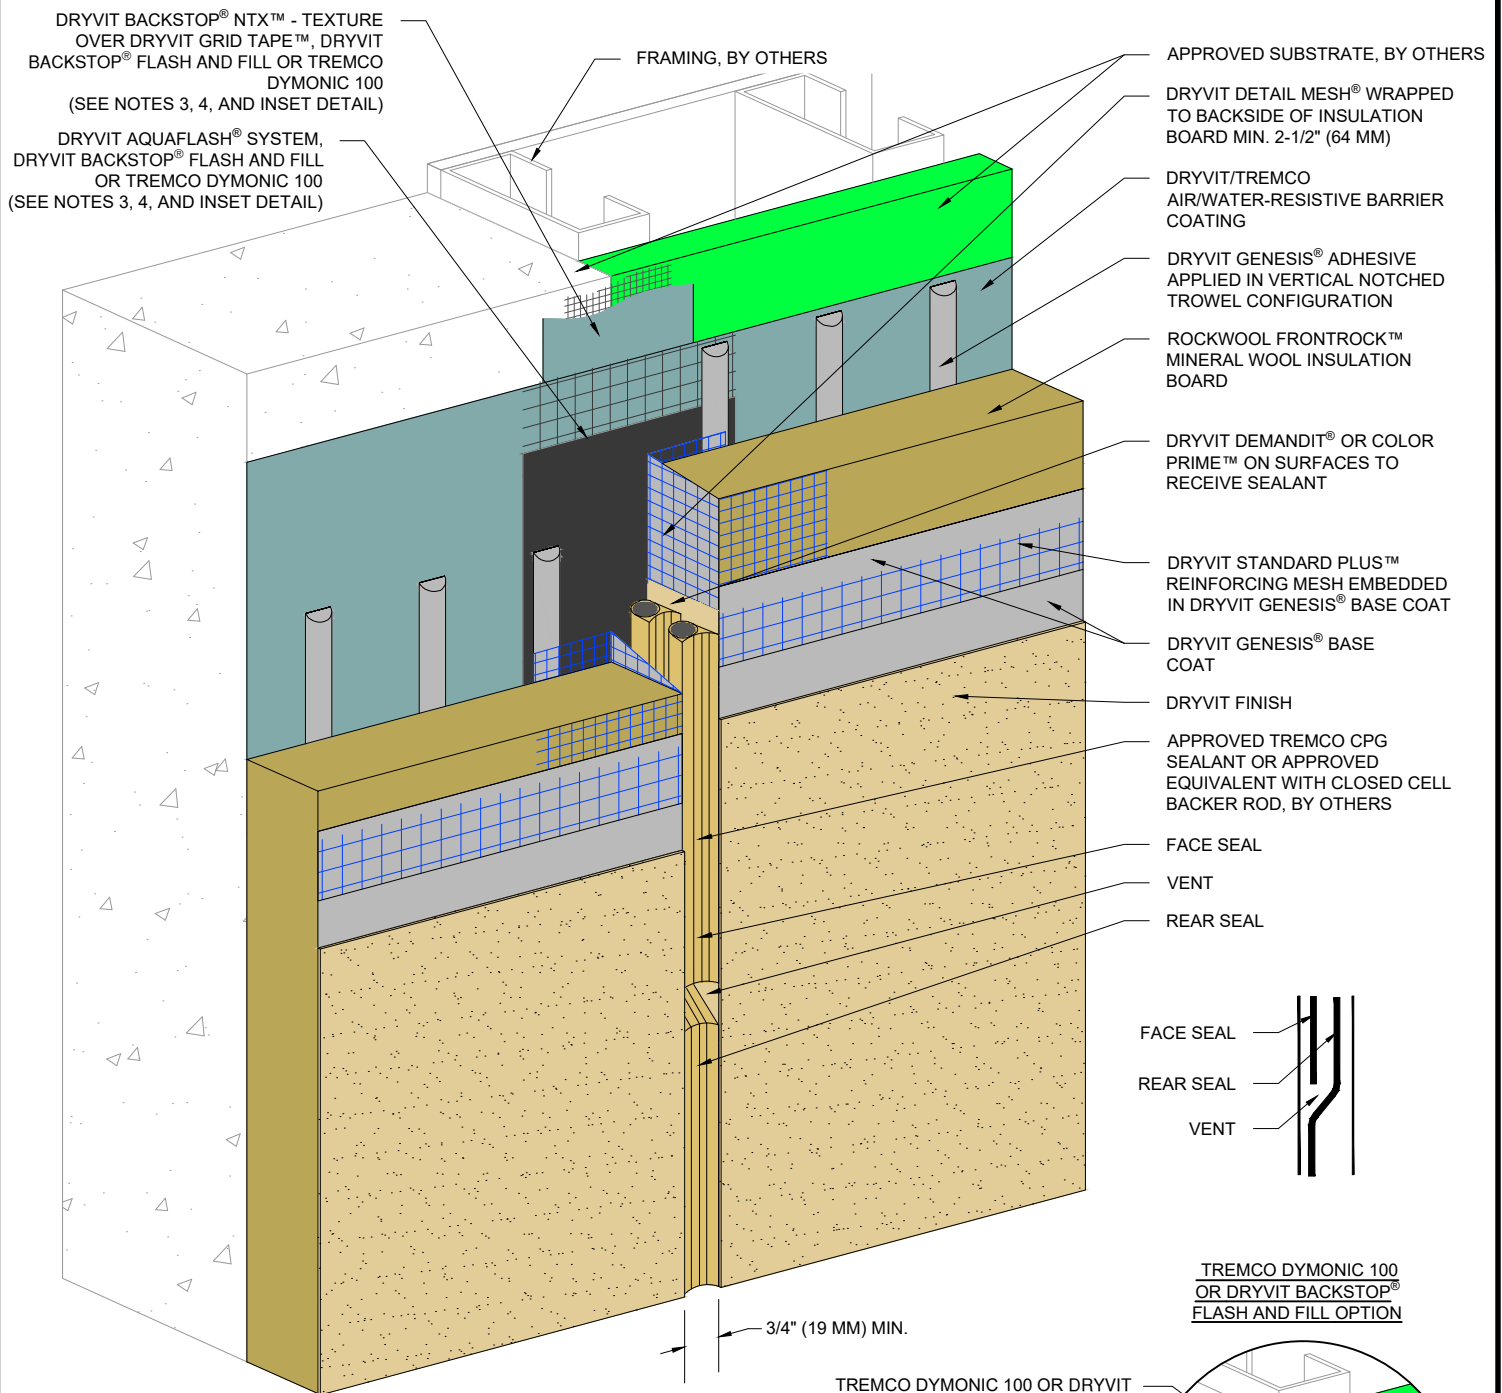

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
4. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
5. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

TREMCO DYMONIC 100 OR DRYVIT BACKSTOP® FLASH AND FILL (SEE NOTES 2, 3)

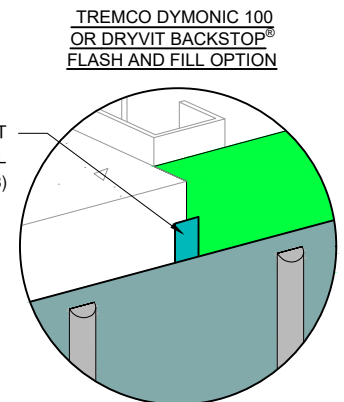

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Vertical Expansion Joint - Double Seal Option

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 34



Construction Products Group

www.tremcocpg.com

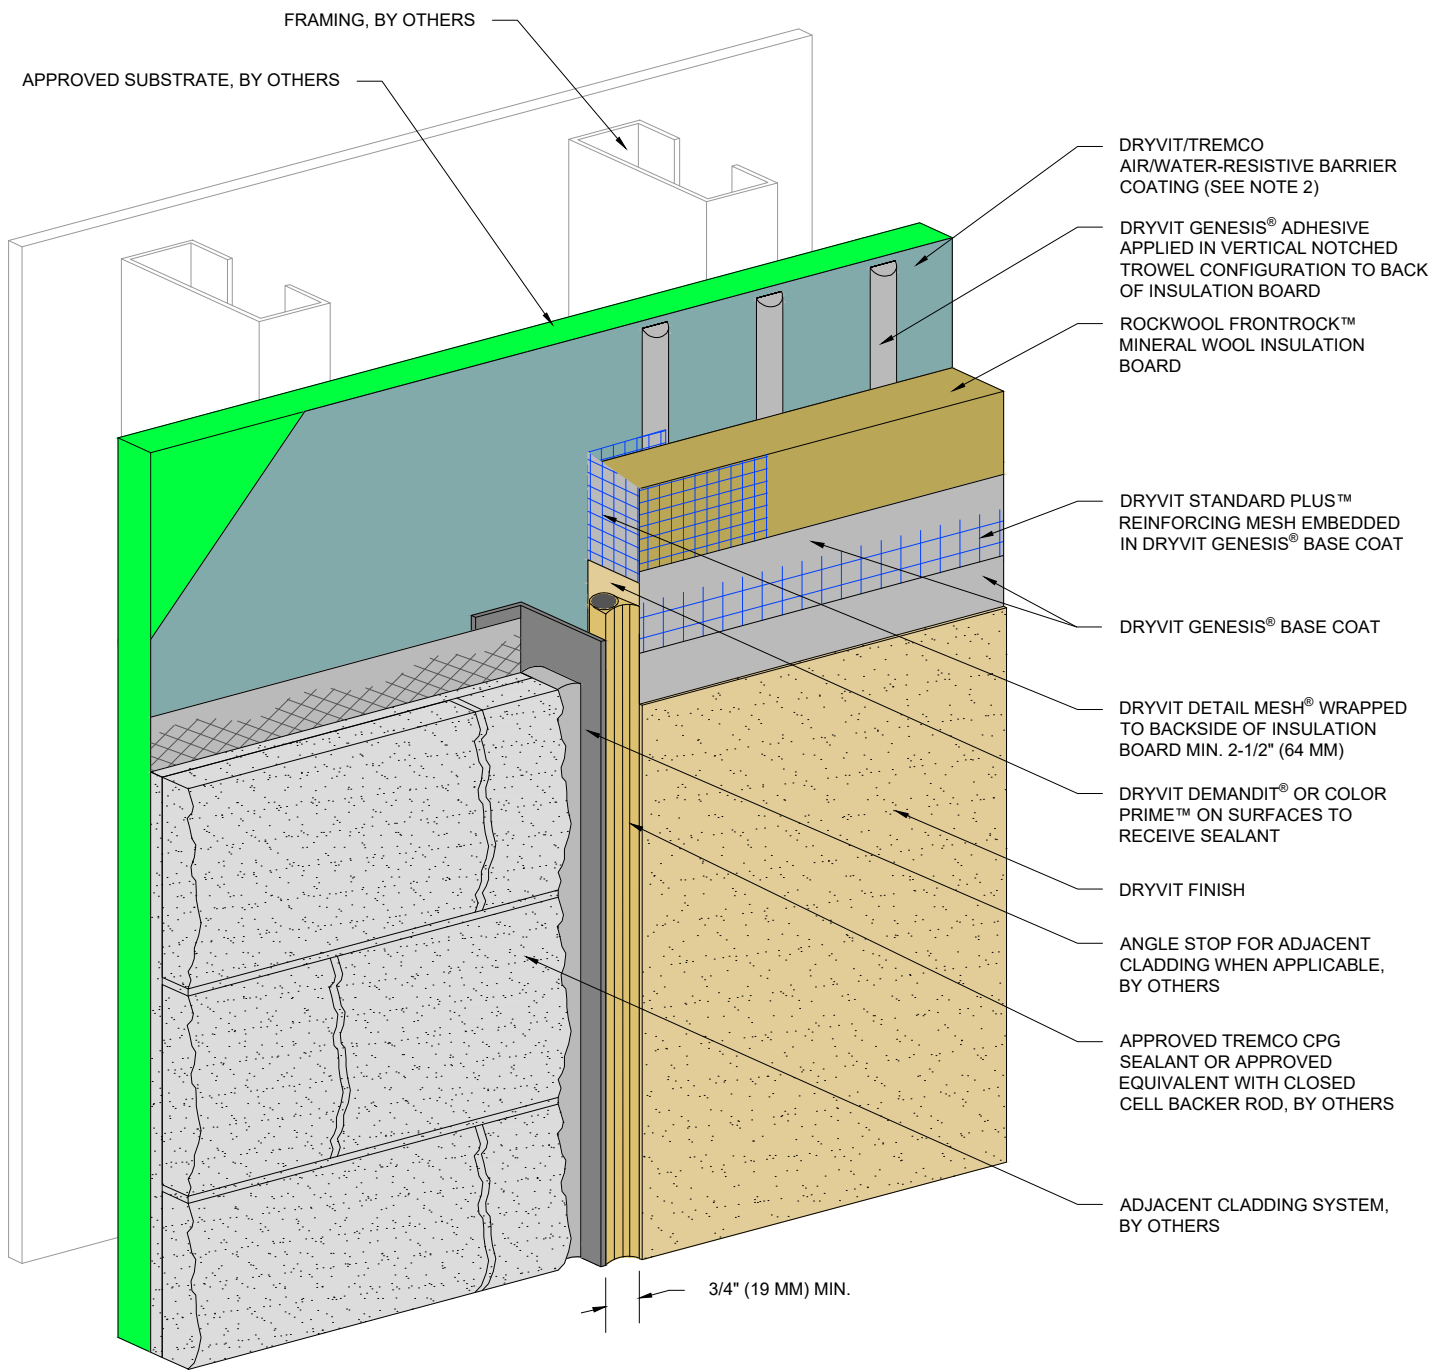

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. FOR INSTALLATION OF BACKSTOP® NTX™ BENEATH CLADDINGS OTHER THAN DRYVIT EIFS, REFER TO DRYVIT PUBLICATION DS840.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Vertical Termination At Adjacent Cladding

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 35



Construction Products Group

www.tremcocpg.com

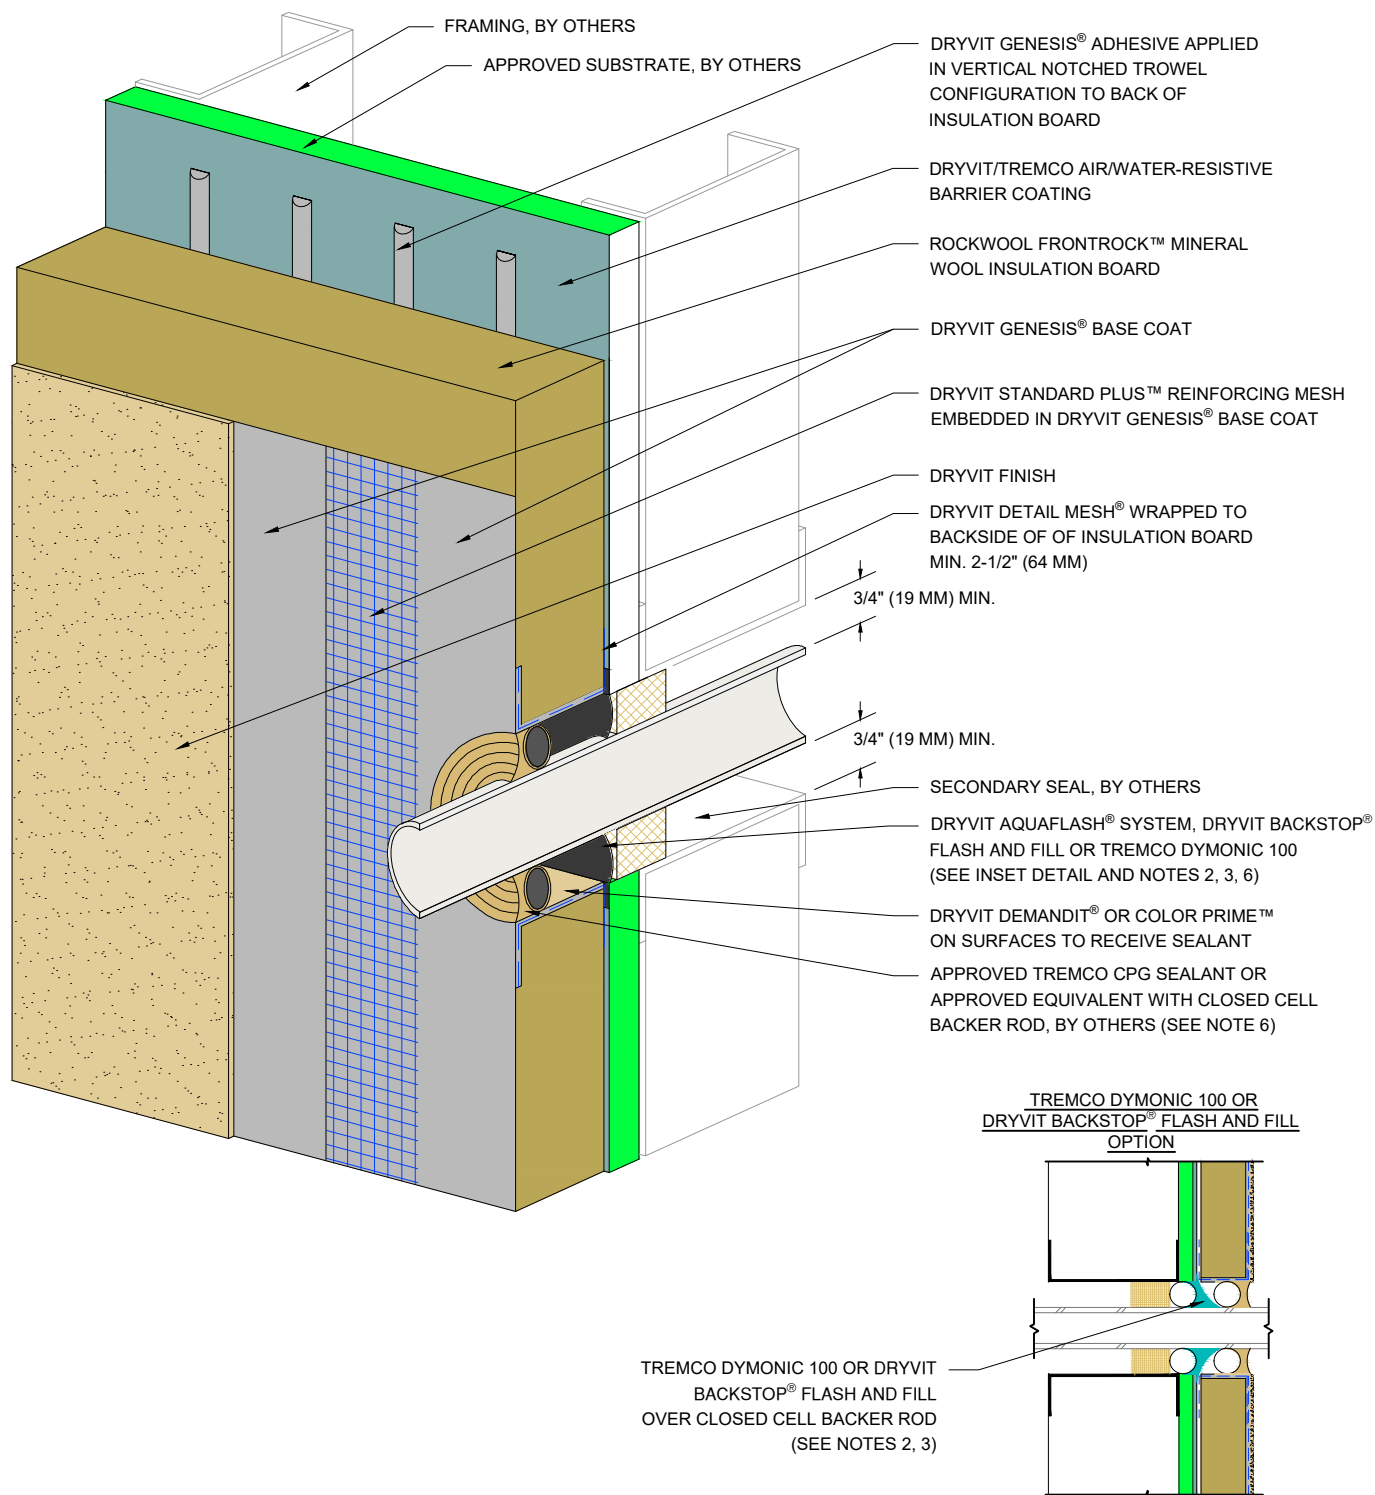

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. REFER TO PRODUCT DATA SHEETS FOR SPECIFIC APPLICATION METHODS.
3. BACKSTOP® FLASH AND FILL MAY ONLY BE USED WITH BACKSTOP® NTX™ AWRB.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

6. DYMONIC 100 SHALL ONLY BE USED AT THE PLANE OF THE AIR BARRIER AND SHALL NOT BE PERMITTED FOR USE AS THE OUTER PERIMETER SEALANT.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Penetrations

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024


File Name:

OMW 36



Construction Products Group

www.tremcocpg.com

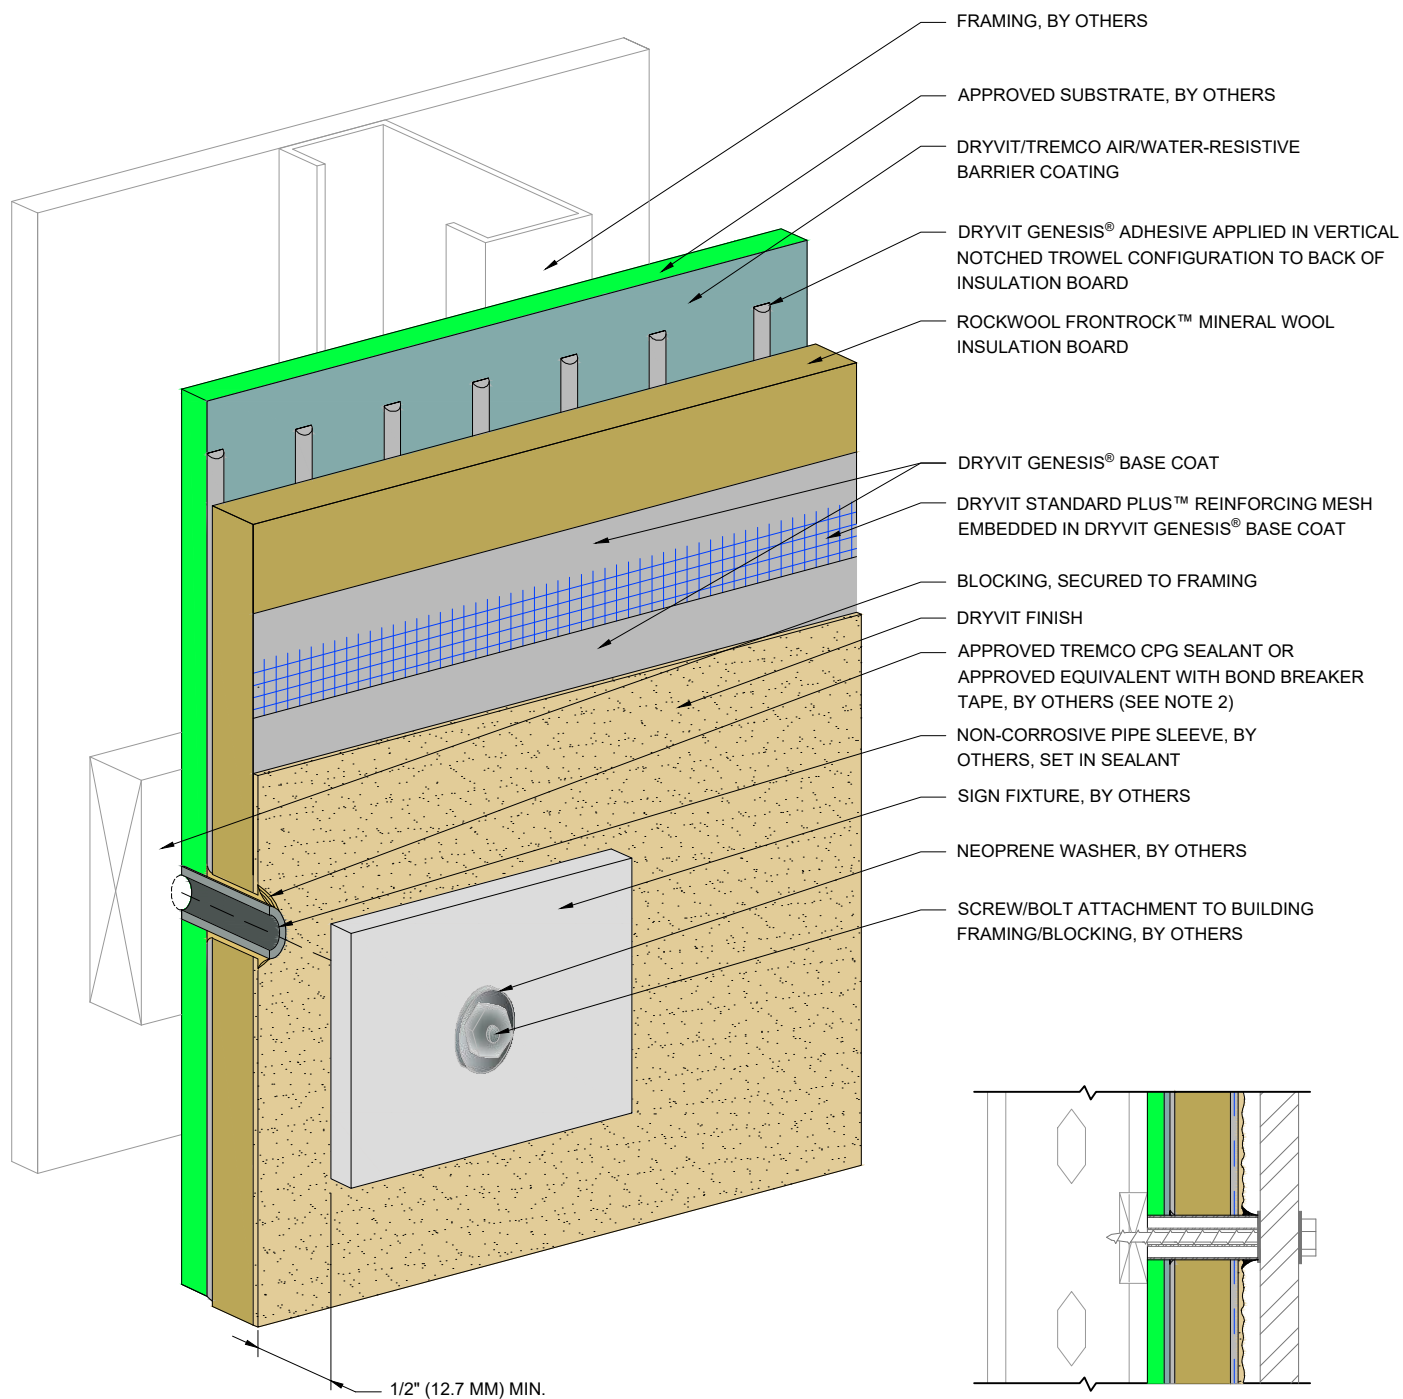

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. PERIMETER OF PIPE SLEEVE IS SEALED TO PREVENT WATER ENTRY INTO WALL.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
5. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Sign Attachment

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 37



Construction Products Group

www.tremcocpg.com

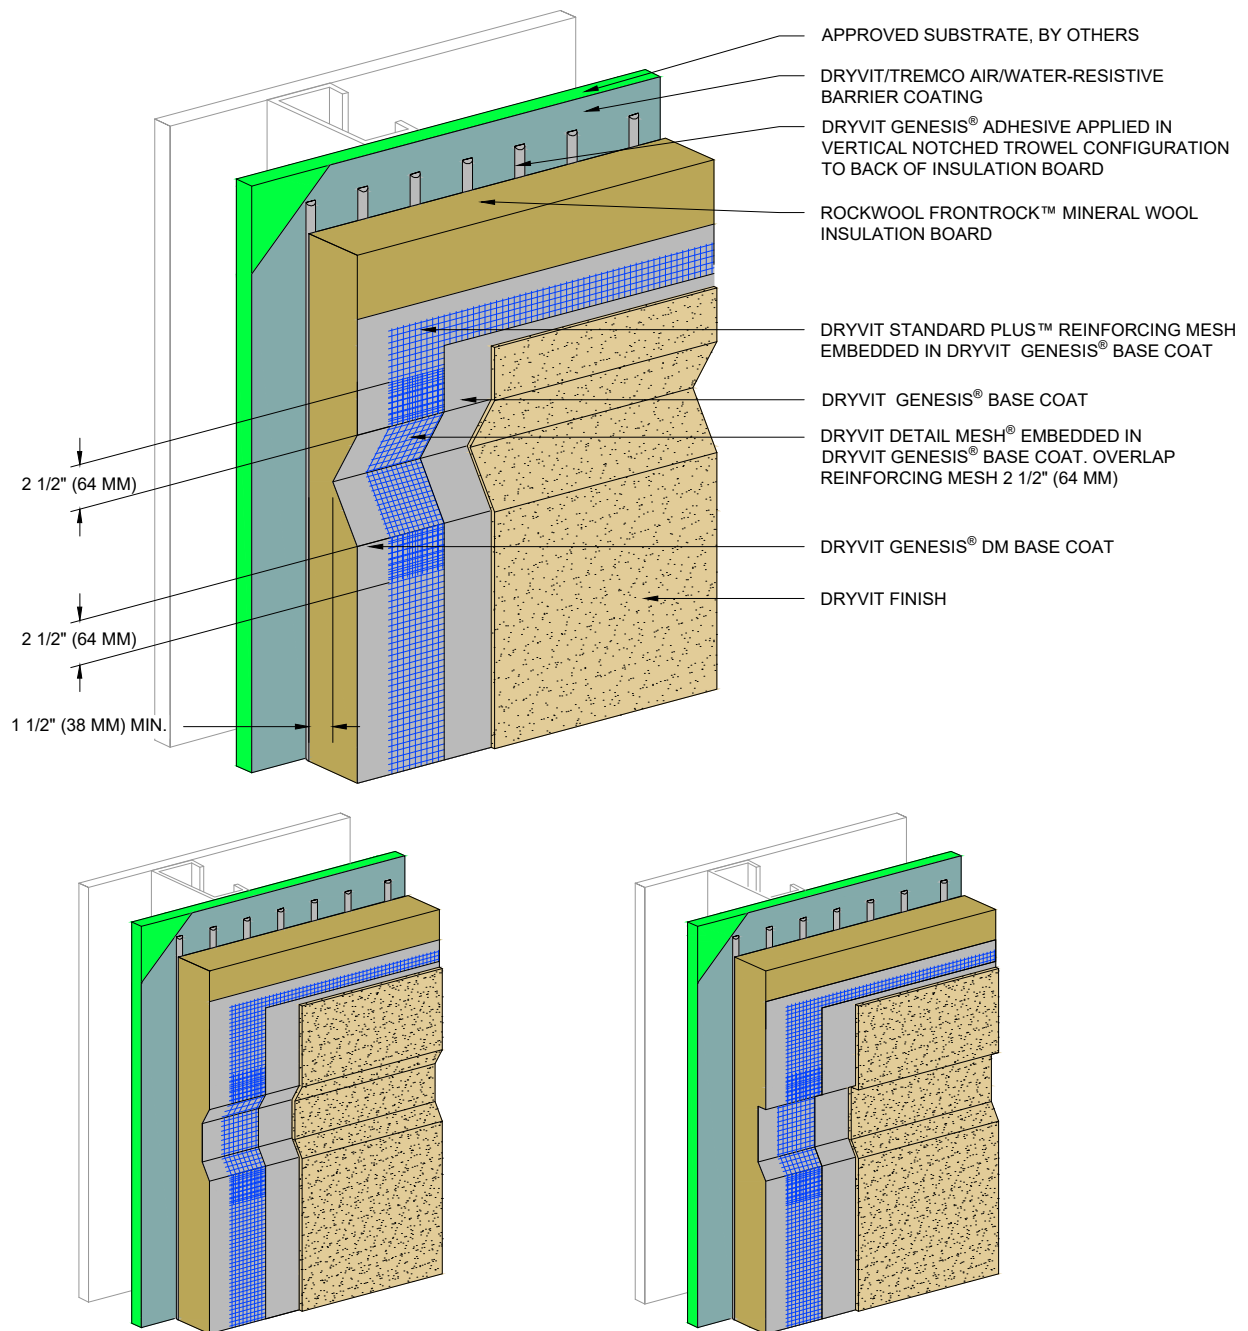

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. SLOPE BOTTOM EDGE OF REVEAL FOR POSITIVE DRAINAGE. REFER TO DS982 FOR SLOPE REQUIREMENTS.
3. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
4. MECHANICAL FASTENERS NOT SHOWN FOR CLARITY. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS. FASTENERS SHALL BE PLACED AT LEAST 4" FROM REVEALS.
5. COORDINATE AESTHETIC REVEAL LAYOUT AND ALIGNMENT WITH REQUIRED MECHANICAL FASTENER LOCATIONS. DO NOT ALTER MECHANICAL FASTENER LAYOUT. DO NOT REMOVE MECHANICAL FASTENERS WHICH HAVE BEEN INSTALLED. INSULATION BOARD THICKNESS AT BASE OF REVEAL SHALL BE NO LESS THAN 1.5".
6. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.

This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Aesthetic Reveals

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 2/28/2024


File Name:

OMW 38



Construction Products Group

www.tremcocpg.com

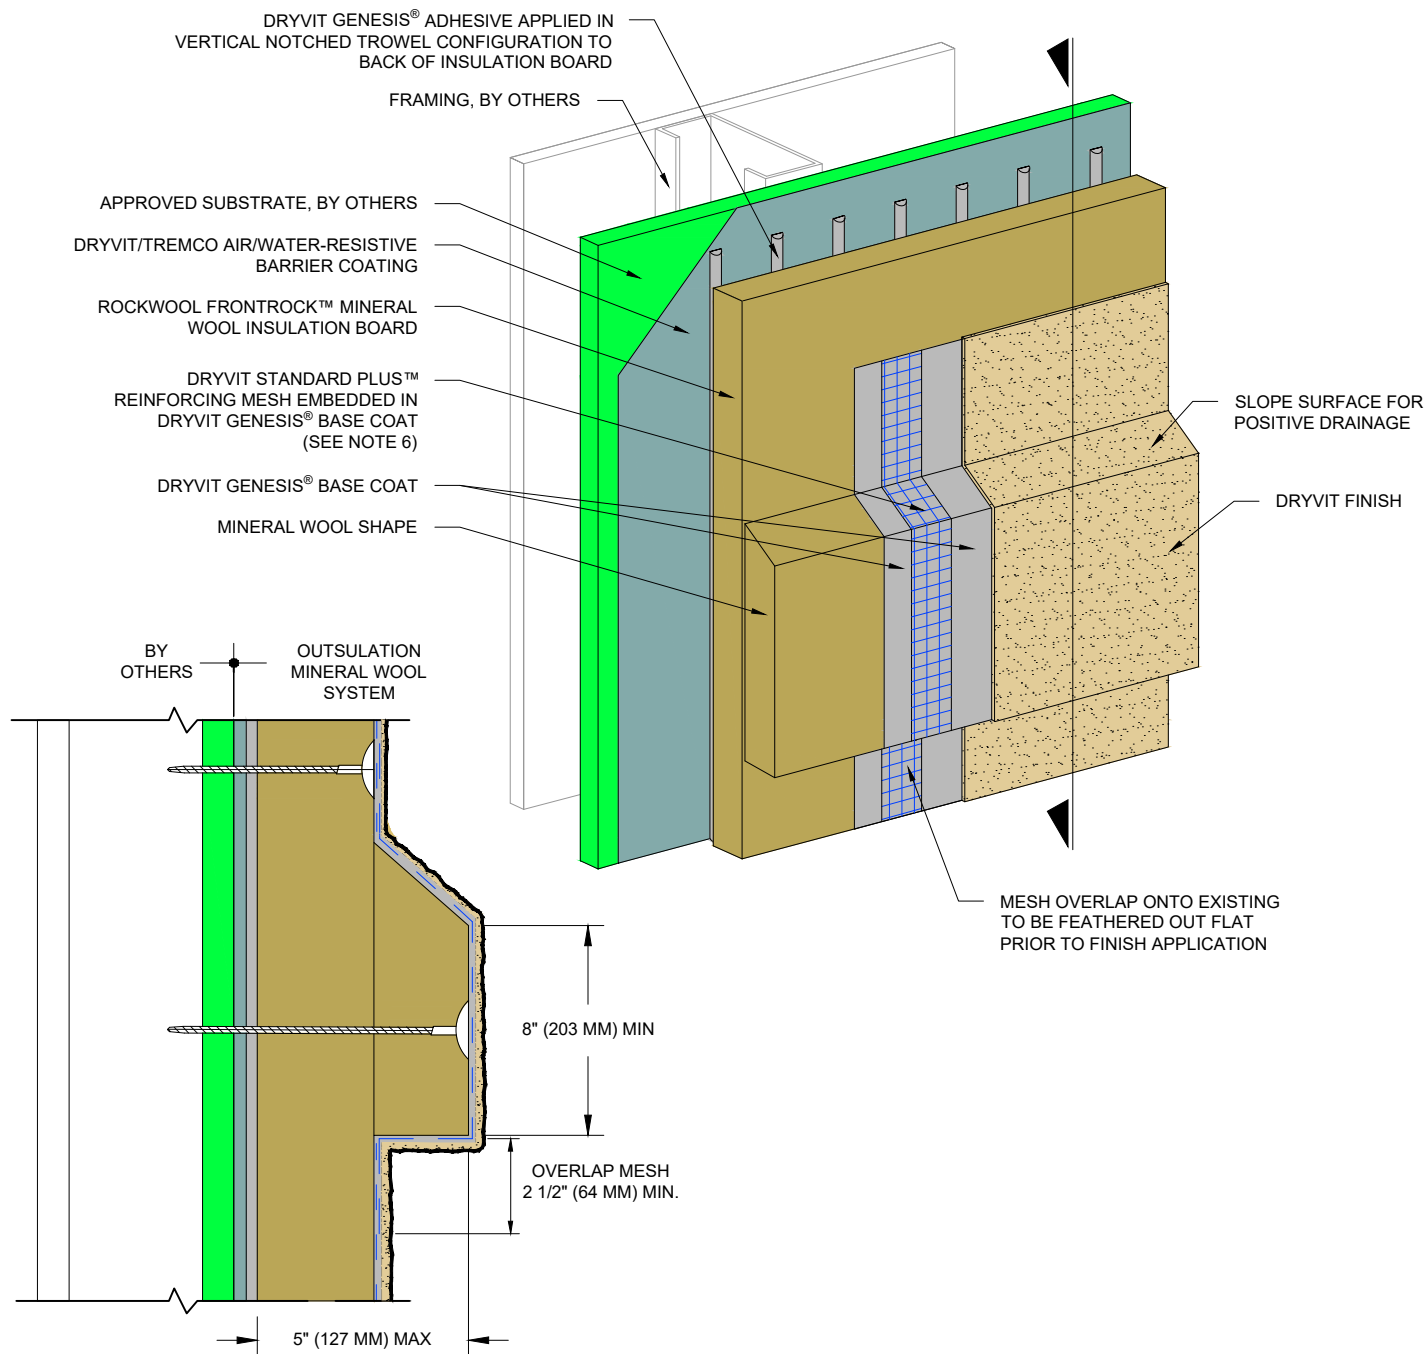

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD™ OR STANDARD PLUS™ MESH. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
2. ALLOW ADHESIVE TO DRY IN ADVANCE OF INSTALLING FASTENERS. SPOT FASTENER/WASHER WITH DRYVIT GENESIS® BASE COAT. SUPPORT MINERAL WOOL INSULATION BOARD, AS REQUIRED, WHILE ADHESIVE DRIES.
3. REFER TO OMW 6, OMW 6a, AND OMW 7 FOR MECHANICAL FASTENER TYPE, LAYOUT, DIMENSION, AND WIND LOAD LIMITS.
4. ADDITIONAL FRAMING MEMBERS MAY BE REQUIRED TO ACCOMMODATE MECHANICAL FASTENER LAYOUT AND DIMENSIONAL REQUIREMENTS. COORDINATE WITH FRAMING SUB-CONTRACTOR.
5. SLOPE TOP SIDE OF MINERAL WOOL SHAPE FOR POSITIVE DRAINING. REFER TO DS982 FOR SLOPE REQUIREMENTS.
6. DETAIL MESH SHOULD BE USED WHEN MINERAL WOOL SHAPE EXHIBITS A HORIZONTAL BOTTOM SURFACE. OVERLAP MESH JOINTS NO LESS THAN 2.5".

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

Outsulation® Mineral Wool System



Dryvit Technical Support: 800-556-7752

Detail: Field-Fabricated Mineral Wool Shapes

Drawn by: HDE

Checked by: CW

Scale: NTS

Date: 4/3/2024

File Name:

OMW 39



Construction Products Group

www.tremcocpg.com